



NOTES:



- EXISTING DISCONNECT AND DUPLEX RECEPTACLES ASSOCIATED WITH EXISTING CHLORINE INJECTION SYSTEM TO BE RELOCATED TO SUIT NEW LOCATION OF CHLORINE INJECTION SYSTEM. REFER TO MECHANICAL DRAWINGS FOR EXACT DETAILS.

LEGEND:

-  ELECTRICAL PANELBOARD
-  MOTOR LOAD

RENOVATION LEGEND:


- X EXISTING ELECTRICAL EQUIPMENT TO BE REMOVED AND TURNED OVER TO THE CONTRACT ADMINISTRATOR. REMOVE, BLANK OFF, EXTEND OR RELOCATE ALL ASSOCIATED WIRING AND MAKE SAFE.
- * EXISTING ELECTRICAL EQUIPMENT TO BE REMOVED AND REINSTALLED OR RELOCATED AS SHOWN UPON COMPLETION OF NEW CEILING OR WALL CONSTRUCTION. RE-WIRE OR EXTEND WIRING AS REQUIRED.

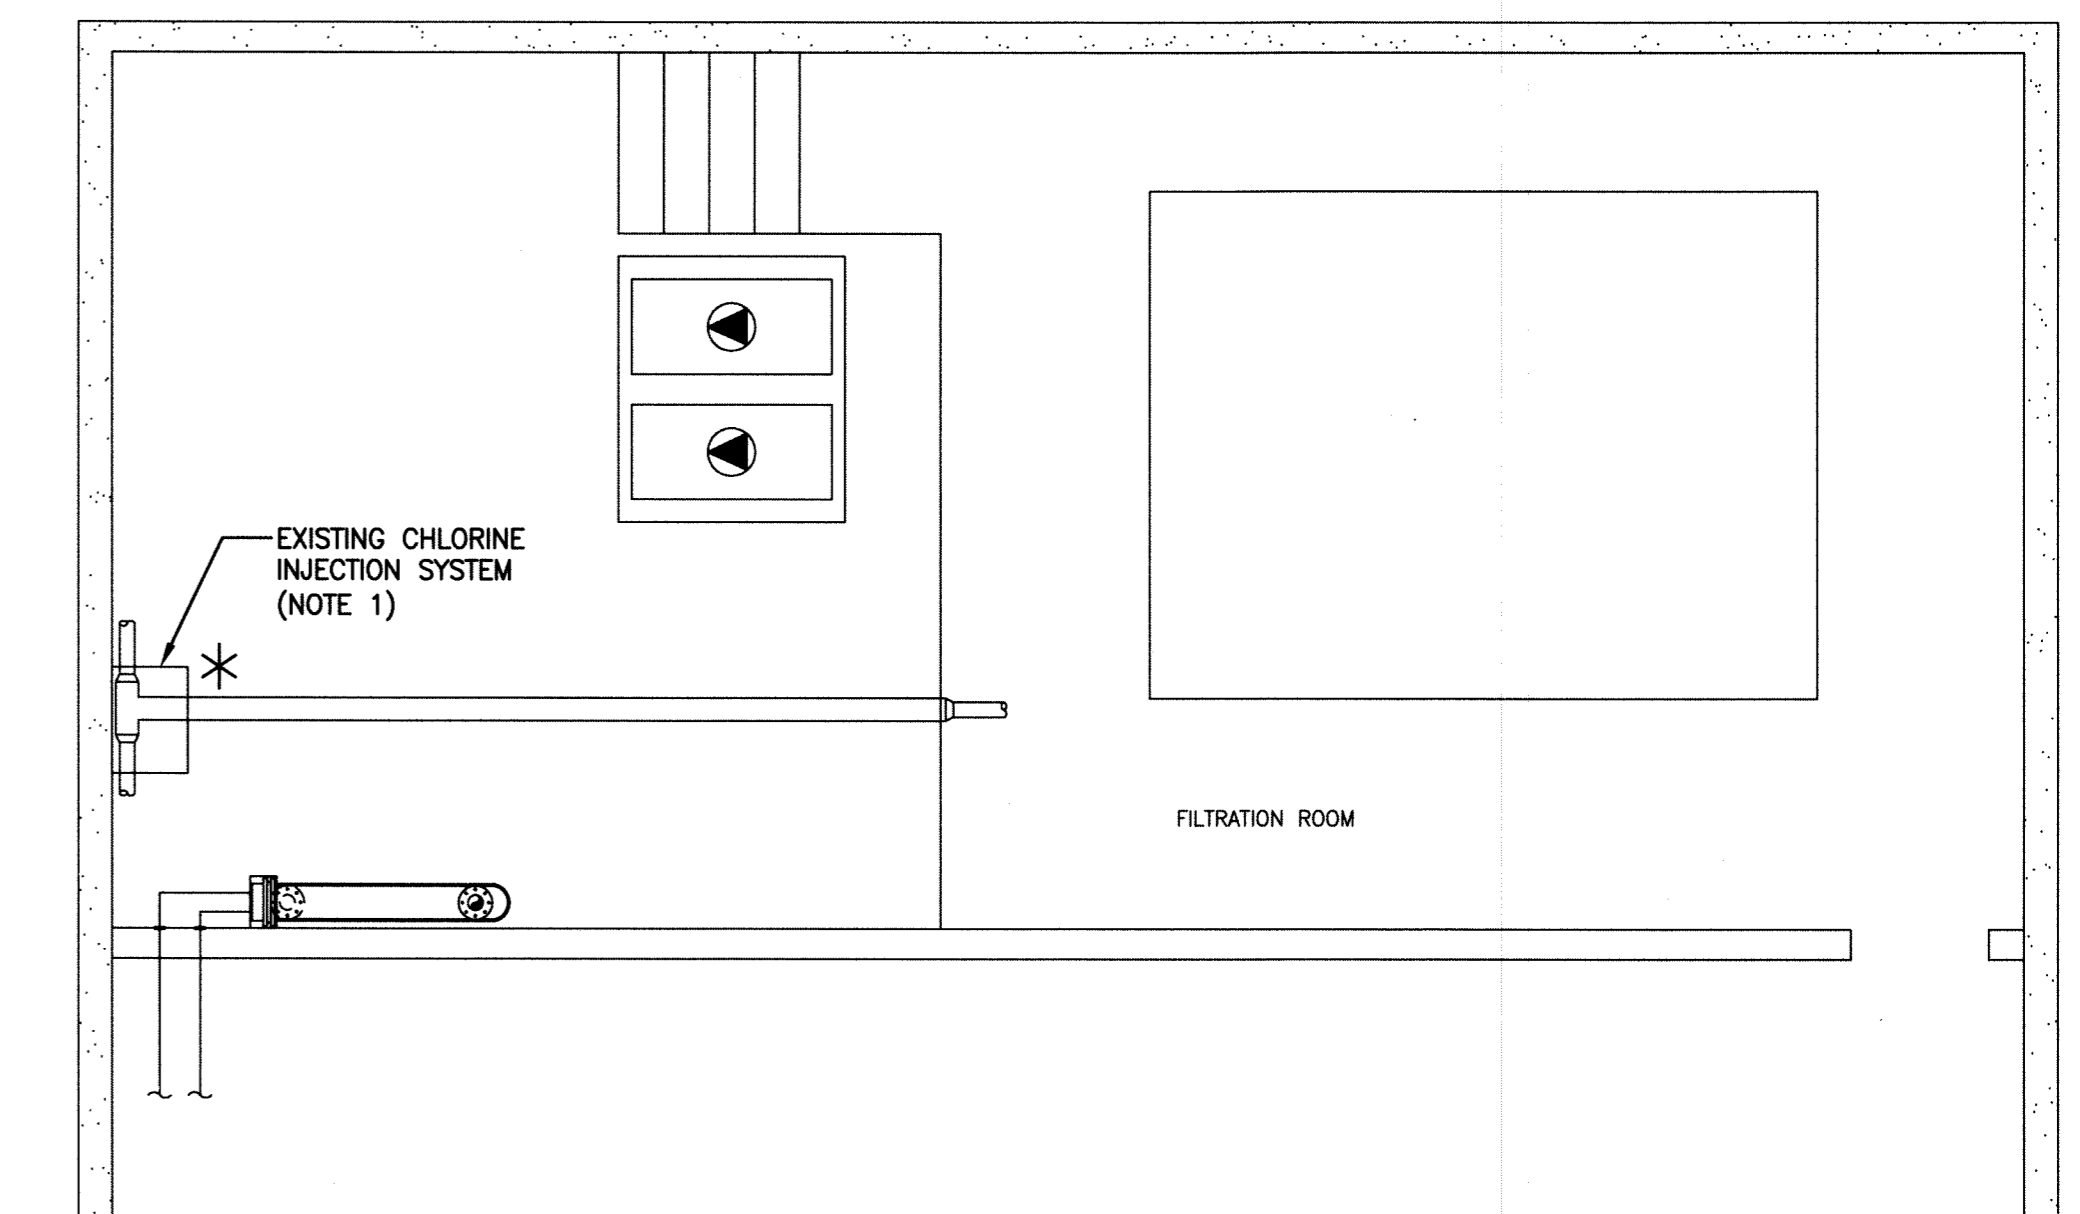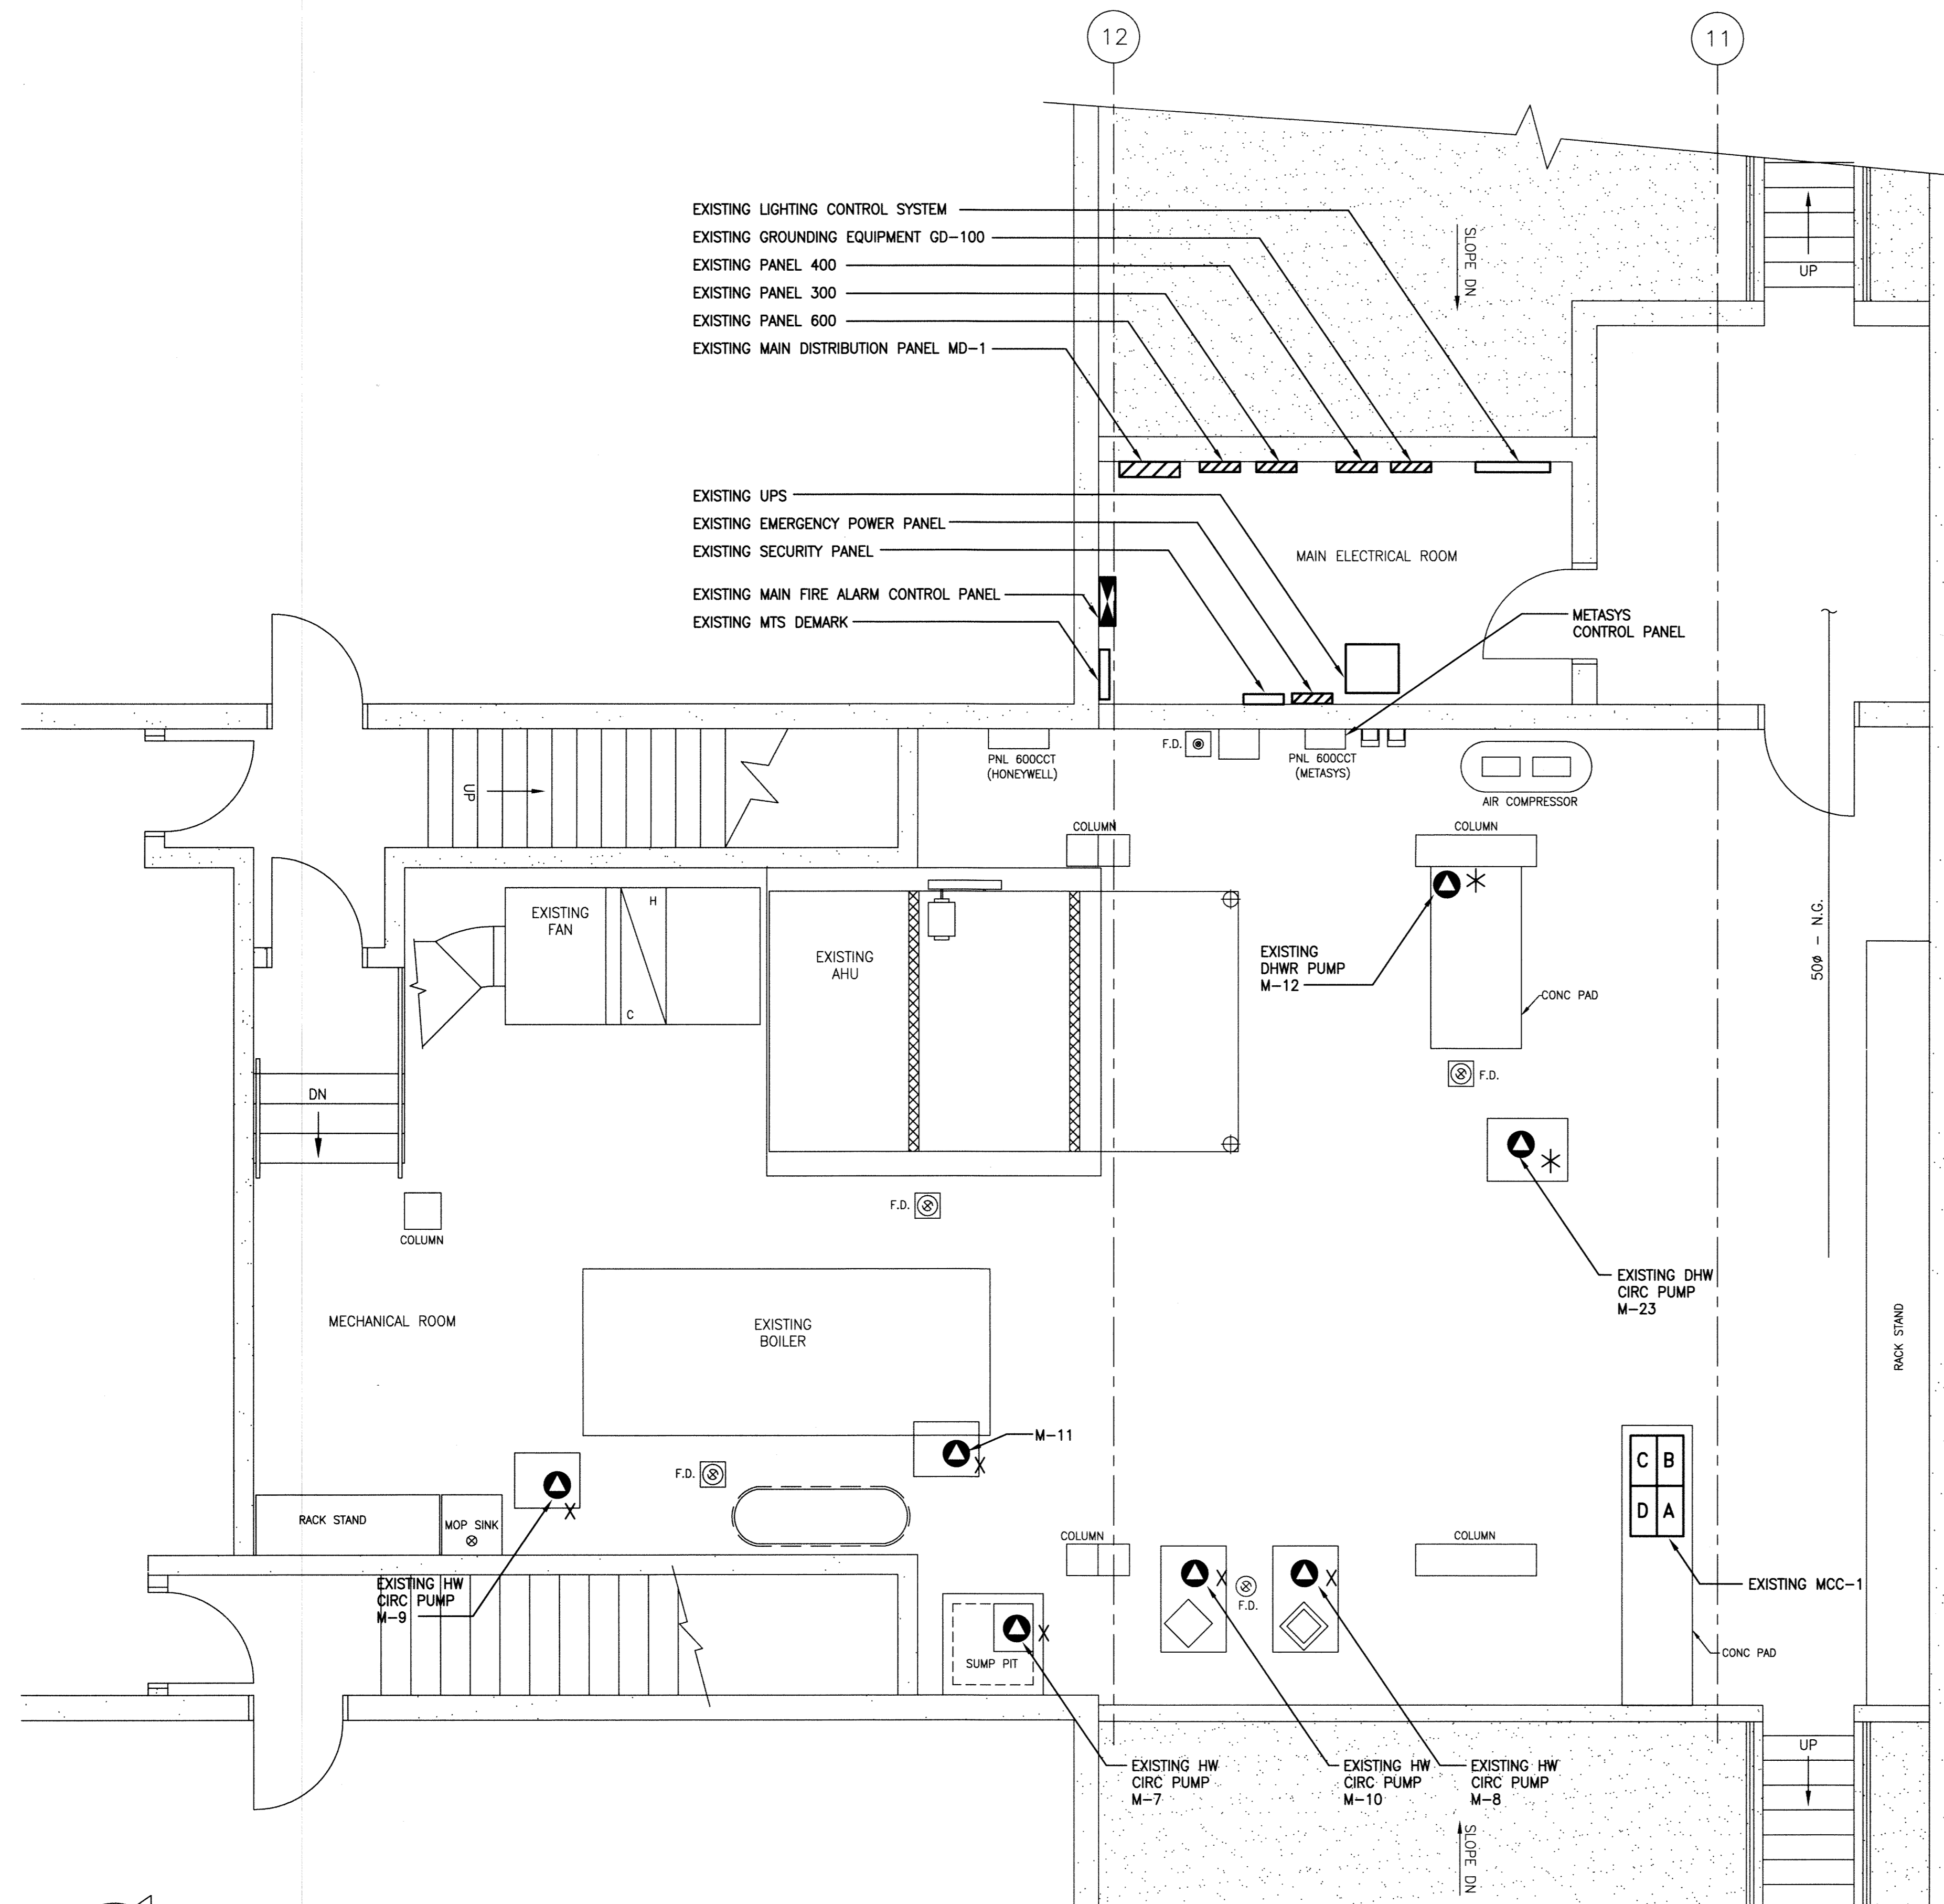

2 BASEMENT FILTRATION ROOM PLAN - DEMOLITION
 1000 0 1000 2000 3000 4000
 SCALE: 1:50mm

1 BASEMENT MECHANICAL ROOM PLAN - DEMOLITION
 800 0 800 1600 2400 3200
 SCALE: 1:40mm


File Name: P:\Projects\2011\11-0107-32\Doc\Control\Released\DWG\11-0107-32-E01-Rev 0.dwg - Tab: E01 Plotted By: D.Deroche 12/02/24 [Fri 1:11pm]

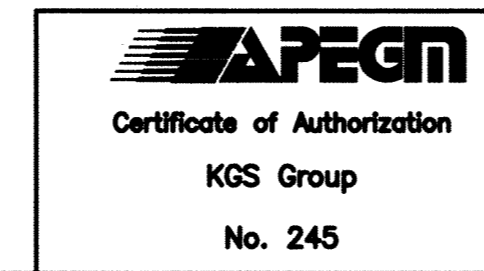

B.M. ELEV.	
DESIGNED BY	CLS
DRAWN BY	GCN
HOR. SCALE:	AS SHOWN
VERTICAL:	
ISSUED FOR TENDER	12/02/24
NO. REVISIONS	DATE BY

KGS GROUP
 CONSULTING ENGINEERS & PROJECT MANAGERS
 WINNIPEG (204) 896-1209
 THUNDER BAY (807) 345-2233

DESIGNED BY	CLS	CHECKED BY	
DRAWN BY	GCN	APPROVED BY	
HOR. SCALE:	AS SHOWN	RELEASED FOR CONSTRUCTION:	
VERTICAL:			

ENGINEER'S SEAL

 FEB. 24 2012
 CONSULTANT DRAWING NO. E01

THE CITY OF WINNIPEG
 PLANNING, PROPERTY & DEVELOPMENT

PROJECT TITLE: ST. JAMES CENTENNIAL POOL
 644 PARKDALE STREET
 BID OPPORTUNITY: 45-2012
 UPGRADE HYDRONIC HEATING SYSTEM

SHEET 001 OF 004
 COMPUTER FILE NAME: 11-0107-32-E01
 CITY DRAWING NUMBER