


T

28543 (93'-7 3/4")

V
Va

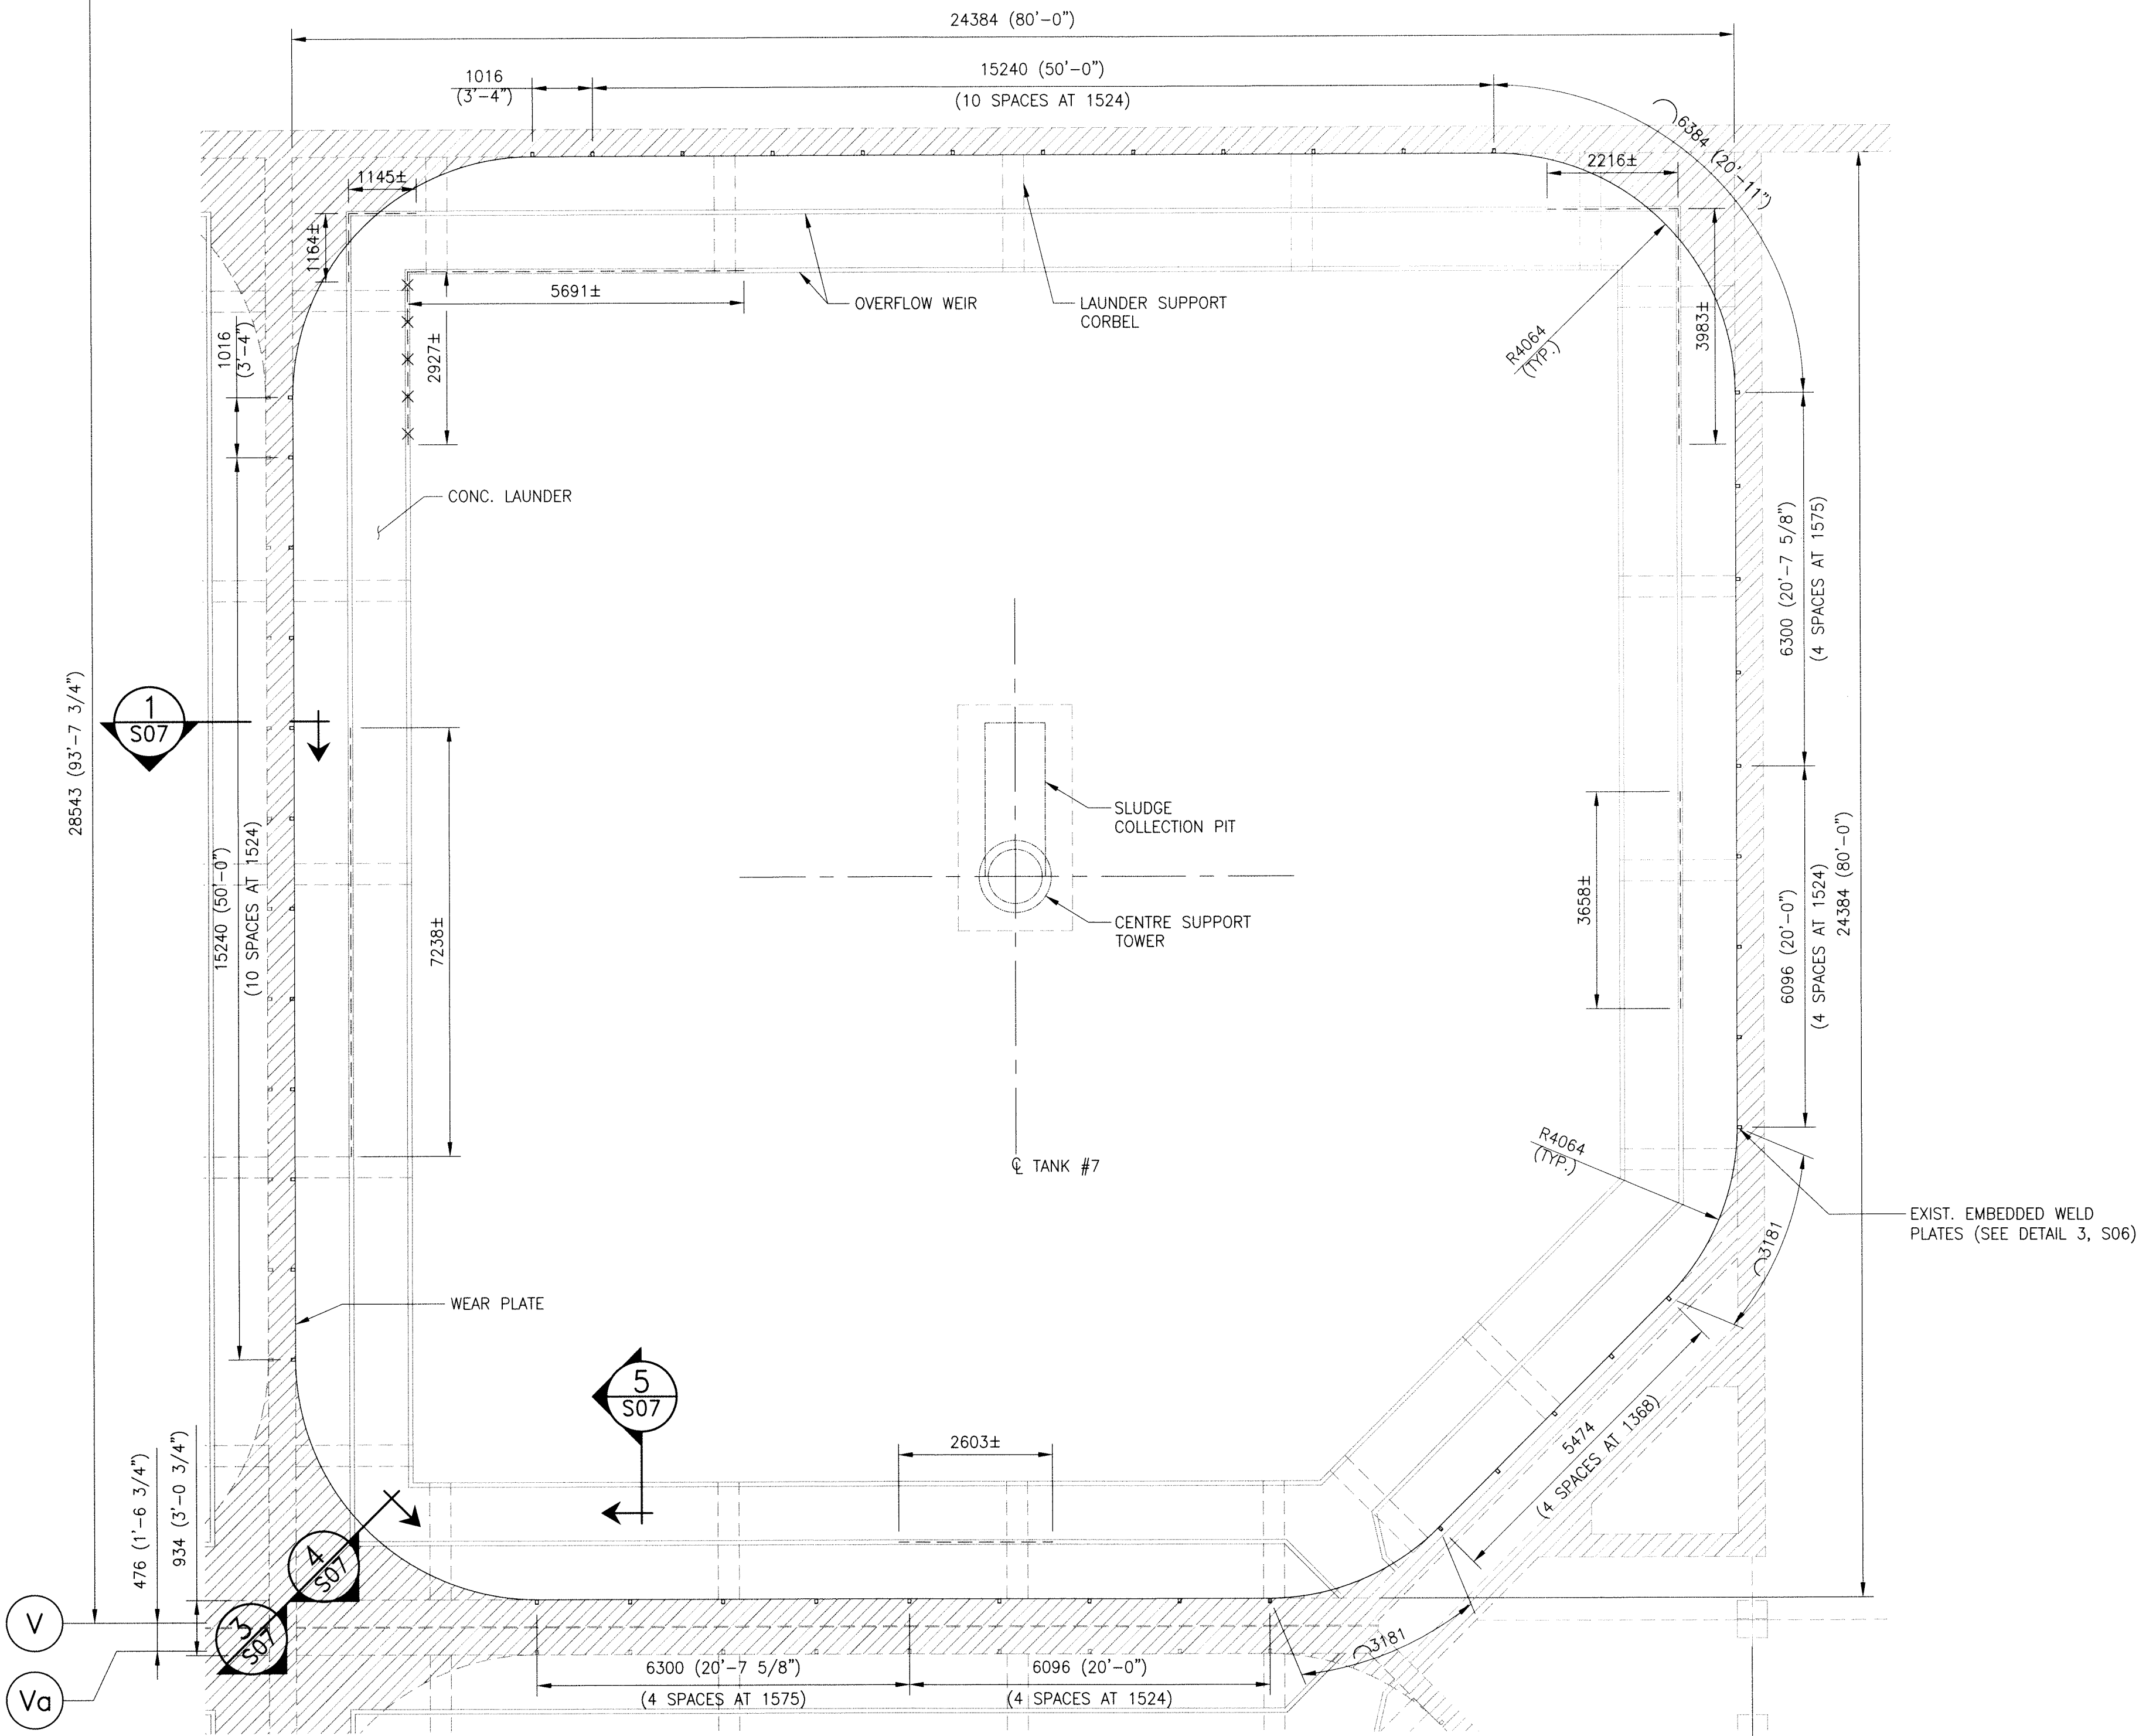


- LEGEND:**
- WEAR PLATE:**
- : REMOVE & REPLACE WEAR PLATE.
- OVERFLOW WEIR PLATE:**
- : REMOVE, CLEAN, & REFASTEN WEIR PLATE.
 - ×-×-× : REMOVE, REPLACE & REFASTEN WEIR PLATE.

SCOPE OF WORK – SECONDARY CLARIFIER #7

ITEM	REF. DETAILS
1. REPLACE WEAR PLATE (ALL).	1,2,3,4 (DWG. S07)
2. COAT NEW WEAR PLATE.	SEE NOTE 2.5 (DWG. S02)
3. REMOVE, REPLACE & REFASTEN SECTION OF OVERFLOW WEIR PLATE.	6,7 (DWG. S07)
4. REMOVE, CLEAN AND REFASTEN SECTION OF OVERFLOW WEIR PLATE.	5,6,7 (DWG. S07)
5. INSTALL NEW FASTENERS TO OVERFLOW WEIR PLATE (ENTIRE PERIMETER).	5,6,7 (DWG. S07)
6. APPLY WATERPROOFING MEMBRANE TO WEIR PLATE.	5 (DWG. S07)
7. REPLACE PIVOT SUPPORT MEMBERS & COMPLETE COATING SPOT REPAIRS TO FIXED PORTION OF SLUDGE COLLECTOR.	SEE DWG. S08, S09
8. MODIFY SCUM COLLECTOR SUPPORT STEEL.	SEE DWG. S09
9. REPLACE CORNER SWEEP ASSEMBLY.	SEE DWG. S08, S09
10. REPLACE COUNTERWEIGHT ASSEMBLY.	SEE DWG. S10
11. REPLACE SLUDGE COLLECTOR TENSION ROD.	SEE DWG. S09

- NOTES:**
1. WORK THIS DRAWING IN COMBINATION WITH THE PROJECT SPECIFICATIONS.
 2. REFER TO DWG. S02 FOR GENERAL NOTES.
 3. REPAIR LOCATIONS, DIMENSIONS AND QUANTITIES ARE APPROXIMATE AND ARE TO BE FIELD CONFIRMED BY THE CONTRACTOR AND APPROVED BY THE CONTRACT ADMINISTRATOR.

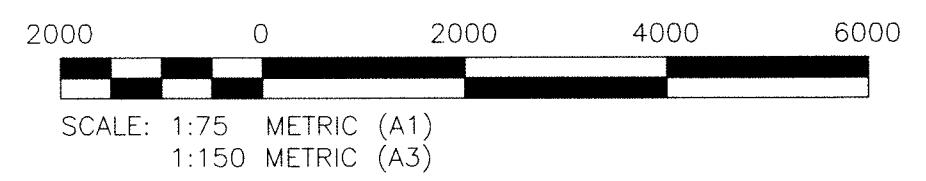


A
S01 PLAN – SECONDARY CLARIFIER 7
SCALE: 1:75



NO.	REVISIONS	DATE	BY
0	ISSUED FOR CONSTRUCTION	02/08/02	CMS

DESIGNED BY	KRD	CHECKED BY	CMS
BRAWN BY	FBV	APPROVED BY	
HDR. SCALE	AS NOTED	RELEASED FOR CONSTRUCTION	
VERTICAL	AS NOTED		
DATE	2011 07 15	DATE	

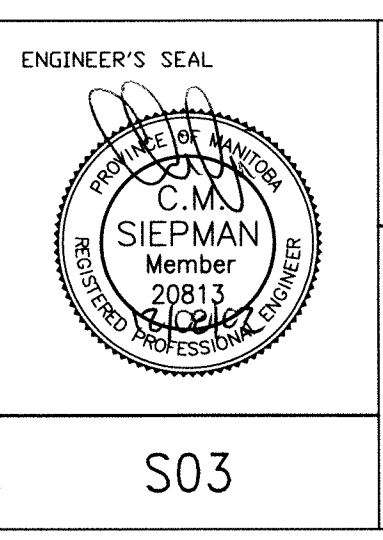

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

NEWPCC
SECONDARY CLARIFIERS 7 TO 10 REHABILITATION
SECONDARY CLARIFIER 7
PLAN

SHEET 3 OF 10
CITY DRAWING NUMBER
1-0101S-S0003-001

S03