B SIZE - 279mm x 432mm

DP-M1

MAIN CONTROL PANEL

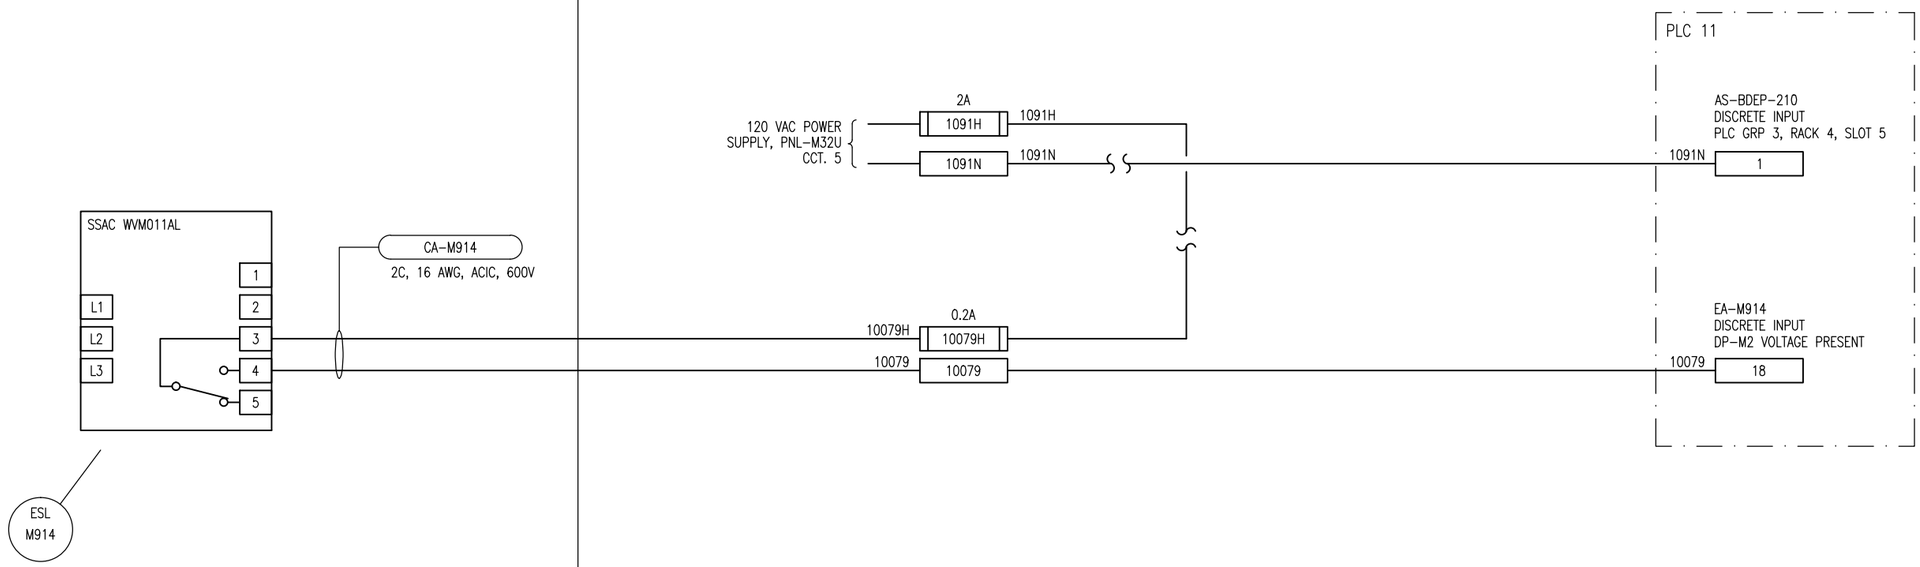

NOTES

1. DRY CONTACT IS CLOSED WHEN 600V POWER IS PRESENT.

APEGM Certificate of Authorization
SNC-Lavalin Inc.
No. 4489

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER, BID OPP. 490-2012	2012/07/23	BJC	CJR

SNC-LAVALIN INC.
148 Nature Park Way
Winnipeg, MB, Canada R3P 0X7
204-786-8080

DESIGNED BY: B. CLEVEN	CHECKED BY: C. REIMER
DRAWN BY: MJ. PERSSON	APPROVED BY: C. REIMER
SCALE: NTS	DATE: 2012/03/26
RELEASED FOR CONSTRUCTION BY:	DATE:
CONSULTANT NO.: 508955-0000-48DD-0032	

ENGINEER'S SEAL

PRELIMINARY
NOT TO BE USED FOR CONSTRUCTION

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

MACLEAN WATER PUMPING STATION

LOOP DIAGRAM
DP-M2 VOLTAGE PRESENT
LOOP M914

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0630M-A0032	001	00	B

LAST SAVE: 2012/07/27 - 8:06am
PATH: M:\508955\4ENG\48I&C\DD - General DWG\1-0630M-A0032-001-00.dwg