


LEGEND:


- EXISTING
- NEW WORK

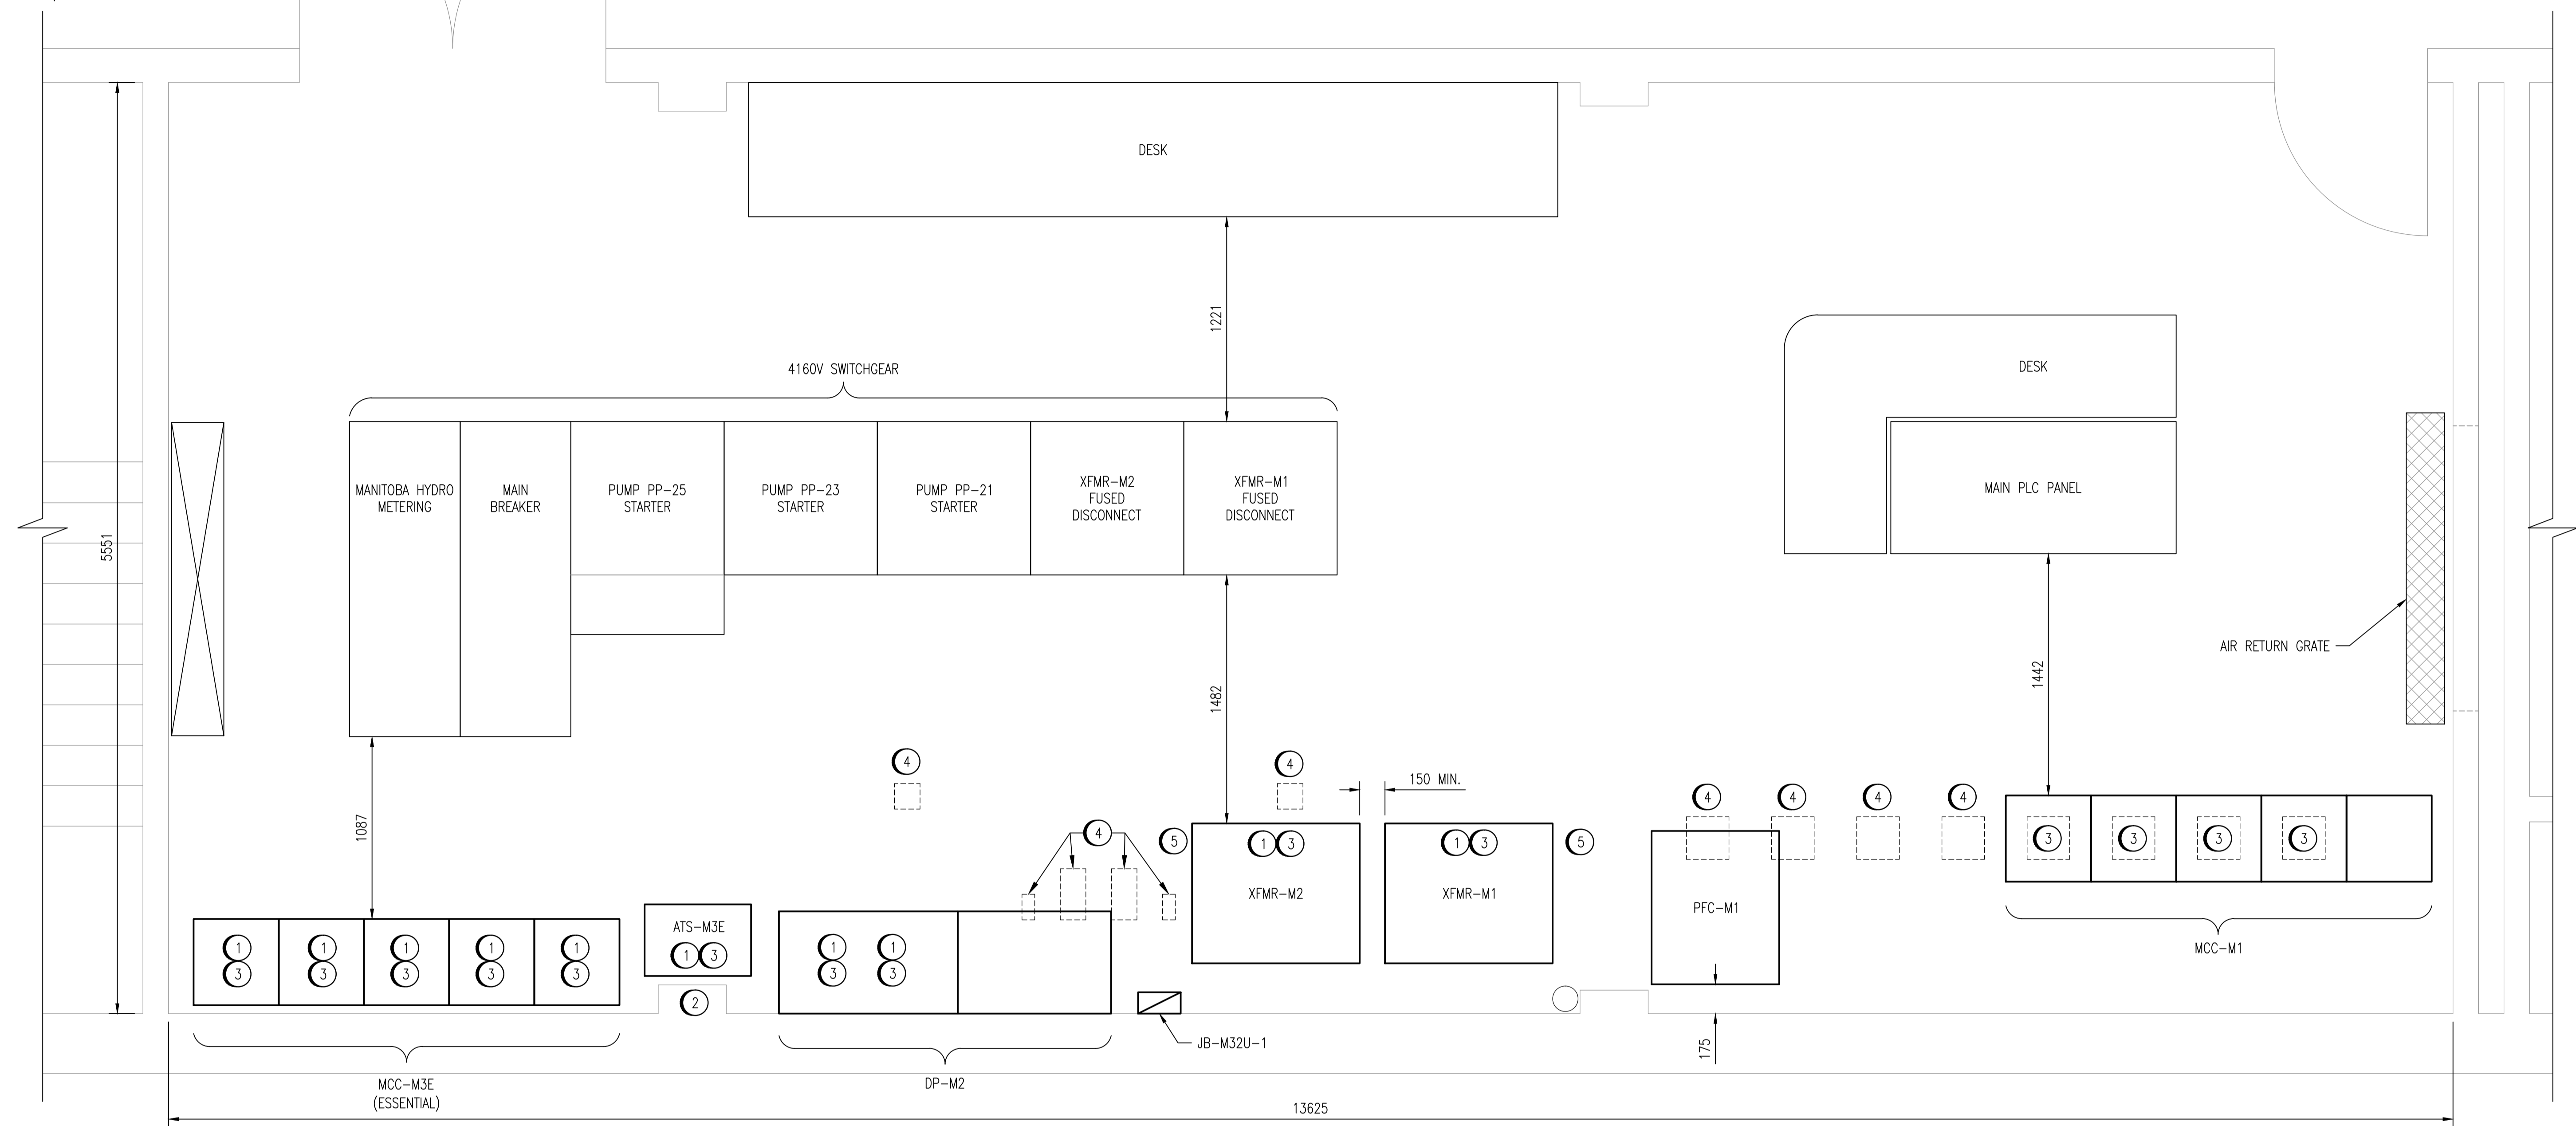

SPECIFIC NOTES:

- ① CORE NEW HOLES IN FLOOR. SIZE AND LOCATION AS REQUIRED BY CABLING AND EQUIPMENT. AVOID REINFORCING STEEL.
- ② PROVIDE UNISTRUT SUPPORTS AS REQUIRED.
- ③ INSTALL FIRESTOPPING SYSTEM THAT MEETS THE REQUIREMENTS OF ULC STANDARD CAN/ULC-S115.
- ④ FILL EXISTING FLOOR PENETRATIONS WITH CONCRETE.
- ⑤ UTILIZE SIDE ENTRY FOR 600V CABLE INTO TRANSFORMERS.

DRAWING NUMBER	REFERENCE DRAWINGS
----------------	--------------------



NO.	REVISIONS	DATE	DESIGN	CHECK
02	ISSUED FOR TENDER, BID OPP. 490-2012	2012/07/23	BJC	CJR
01	REVISED AS PER EXISTING	2011/03/18	BJC	CJR
00	ISSUED FOR TENDER	2009/08/17	BDK	CJR

SNC-LAVALIN INC.
 148 Nature Park Way
 Winnipeg, MB, Canada R3P 0X7
 204-786-8080

DESIGNED BY: B. CLEVEN
 CHECKED BY: C. REIMER
 DRAWN BY: B. KING
 APPROVED BY: C. REIMER

SCALE: 1:20
 DATE: 2009/08/17

CONSULTANT NO.: 508955-0000-47DD-0012

ENGINEER'S SEAL

PRELIMINARY
 NOT TO BE
 USED FOR
 CONSTRUCTION

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

MACLEAN WATER PUMPING STATION

ELECTRICAL EQUIPMENT PLAN
 ELECTRICAL ROOM

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0630M-E0012	001	02	A1