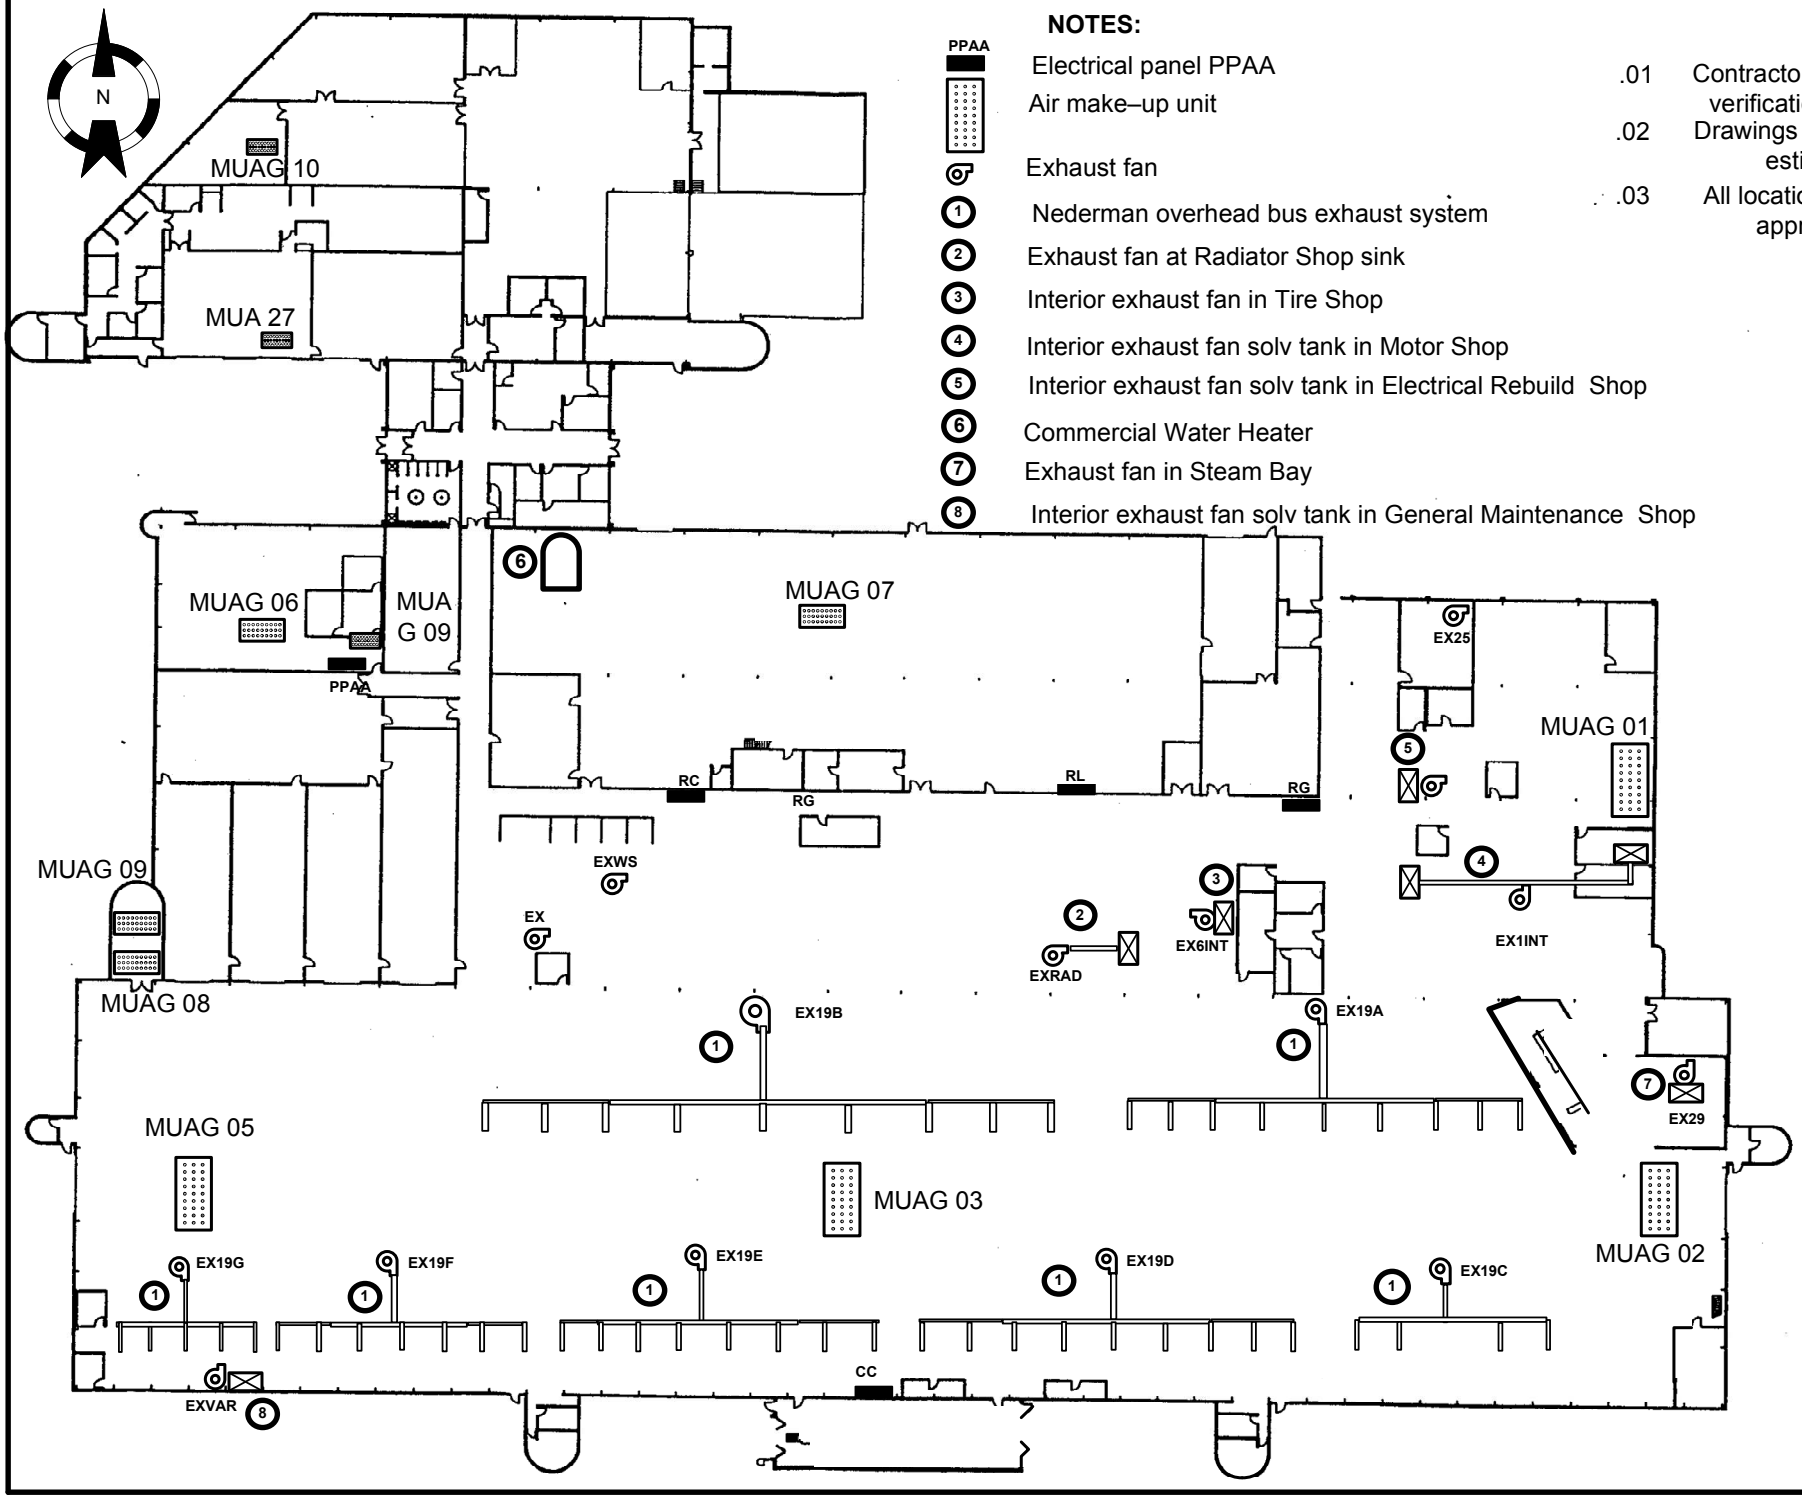

NOTES:

PPAA — Electrical panel PPAA

Air make–up unit

Exhaust fan

1. Nederman overhead bus exhaust system
2. Exhaust fan at Radiator Shop sink
3. Interior exhaust fan in Tire Shop
4. Interior exhaust fan solv tank in Motor Shop
5. Interior exhaust fan solv tank in Electrical Rebuild Shop
6. Commercial Water Heater
7. Exhaust fan in Steam Bay
8. Interior exhaust fan solv tank in General Maintenance Shop

NOTES:

.01 Contractor is responsible for site verifications of all dimensions

.02 Drawings are not to be scaled for estimating purposes

.03 All locations given are approximate

WINNIPEG TRANSIT DEPARTMENT
421 Osborne Street
Winnipeg MB R3L 2A2
Tel: 986-3821 / 479-5430
avecherya@winnipeg.ca

PROJECT
INSPECTION AND REPAIR OF HVAC EQUIPMENT AT WINNIPEG TRANSIT DEPARTMENT

SHEET TITLE
LOCATION OF MUA UNITS AND EXHAUST FANS AT FORT ROUGE GARAGE ON TRACK G

DRAWN BY	CHECKED BY	APPR. BY
AV	AV	

eFILE	PROJECT No
742-2012 DRAWING A-1-RO	742-2012

DATE	SCALE
2012. 09.26	NTS

SHEET No **A-1**