



- NOTES:
- THIS DETAIL APPLIES TO ALL INTERNAL AND EXTERNAL SHIELDED CONTROL CABLE WIRING WITHIN A CONTROL PANEL.
 - USE THIS ARRANGEMENT FOR CONNECTING SHIELD TO A TERMINAL STRIP FOR:
 - CONTINUING TO GROUND AT THIS POINT (NOTE - ONLY ONE POINT ALONG SIGNAL CABLE MAY BE CONNECTED TO GROUND) OR,
 - CONTINUING TO ANOTHER SHIELDED CONTROL CABLE WITHOUT CONNECTING TO GROUND AT THIS POINT.

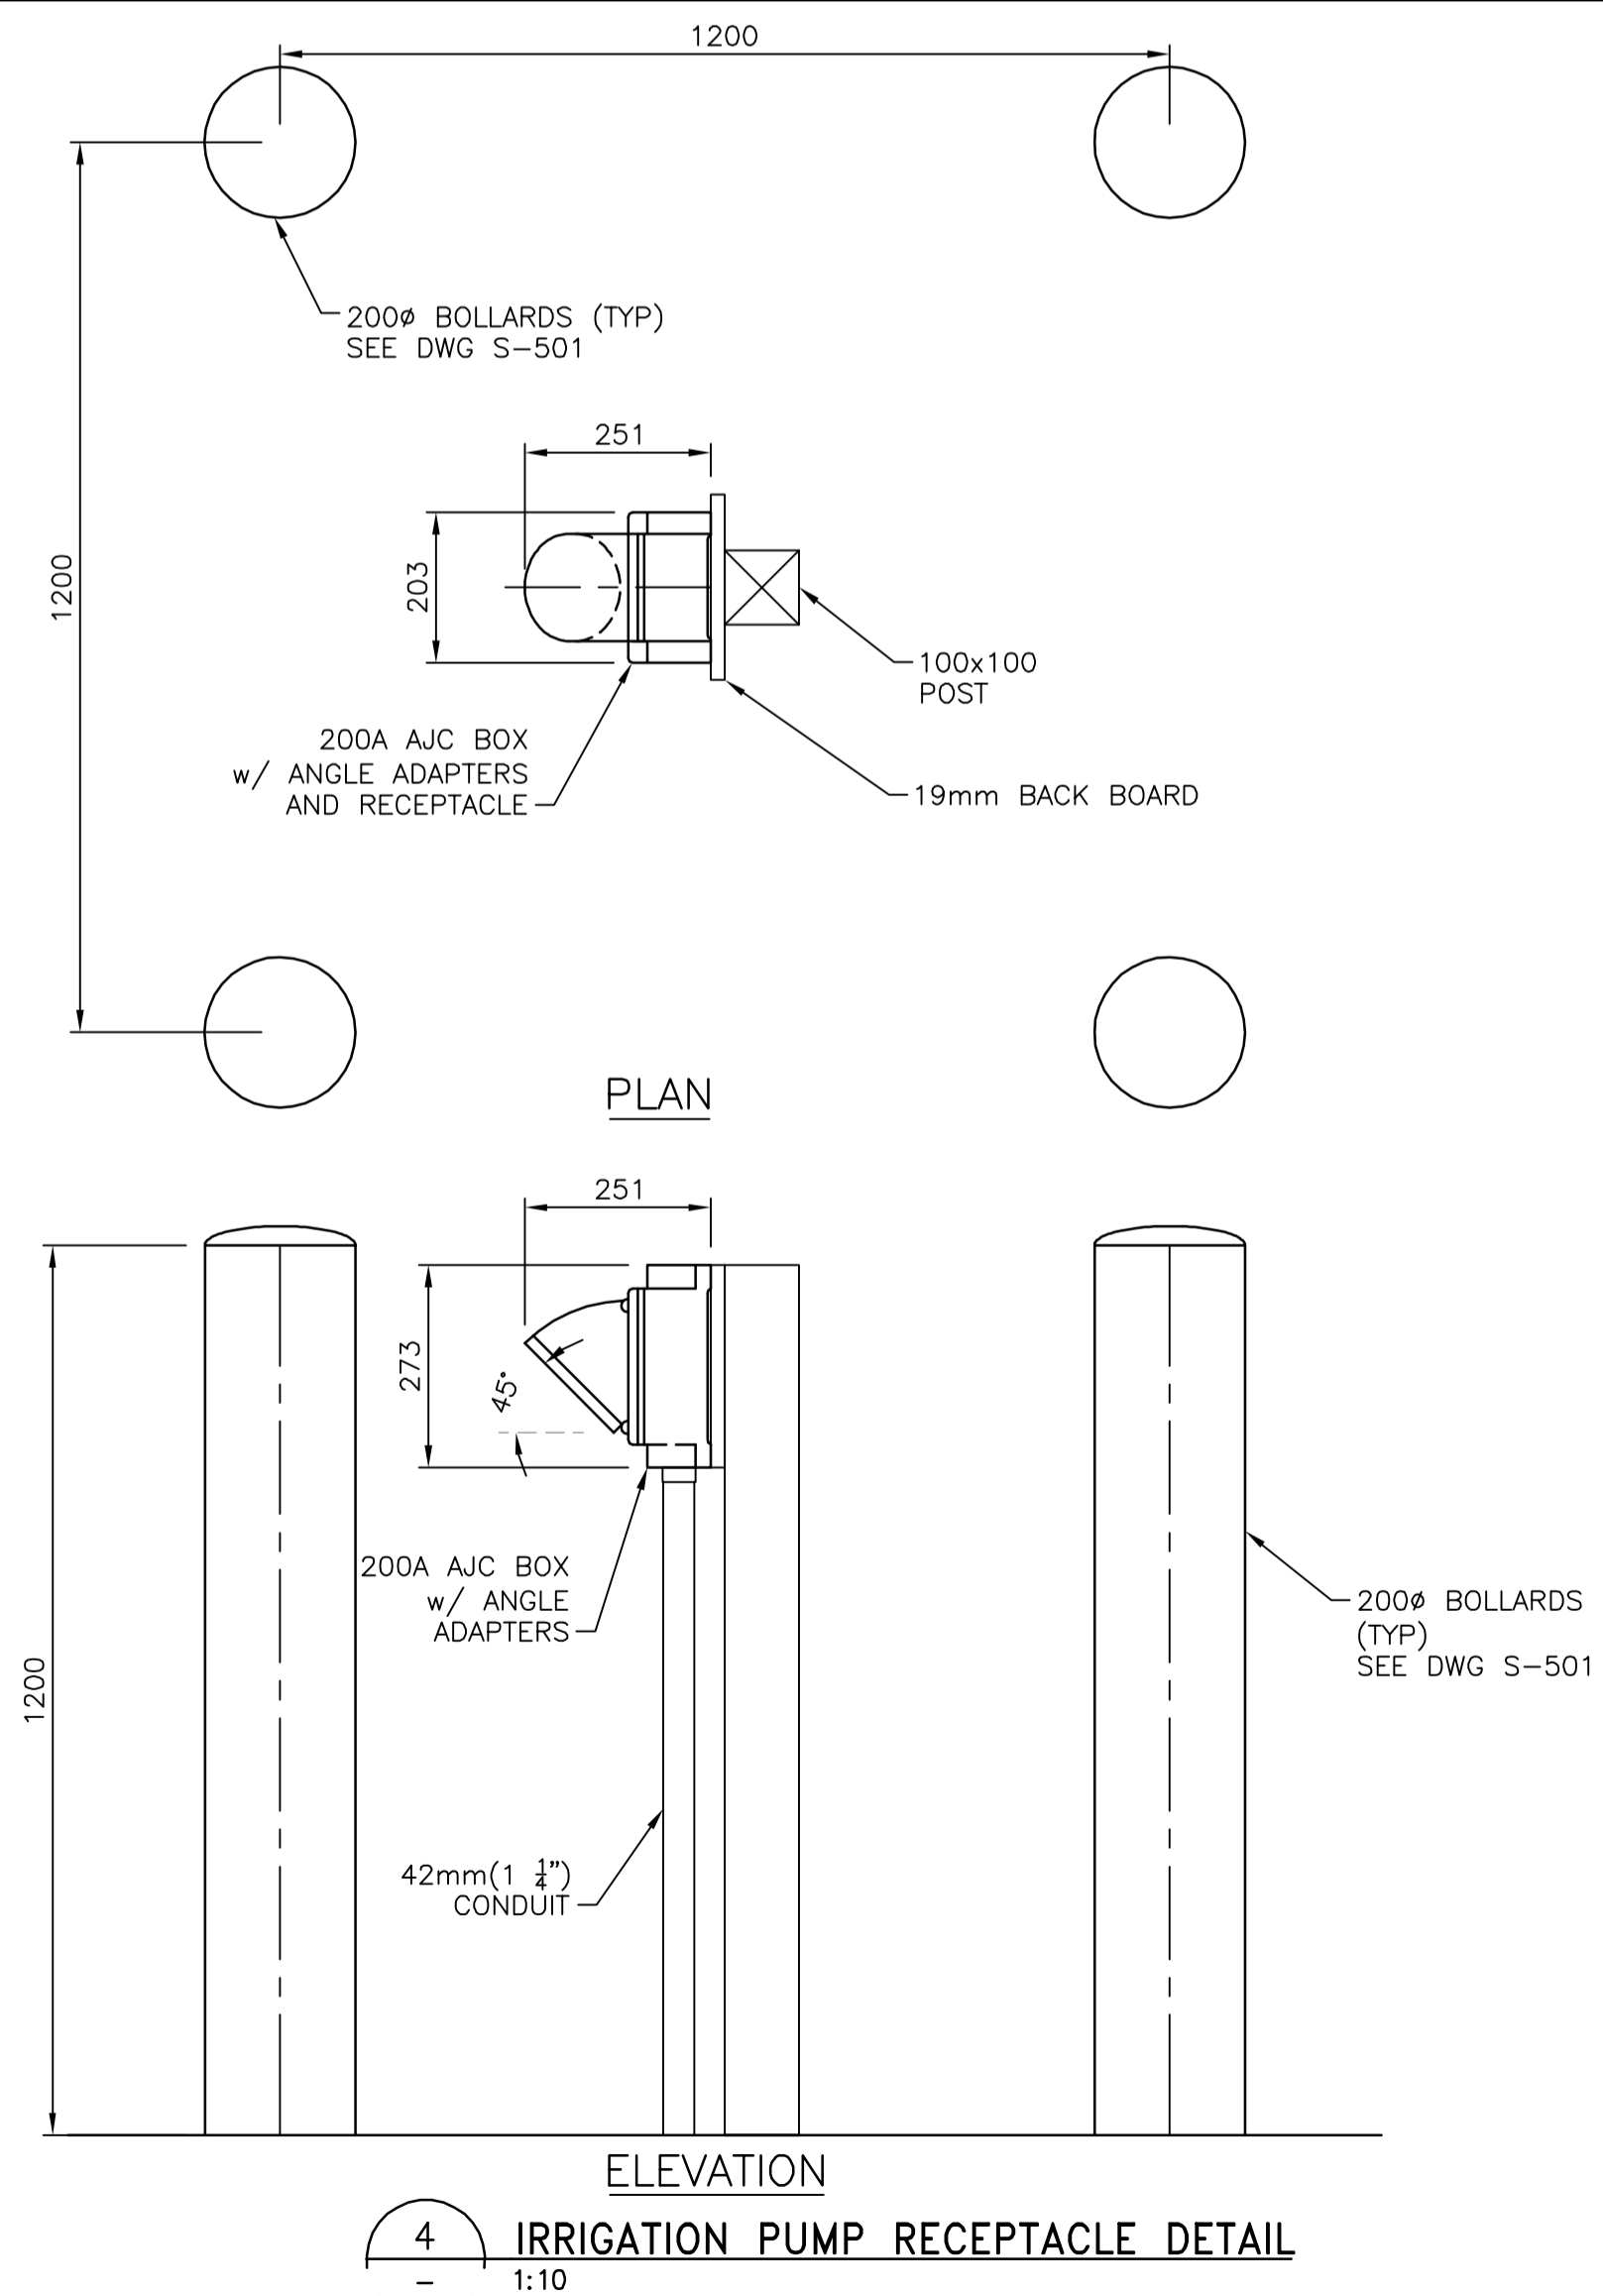

APEGM
Certificate of Authorization
CH2M HILL Canada Ltd.
No. 1441 Date: January 25, 2013

B.M. ELEV.			
CONSTRUCTION COMPLETION DATE: YYYY MM DD			
DESIGNED BY	LL	CHECKED BY	WT
DRAWN BY	EA	APPROVED BY	BW
SCALE:	HORIZONTAL AS NOTED		RELEASED FOR CONSTRUCTION
NO.	ISSUED FOR CONSTRUCTION	DATE	BY
0	ISSUED FOR CONSTRUCTION	13/01/25	JBC
NO.	REVISIONS	DATE	BY
		DATE	2013 01 25
PLOT DATE: 2013 02 04			

CH2MHILL

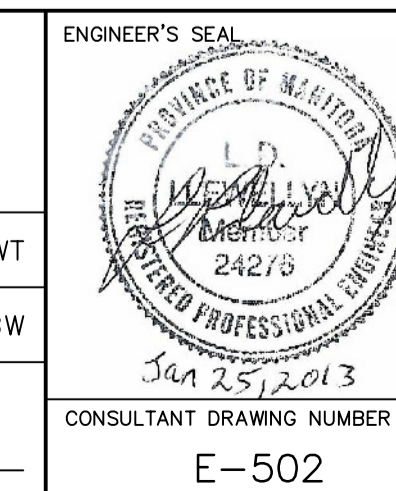

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT
ENGINEERING DIVISION

BRADY ROAD RESOURCE MANAGEMENT FACILITY
LEAF AND YARD WASTE AND
PILOT BIOSOLIDS COMPOSTING

ELECTRICAL DETAILS
SHEET 2 OF 2

SHEET 45 OF 45
CITY DRAWING NUMBER
1-0400B-E0007-002-00