
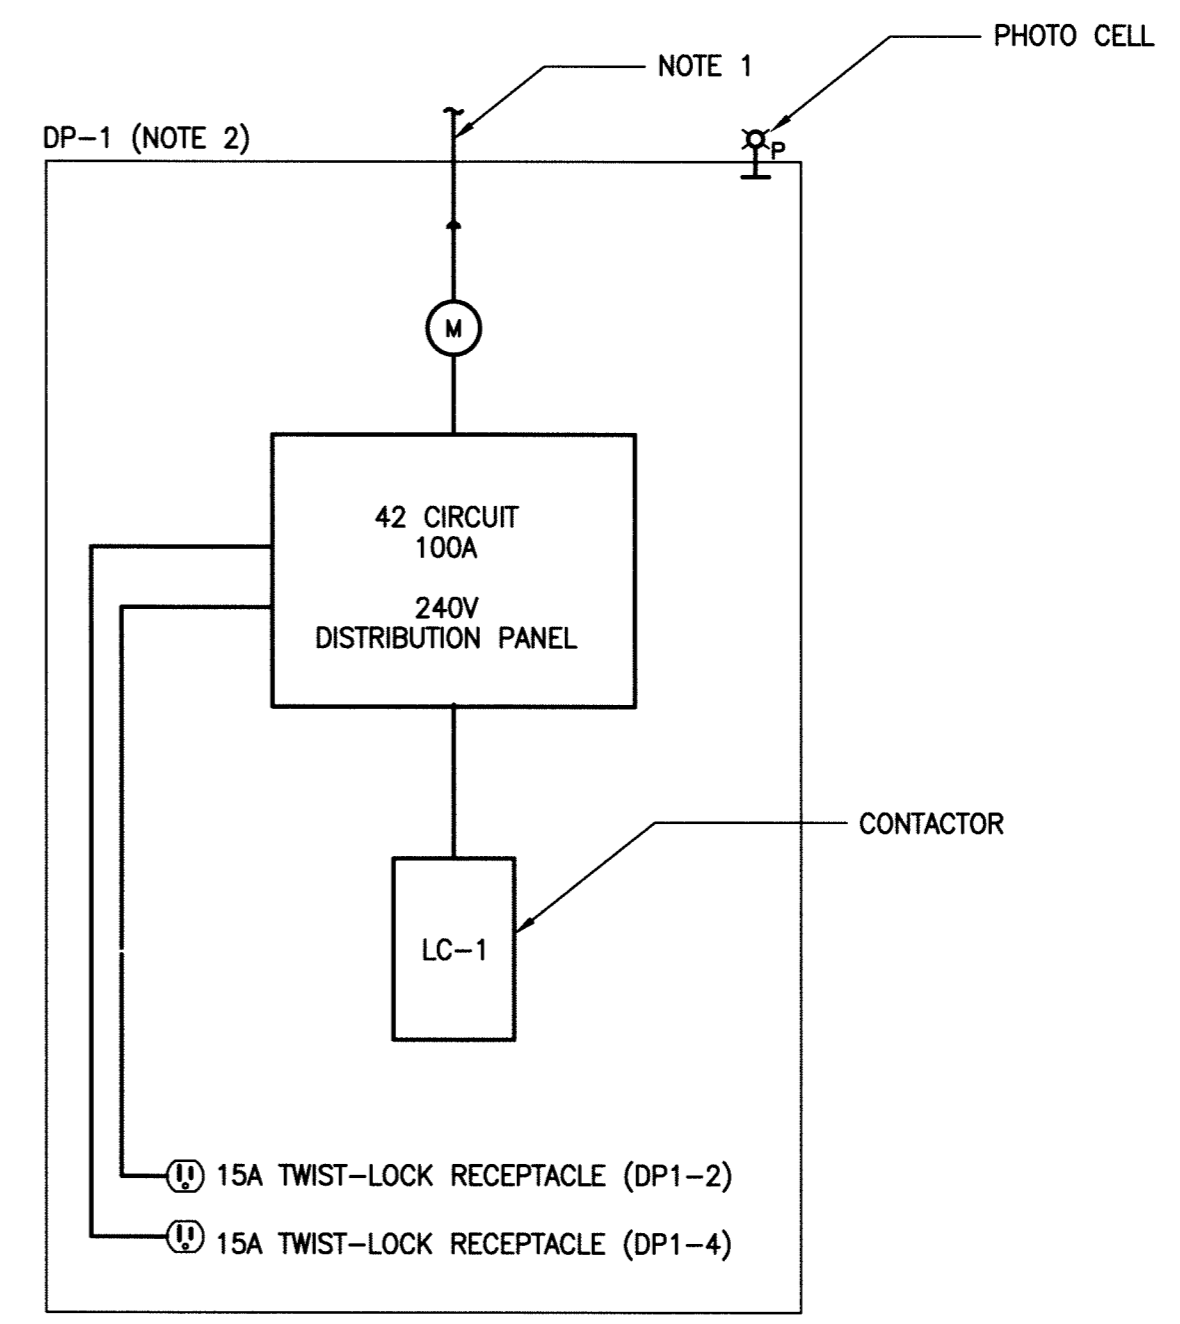


- NOTES:**
- ARRANGE FOR HYDRO SERVICE ENTRANCE CONNECTION.
 - PROVIDE ALL EQUIPMENT COMPLETE IN A PADLOCKABLE, PEDESTAL-MOUNT CSA APPROVED ENCLOSURE. PROVIDE A SEPARATE COVER OVER CONTROLS AND RECEPTACLES.
 - SUPPLY AND INSTALL NEW 1 1/2" PVC CONDUIT IN RAMP SLAB. PROVIDE STAINLESS THREADED CONNECTION AND CAP AT END.

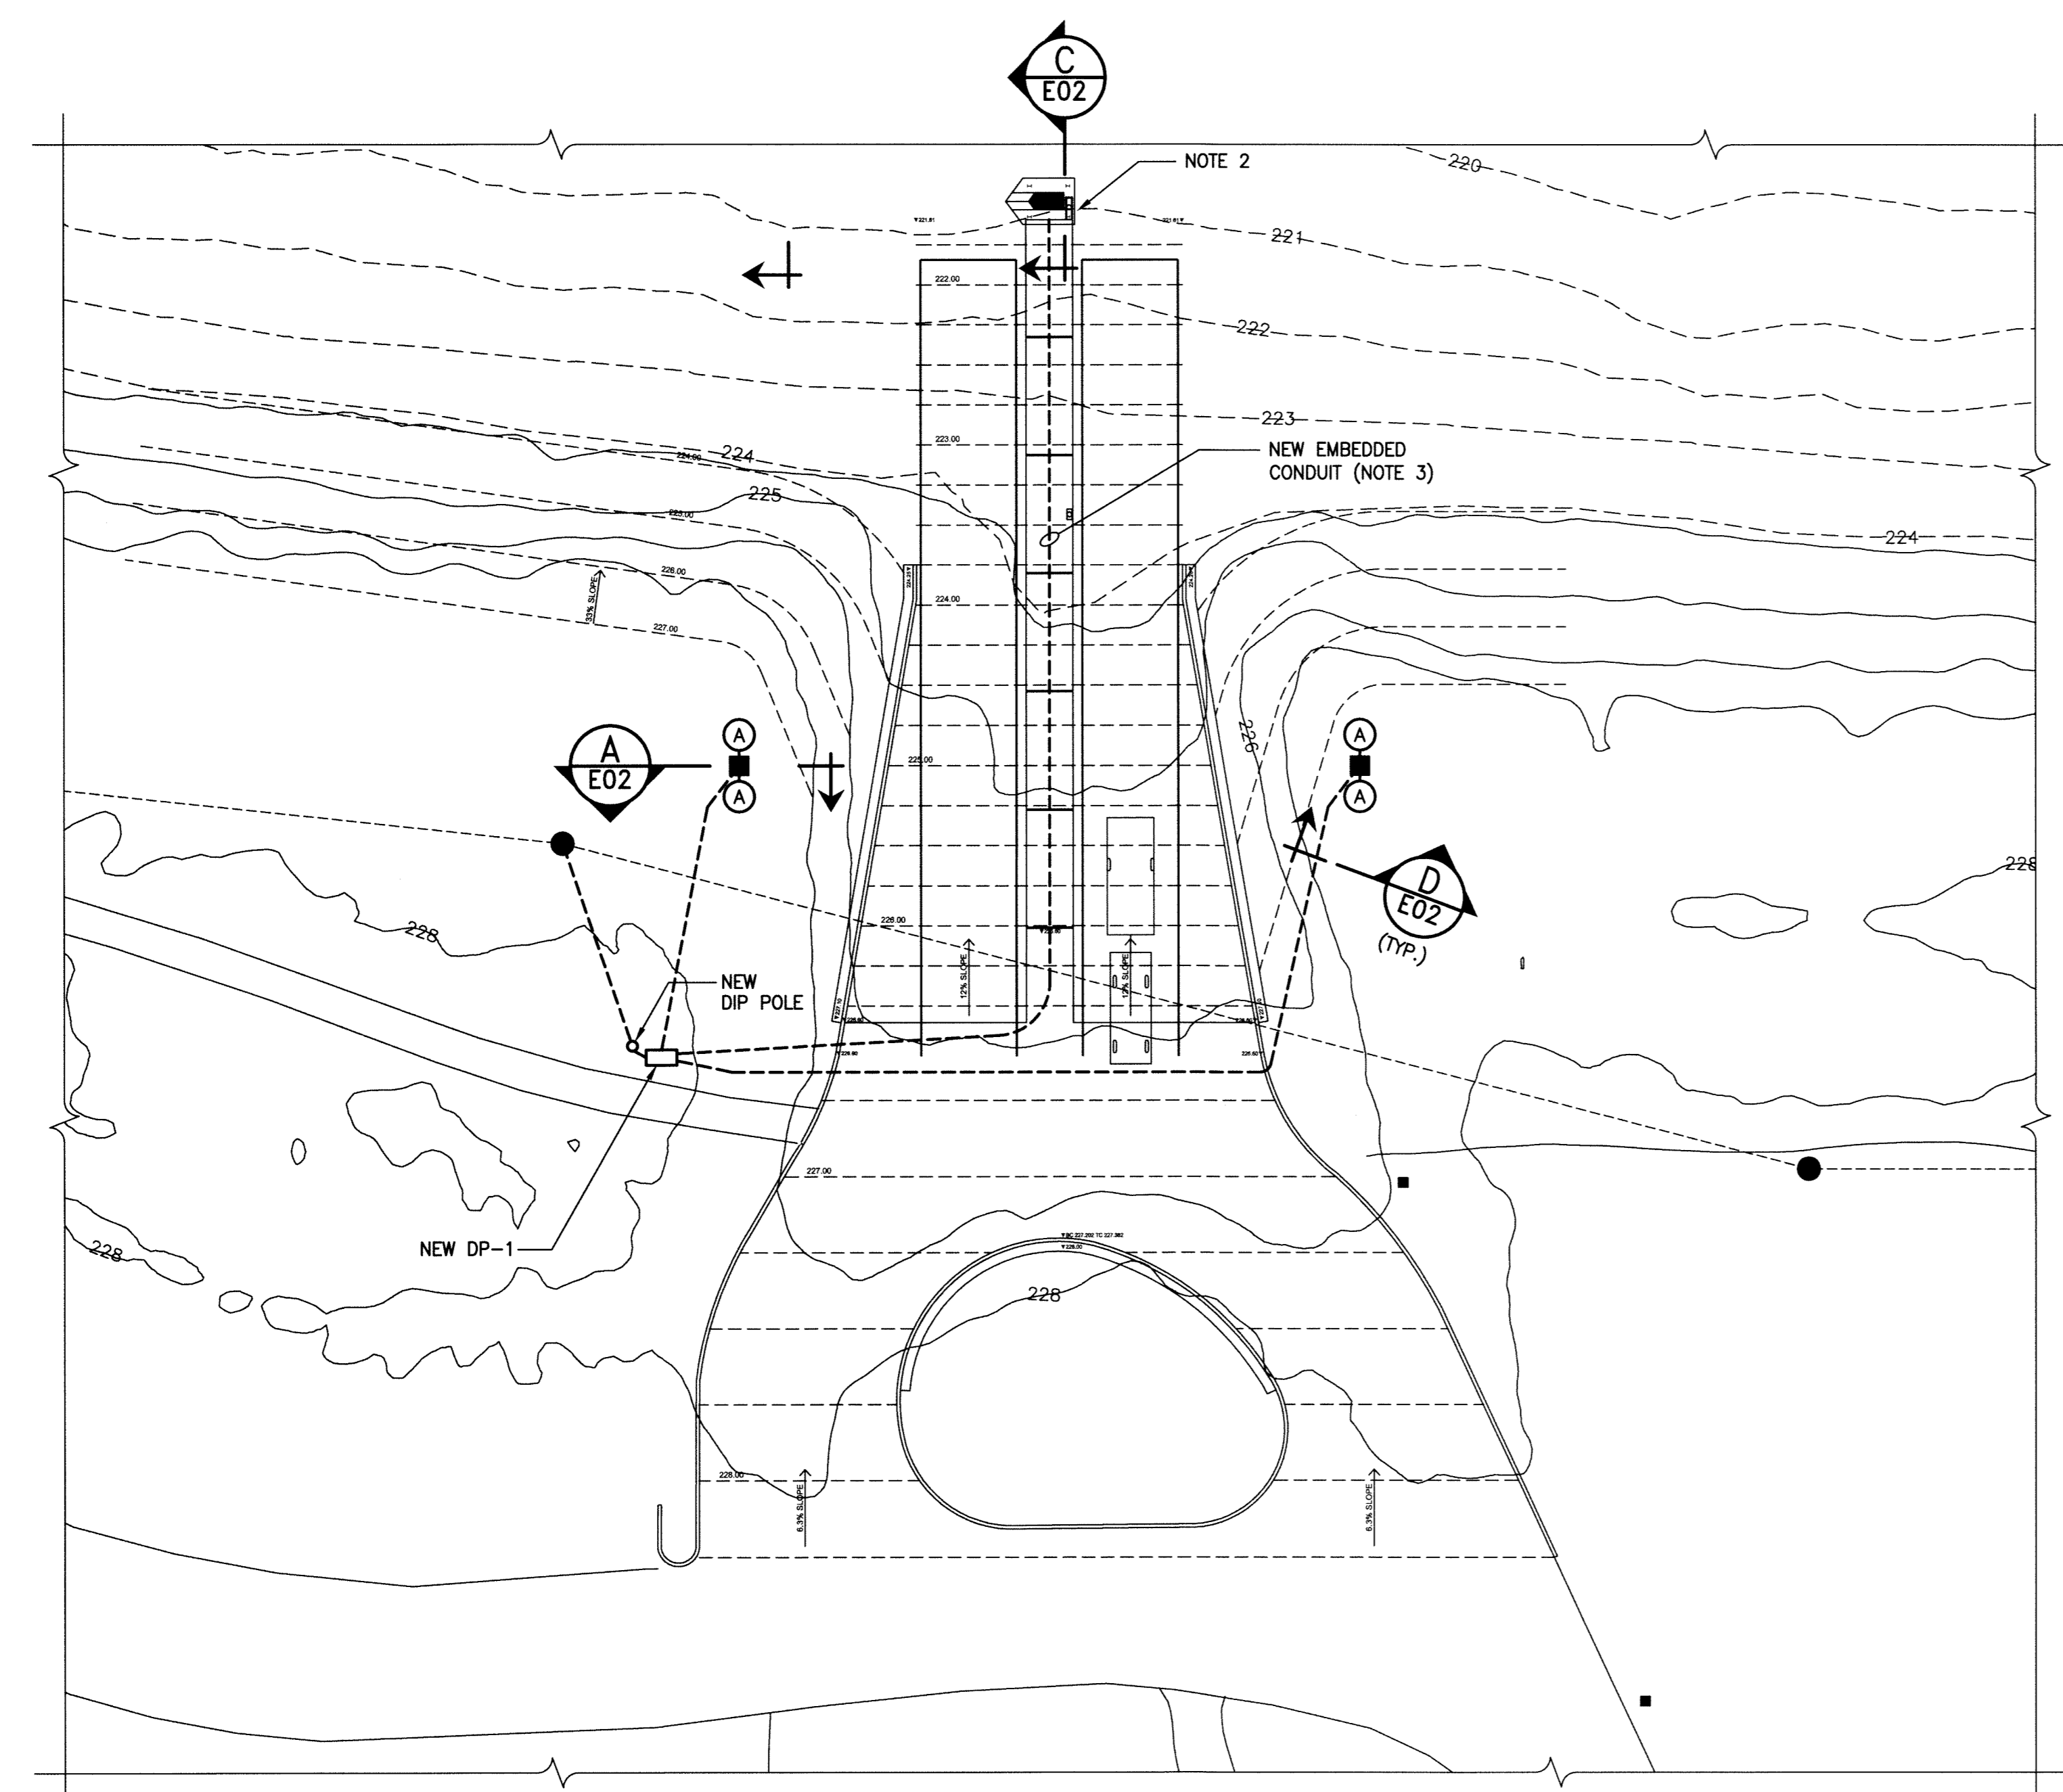

SUPPLY: 240V 1Ø 3W MAINS AMPACITY: 100 INCOMING: <input checked="" type="checkbox"/> BREAKER <input type="checkbox"/> LUGS MAIN BREAKER REQUIRED: <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO MAIN BREAKER AMPS: 100 BUS MATERIAL: <input checked="" type="checkbox"/> COPPER <input type="checkbox"/> ALUMINUM BUS AND BREAKER RATING: 15kA		NAME PLATE: PANEL ' DP-1 '	LOCATION: MOUNTING: <input checked="" type="checkbox"/> SURFACE <input type="checkbox"/> FLUSH MANUFACTURER: MODEL NO: BREAKER: <input type="checkbox"/> PLUG-IN <input checked="" type="checkbox"/> BOLT-ON TVSS: <input type="checkbox"/> YES <input checked="" type="checkbox"/> NO SERVICE ENTRANCE RATED: <input checked="" type="checkbox"/> YES <input type="checkbox"/> NO						
REV/CCT	VA	P	BKR	A	B	BKR	P	VA	CCT/REV
0 1	900	1	15	•	•	15	1	—	RECEPTACLE
0 3	900	1	15	•	•	15	1	—	RECEPTACLE
0 5	500	1	15	•	•	15	1	—	SPARE
0 7	200	1	15	•	•	15	1	—	SPARE
0 9	1100	1	15	•	•	15	1	—	CONTROLS
0 11	1100	1	15	•	•	15	1	—	—
0 13	1100	1	15	•	•	15	1	—	—
0 15	1100	1	15	•	•	15	1	—	—
0 17	—	—	—	•	•	—	—	—	18 0
0 19	—	—	—	•	•	—	—	—	20 0
0 21	—	—	—	•	•	—	—	—	22 0
0 23	—	—	—	•	•	—	—	—	24 0
0 25	—	—	—	•	•	—	—	—	26 0
0 27	—	—	—	•	•	—	—	—	28 0
0 29	—	—	—	•	•	—	—	—	30 0
0 31	—	—	—	•	•	—	—	—	32 0
0 33	—	—	—	•	•	—	—	—	34 0
0 35	—	—	—	•	•	—	—	—	36 0
0 37	—	—	—	•	•	—	—	—	38 0
0 39	—	—	—	•	•	—	—	—	40 0
0 41	—	—	—	•	•	—	—	—	42 0

TYPE	DESCRIPTION	VOLTAGE	LAMPS	APPROVED MANUFACTURERS
A	FIXTURES: (2 PER POLE) - ARCHITECTURAL ALUMINUM FLOOD LIGHT. PULSE-START 400 WATT METAL HALIDE. WIDE-FLOOD, BLACK, c/w ALL REQUIRED ACCESSORIES.	120V	2x 400W PULSE-START METAL HALIDE	LITHONIA: KFL3 400W HPW - 120-SCWA-THK-CSA-DBL-PI
	POLE: - 30' HEAVY DUTY ROUND STRAIGHT POLE c/w TWO SIDE ARMS MOUNTING FLOOD LIGHTS. GALVANIZED AND POWDER COATED BLACK c/w ALL ACCESSORIES.			VALMONT: 6RH-30-07-0.2
B	LED 3' WATERTIGHT LINEAR FLUORESCENT c/w ALL MOUNTING ACCESSORIES. BLACK	120V	LED	LUMENPULSE: LOGP-HD-120-36-30K 10x60-UMP-BK-NO-CCC
C	LED 2' WATERTIGHT LINEAR FLUORESCENT c/w ALL MOUNTING ACCESSORIES. BLACK	120V	LED	LUMENPULSE: LOGP-HD-120-24-30K 10x60-UMP-BK-NO-CCC
D	LED OBSTRUCTION LIGHT. CONSTANT BURN RED, 100,000 HOUR LIFE. SURFACE MOUNT.	120V	LED	FEDERAL SIGNALS: LP3TL-120R

P:\Projects\2012\12-0109-009\Doc\Central\08\Basis\DWG\12-0109-009_E01-Rev 1.dwg - Tab: E01-NL Plotted By: Dberche 01/07/2013 (Mem 8:56am)

LOCATION APPROVED UNDERGROUND STRUCTURES

SUPV. U/G STRUCTURES DATE COMMITTEE

NOTE:
 LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

DESIGNED BY: AP	CHECKED BY: LL	SCALE: AS NOTED	RELEASED FOR CONSTRUCTION: DATE
DRAWN BY: BGO	APPROVED BY: AP		
1 ISSUED FOR TENDER 13/01/04 AP			
D ISSUED FOR TENDER 12/12/20 AP			
NO. REVISIONS	DATE	BY	DATE
			12/12/04

METRIC WHOLE NUMBERS INDICATE MILLIMETRES DECIMALIZED NUMBERS INDICATE METRES		Certificate of Authorization KGS Group No. 245	
PROJECT TITLE ST. VITAL PARK BOAT LAUNCH PLAN, DETAILS AND SCHEDULES		SHEET OF COMPUTER FILE NAME 12-0109-009_E01 CITY DRAWING NUMBER	
CONSULTANT DRAWING NO. 12-0109-009_E01			