




CITY OF WINNIPEG TRANSIT DEPARTMENT

BID OPPORTUNITY No. 529-2013 ELECTRICAL SECTION RENOVATION AT THE WINNIPEG TRANSIT GARAGE, 421 OSBORNE STREET

ISSUED FOR CONSTRUCTION
JUNE 27, 2013

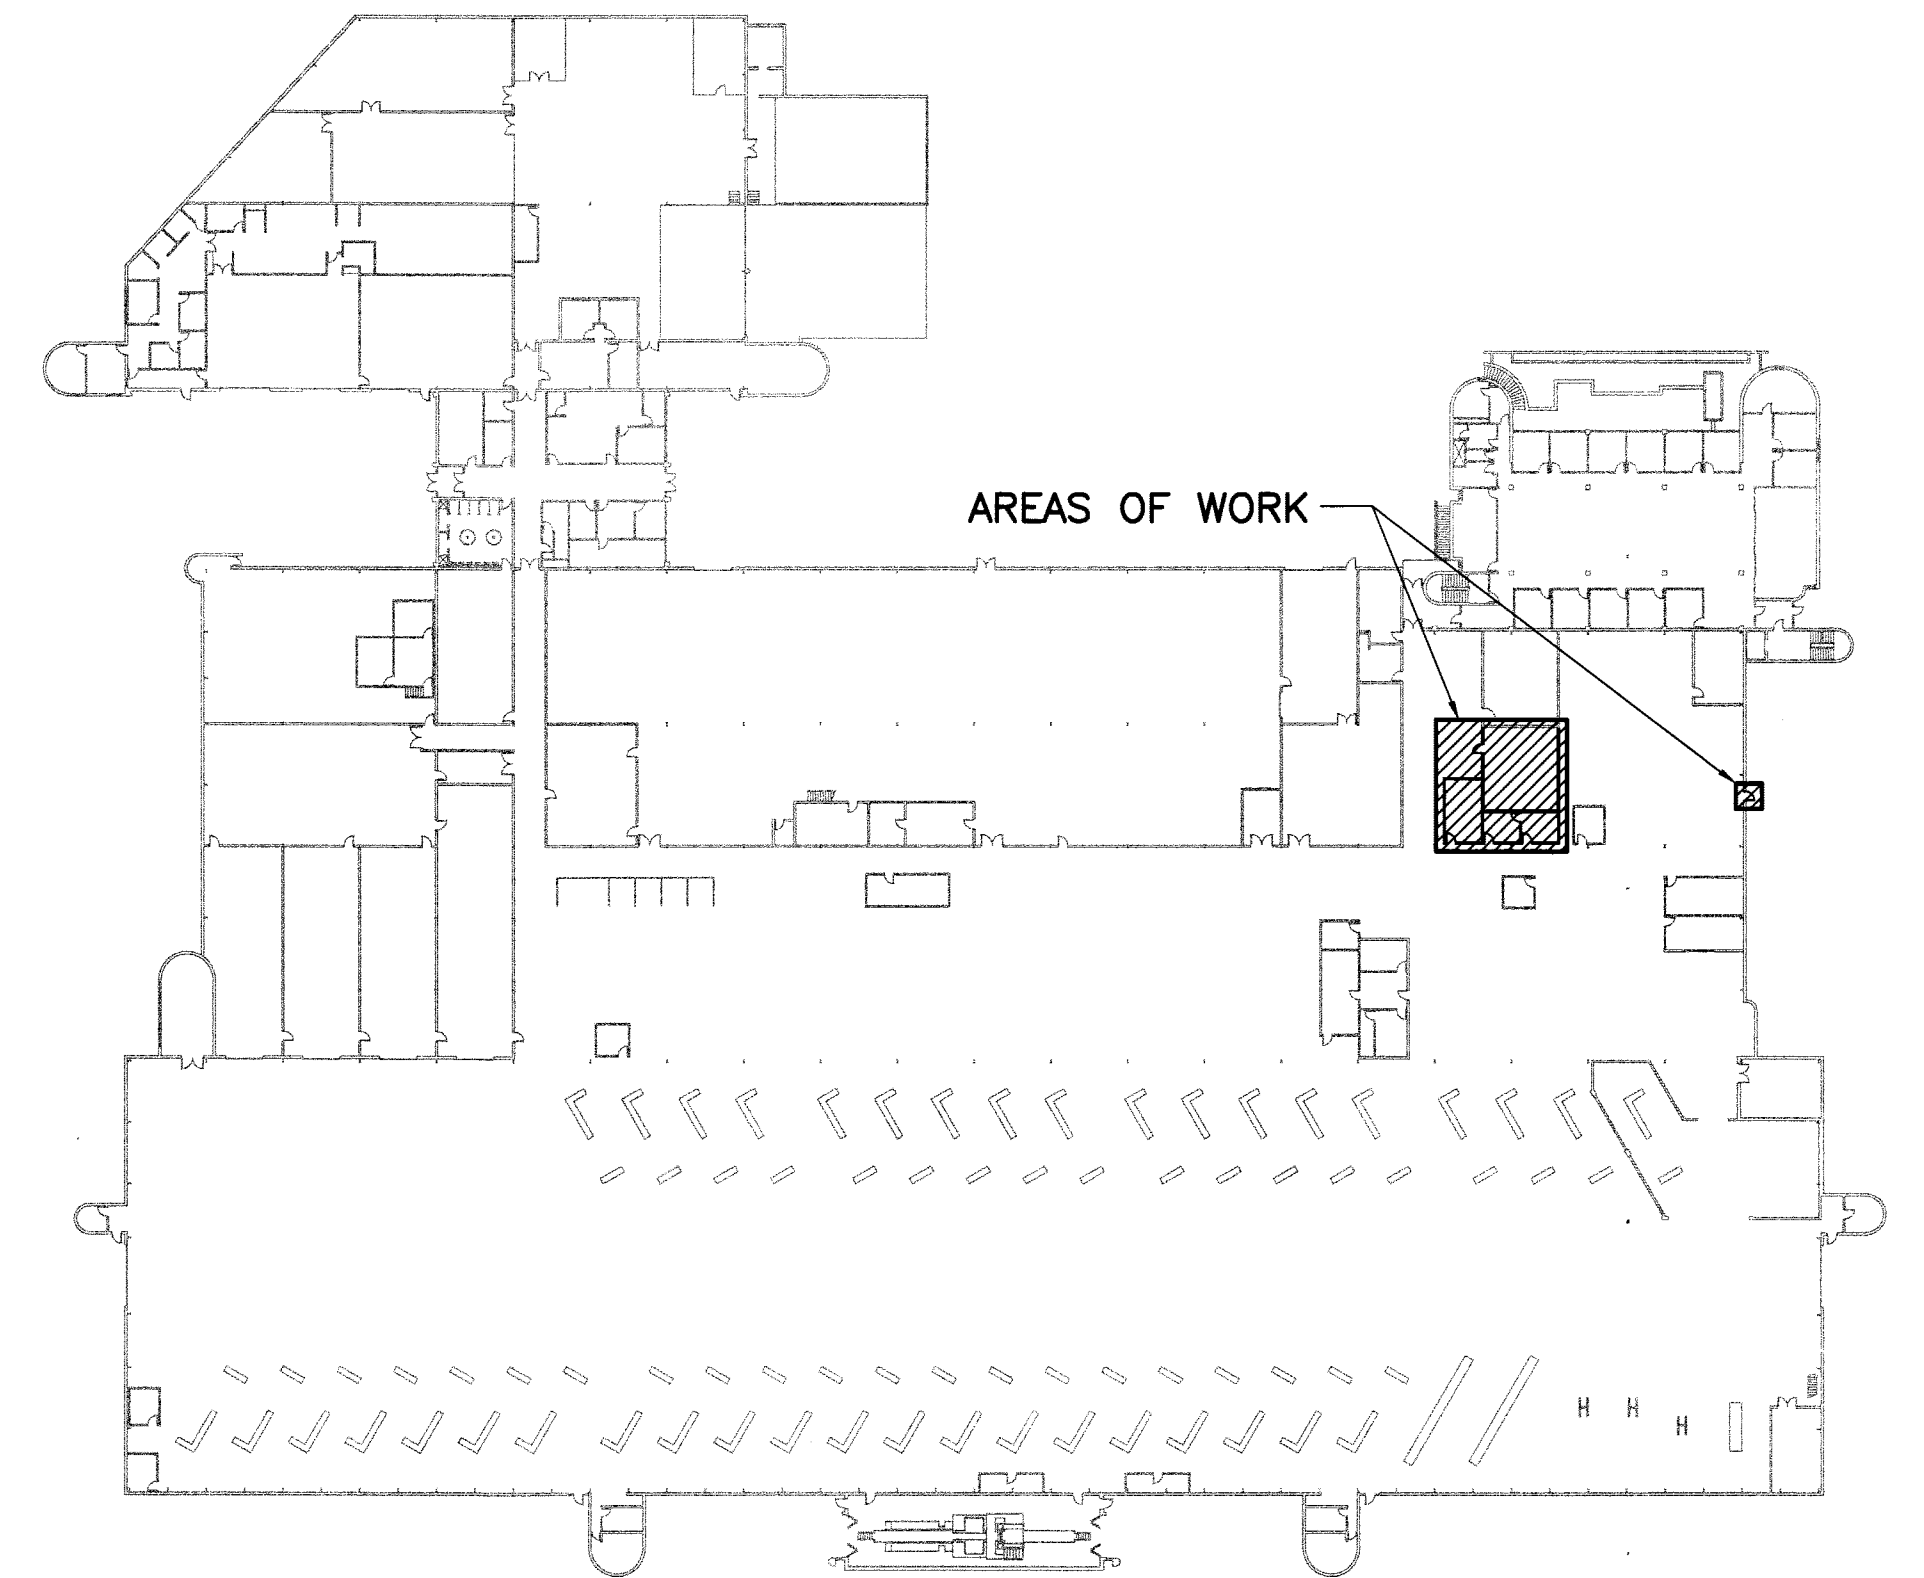

KEY PLAN

DRAWING INDEX

BUILDING

1329720200-DWG-G0001-00 SITE PLAN

BUILDING

1329720200-DWG-B0001-00 PARTIAL MAIN FLOOR PLAN
1329720200-DWG-B0002-00 PARTIAL DEMOLITION AND MAIN FLOOR PLAN
1329720200-DWG-B0003-00 PARTIAL REFLECTED CEILING ROOF PLAN
1329720200-DWG-B0004-00 BUILDING SECTION AND DETAILS
1329720200-DWG-B0005-00 BUILDING SPECIFICATIONS & SCHEDULES

STRUCTURAL

1329720200-DWG-S0001-00 STEEL STUD FRAMING PLAN, AND DETAILS
1329720200-DWG-S0002-00 STRUCTURAL SPECIFICATIONS

MECHANICAL

1329720200-DWG-M0001-00 PARTIAL MAIN FLOOR PLAN DEMOLITION AND NEW CONSTRUCTION
1329720200-DWG-M0002-00 PARTIAL MAIN FLOOR PLAN COMPRESSED AIR AND SPRINKLER SYSTEM PIPING
1329720200-DWG-M0003-00 MECHANICAL SPECIFICATIONS
1329720200-DWG-M0004-00 SCHEDULES AND DETAILS

ELECTRICAL

1329720200-DWG-E0001-00 ELECTRICAL KEY PLAN AND SYMBOL LEGEND
1329720200-DWG-E0002-00 ELECTRICAL DEMOLITION PLAN
1329720200-DWG-E0003-00 ELECTRICAL PARTIAL MAIN FLOOR PLAN
1329720200-DWG-E0004-00 ELECTRICAL PARTIAL MAIN FLOOR PLAN LIGHTING DETAILS
1329720200-DWG-E0005-00 ELECTRICAL SCHEDULES
1329720200-DWG-E0006-00 ELECTRICAL SPECIFICATIONS - SHEET 1 OF 2
1329720200-DWG-E0007-00 ELECTRICAL SPECIFICATIONS - SHEET 2 OF 2

ABBREVIATED CODE REVIEW - MBC 2011

1. OCCUPANCY CLASSIFICATION	
CLASSIFICATION:	3.2.2.72. INDUSTRIAL BUILDINGS, GROUP F, DIVISION 2, ANY HEIGHT, ANY AREA, SPRINKLERED
MAJOR OCCUPANCY:	VEHICLE PARKING, MAINTENANCE AND STORAGE FACILITY
RENOVATED AREA:	288m ²
NO. OF STOREYS:	1
SPRINKLERED:	YES
2. CONSTRUCTION REQUIREMENTS	
TYPE OF CONSTRUCTION:	NONCOMBUSTIBLE
ROOF ASSEMBLIES:	NO RATING REQUIRED
FLOOR ASSEMBLIES:	FIRE SEPARATION, 2 HR. FIRE-RATING, - NOT APPLICABLE IN THIS AREA
MEZZANINES:	1 HR. FIRE-RATED - NOT APPLICABLE IN THIS AREA
LOAD BEARING WALLS AND COLUMNS:	RATED TO MATCH SUPPORTED ASSEMBLY
MINIMUM EXITS REQUIRED:	3.3.1.5.(1) 2 REQUIRED
DISTANCE BETWEEN EXITS:	3.4.2.3.(1)(b) 1/2 DIAGONAL FLOOR AREA BUT NOT LESS THAN 9m.
TRAVEL DISTANCE:	3.4.2.5.(1)(c) 45m



TT PROJECT No. 1329720200