



MAIN LEVEL - WEST END
1/16" = 1'-0"

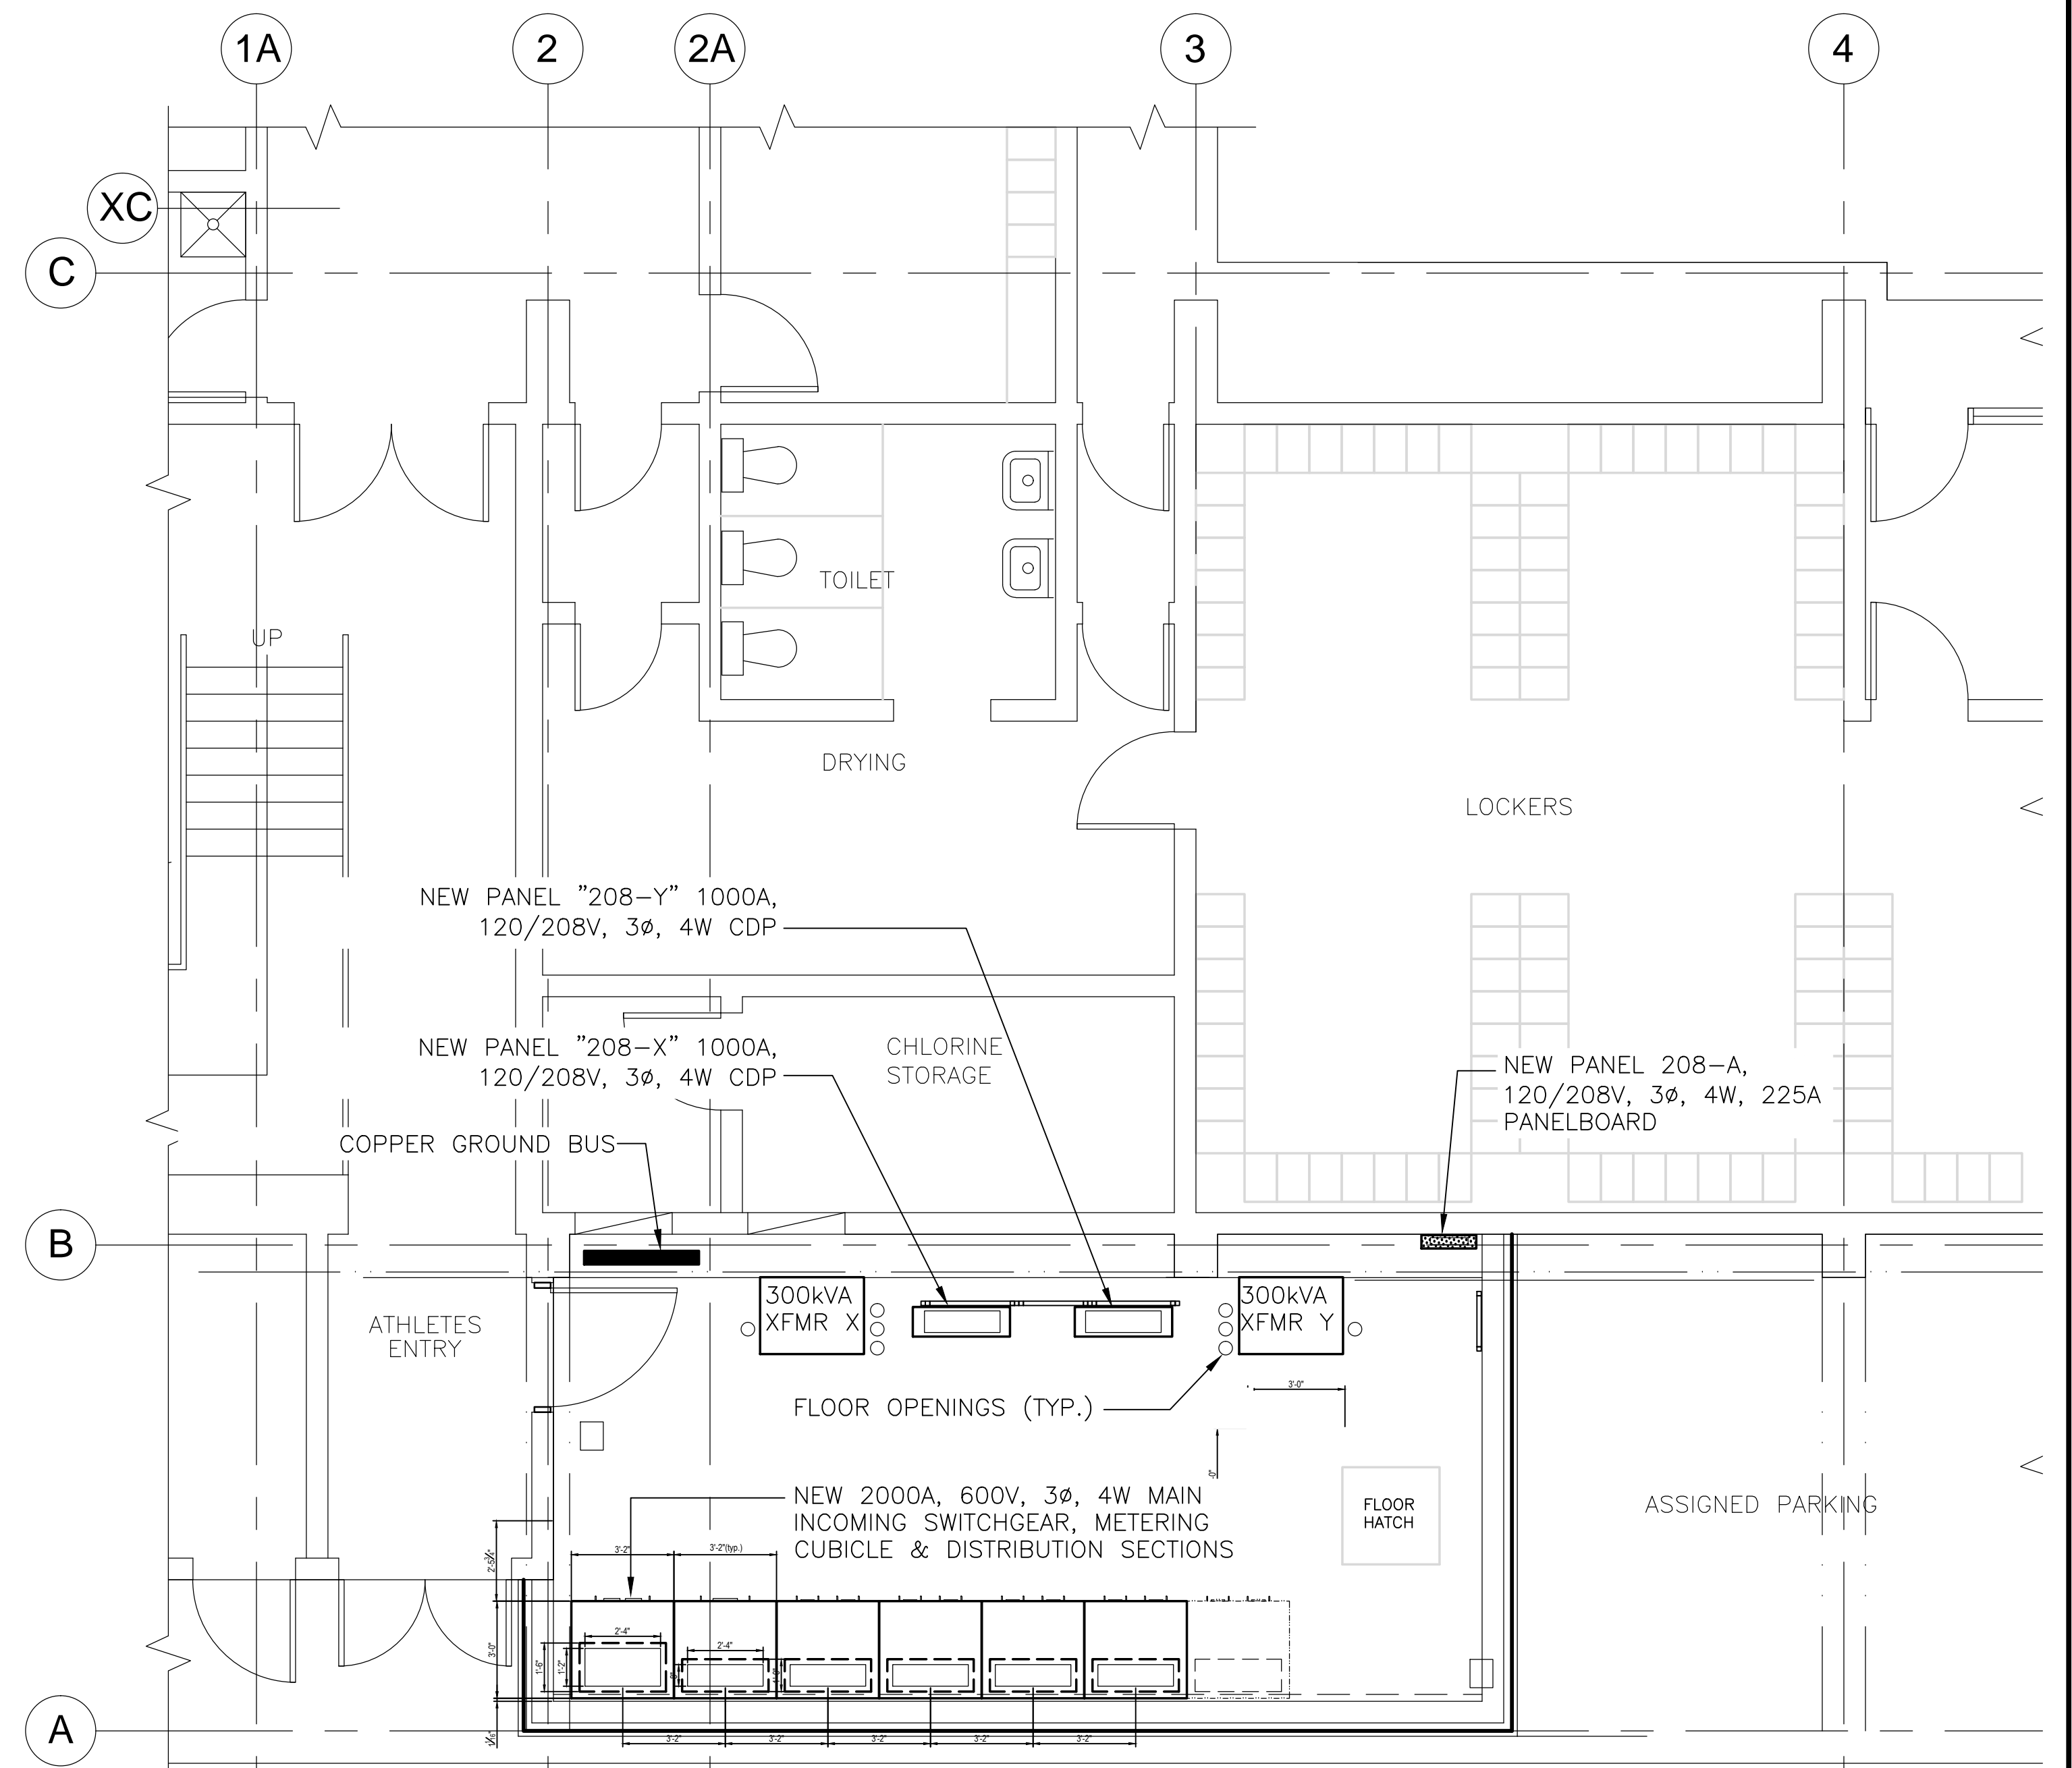

NOTE
1) CONNECT GROUND BUS TO EXISTING BUILDING GROUND SYSTEM WITH TWO (2) #2/0 AWG BARE COPPER CONDUCTORS.

2 MAIN LEVEL AT ELECTRICAL ROOM
E203E203 1/4" = 1'-0"

Conditions of Use
Verify elevations and/or dimensions on drawing prior to use. Report any discrepancies to Dillon Consulting Limited.
Do not scale dimensions from drawing.
Do not modify drawing, re-use it, or use it for purposes other than those intended at the time of its preparation without prior written permission from Dillon Consulting Limited.

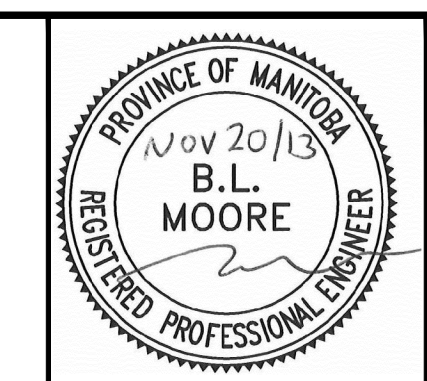

DESIGN	BLM	REVIEWED BY	
DRAWN	SCK	CHECKED BY	
DATE	APR 3, 2013		
SCALE	AS SHOWN		
ISSUED FOR	ISSUED FOR	DATE	BY
0	ISSUED FOR BID OPPORTUNITY NUMBER 850-2013	13-11-20	SCK

PAN AM POOL ELECTRICAL UPGRADE		PROJECT NO. 137300
ELECTRICAL MAIN LEVEL - WEST & ELECTRICAL ROOM		SHEET NO. E204