


FIL-X413/ X414
 FILTER COLUMNS

HEIGHT: 6.5m
 DIAMETER: 150mm

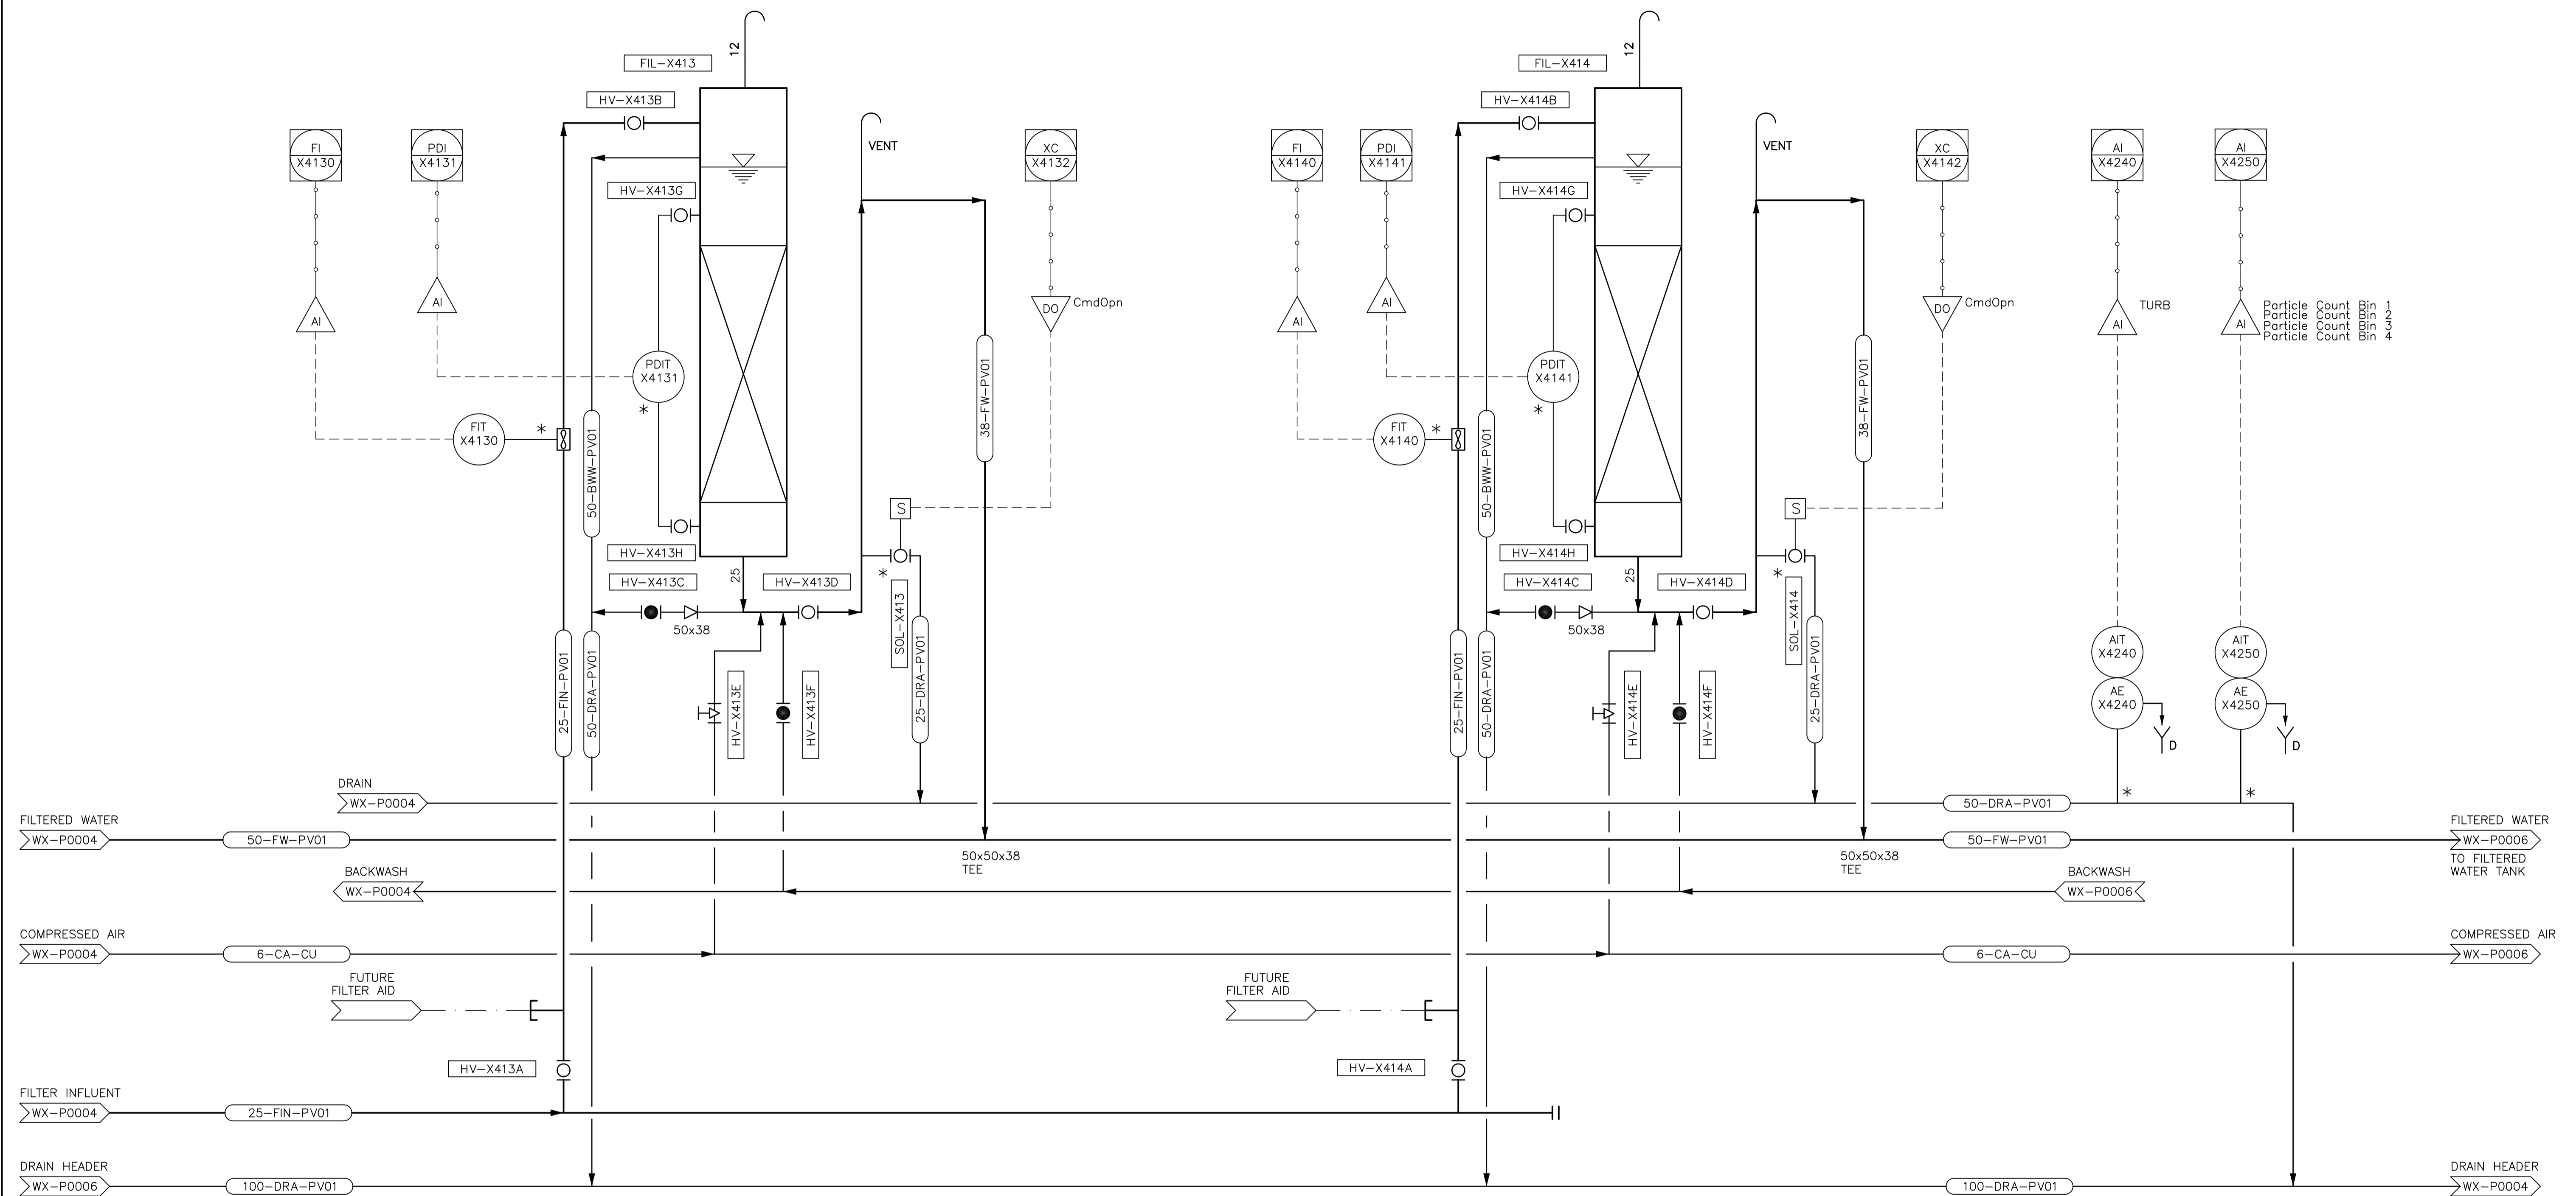

NOTES:


* CITY OF WINNIPEG TO SUPPLY EQUIPMENT/ INSTRUMENTATION.
 CONTRACTOR TO INSTALL.



B.M. ELEV.			
CONSTRUCTION COMPLETION DATE: YYYY MM DD			
DESIGNED BY	KG	CHECKED BY	BW
DRAWN BY	JBC	APPROVED BY	BW
SCALE:	NTS	RELEASED FOR CONSTRUCTION	
HORIZONTAL			
VERTICAL			
DATE	2014 06 13	DATE	
NO.	REVISIONS	DATE	BY
1	ISSUED FOR BID OP. 1068-2014	15/01/23	JBC
0	ISSUED FOR TENDER	14/06/13	JBC



DESIGNED BY	KG	CHECKED BY	BW
DRAWN BY	JBC	APPROVED BY	BW
SCALE:	NTS	RELEASED FOR CONSTRUCTION	
HORIZONTAL			
VERTICAL			
DATE	2014 06 13	DATE	

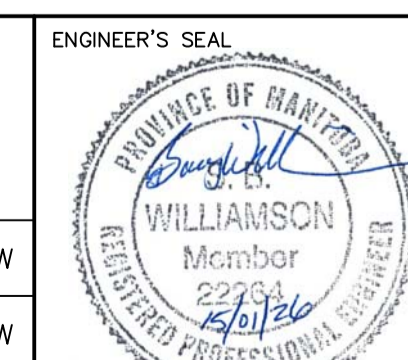

CONSULTANT DRAWING NUMBER
 WX-P0005

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 ENGINEERING DIVISION

CITY OF WINNIPEG WATER TREATMENT RESEARCH
 AND PROCESS OPTIMIZATION FACILITY
 PROCESS
 FILTER BANK A (SHEET 2 OF 2)
 PROCESS AND INSTRUMENTATION DIAGRAM

SHEET X OF X
 CITY DRAWING NUMBER
 1-0601X-P0004-002-01

PLOT DATE: 2015 01 26

BID OPPORTUNITY: 1068-2014

FILE PATH: \\WINNIPEG\Pro\WinnipegCityof\462784Waterworks\DWG\DLV\
 FILE NAME: 462784-P-0001.dwg