



File Name: P:\Projects\2013\13-0107-026\DWG\Elec\13-0107-026-D-E40.1-40.2.dwg - Tab: D-E40.1 Plotted By: deroche 12/16/2014 [Tue 4:11pm]

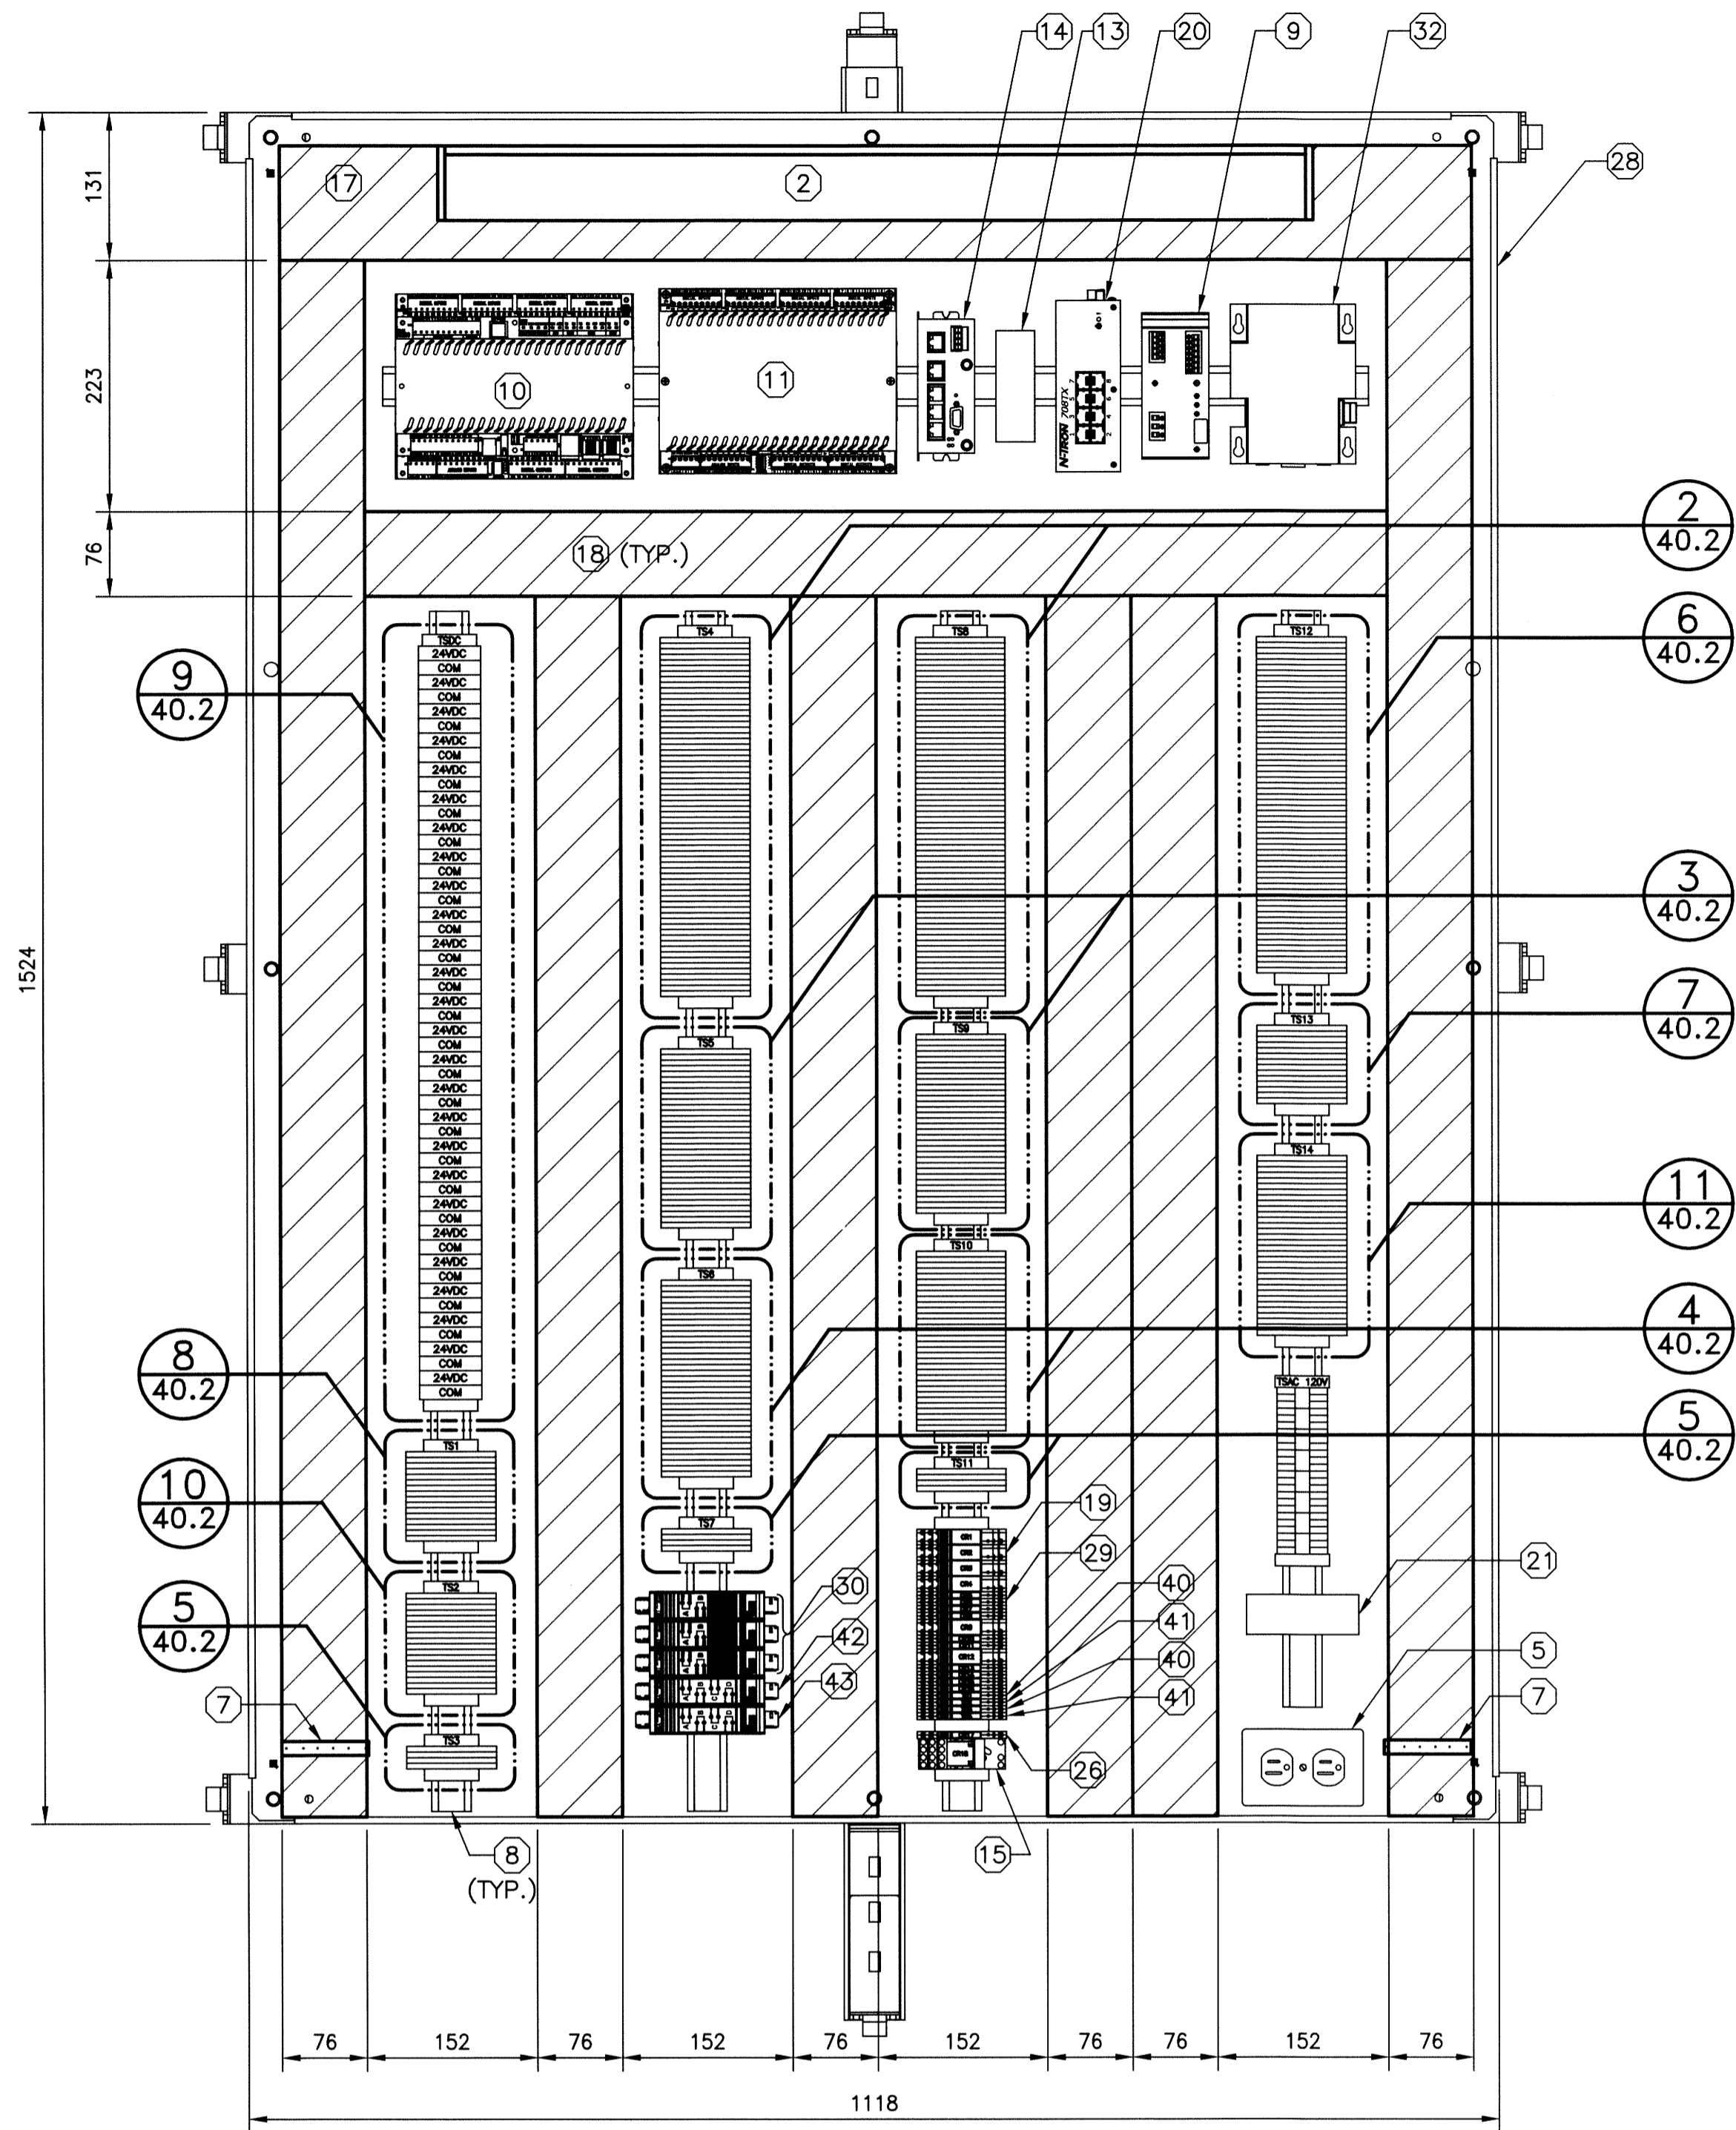


1 ENCLOSURE AND DEVICE ARRANGEMENT
 SCALE: N.T.S.

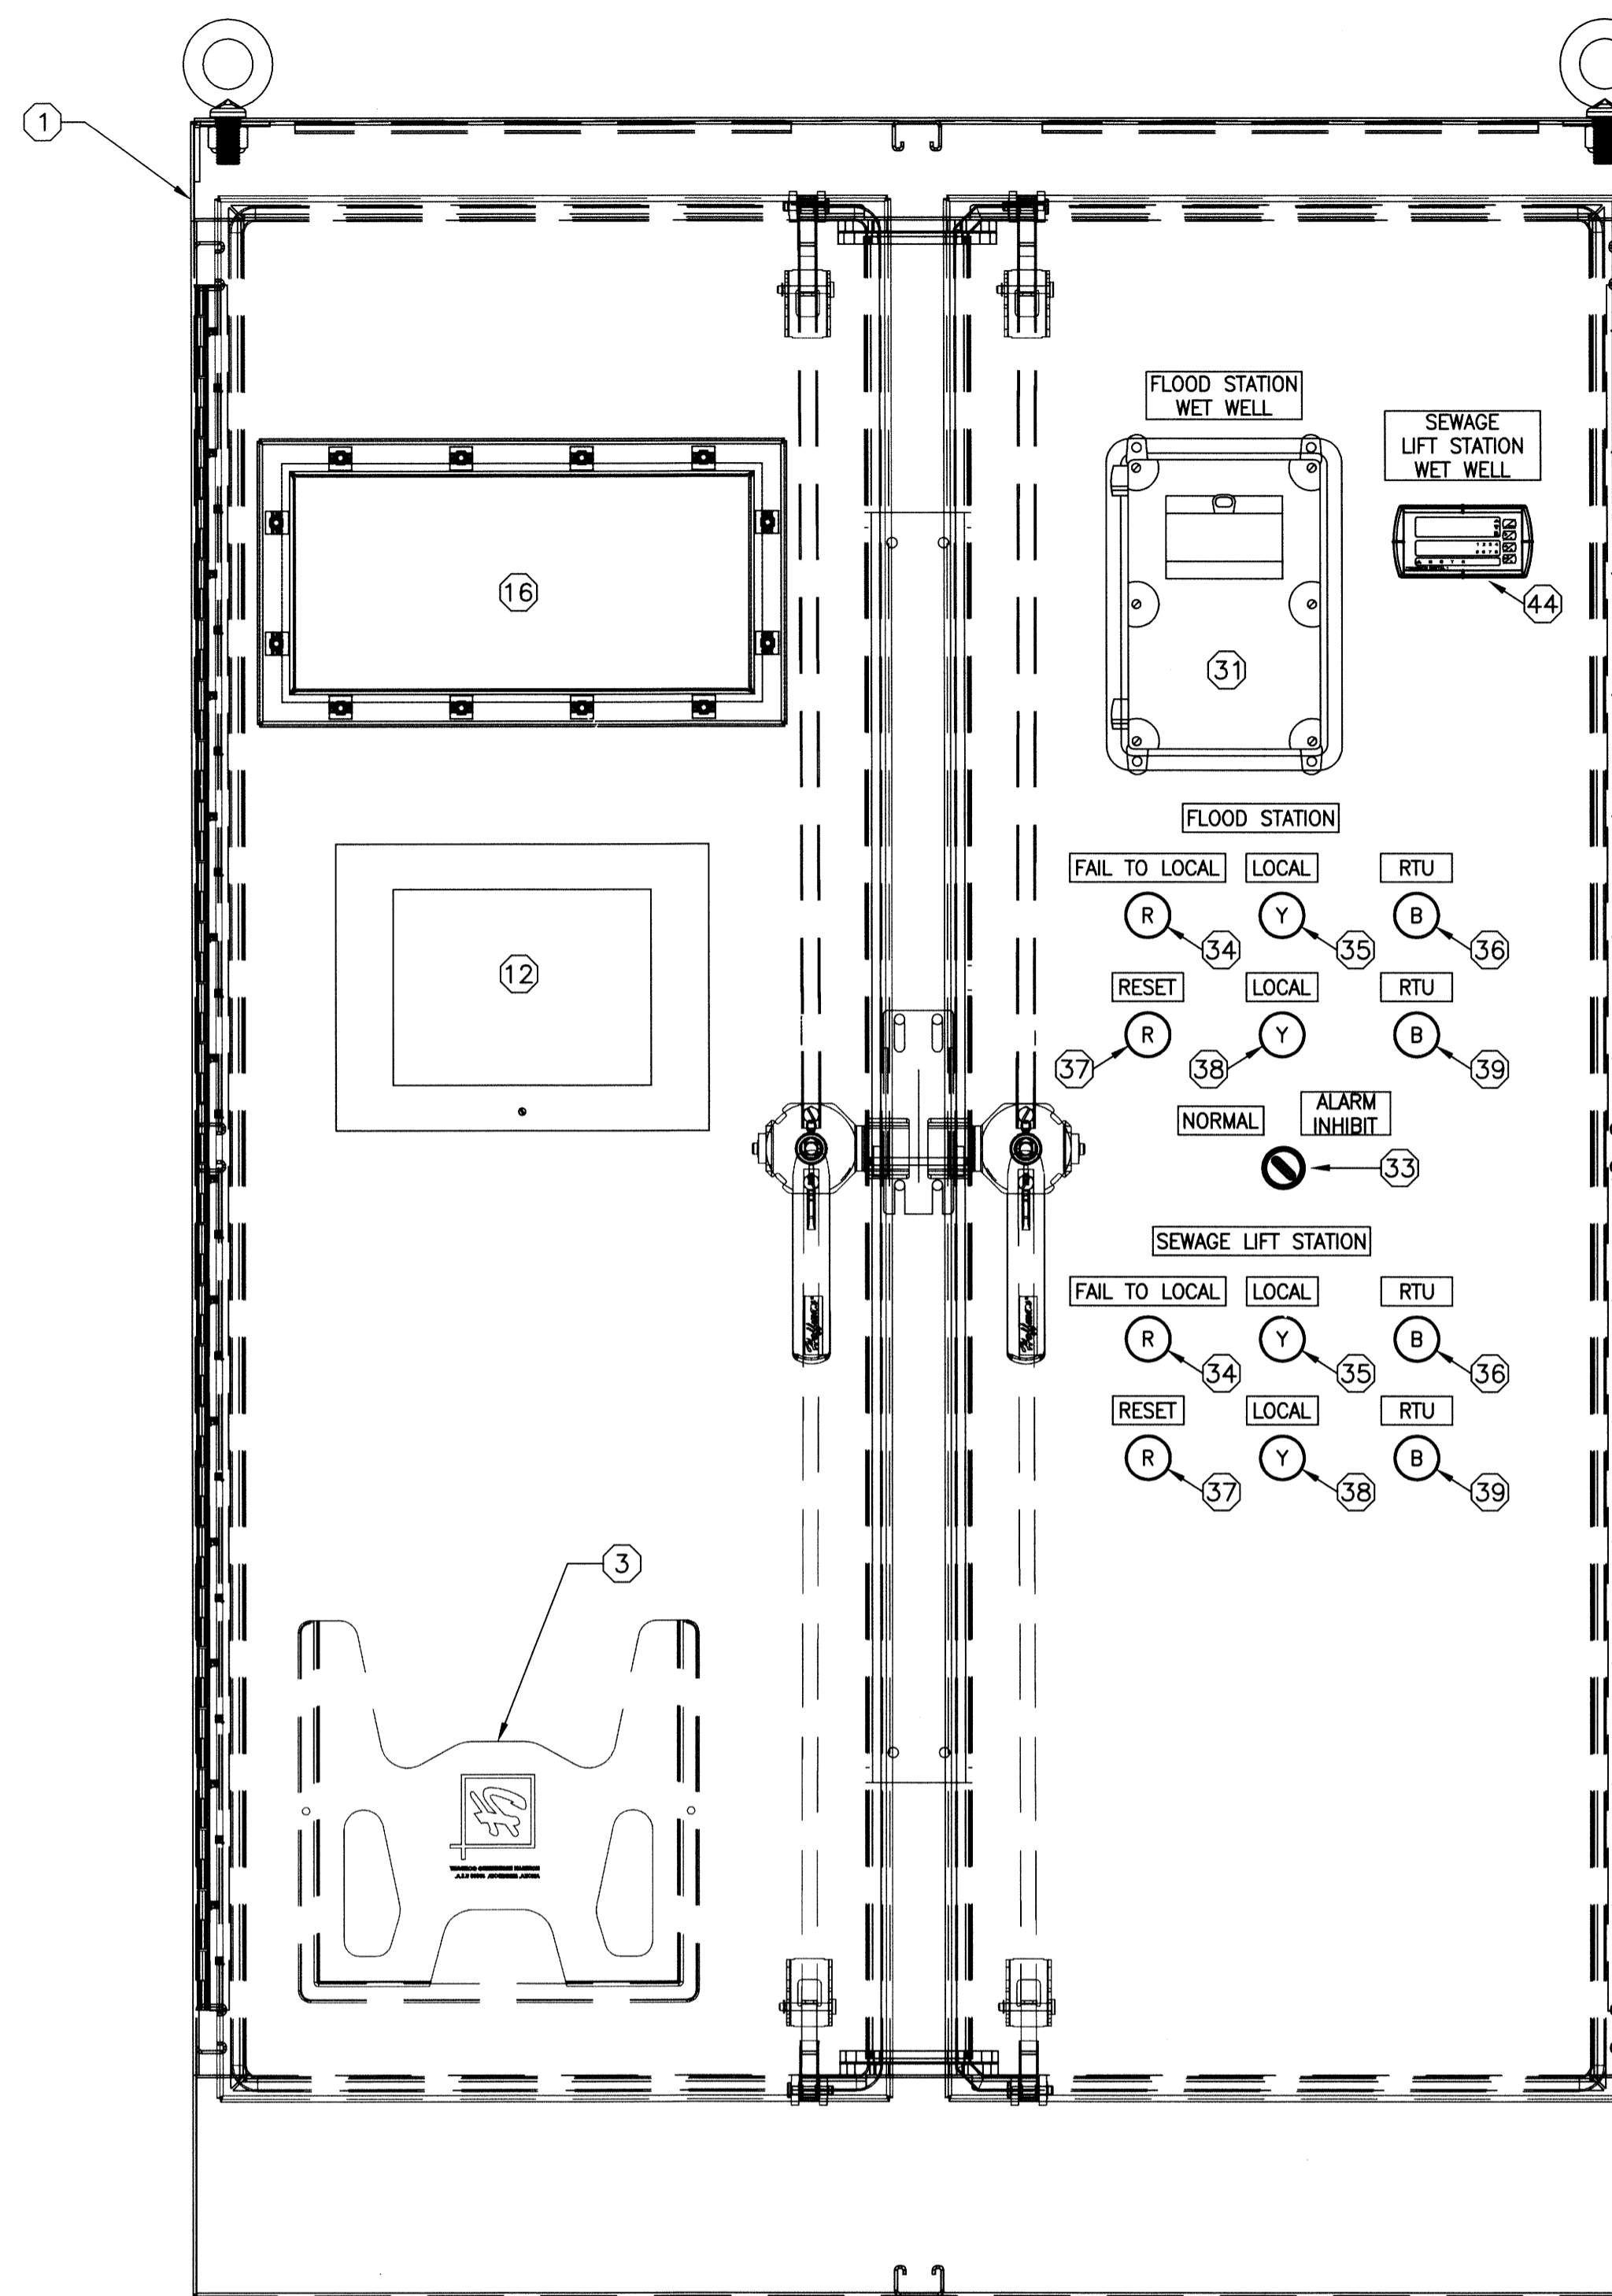

2 ENCLOSURE AND DEVICE FRONT PANEL
 SCALE: N.T.S.

NOTES:

1. PROVIDE MOUNTING RAIL TO MAXIMUM AVAILABLE LENGTH.
2. REMOVE PORTIONS OF WIRE DUCT SIDEWALL TO ALLOW ENTRY OF FIELD CABLES FROM PANEL SIDES.

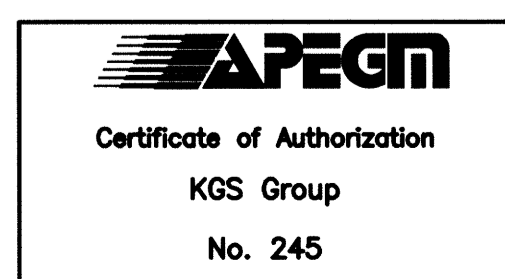

FIELD BOOK #		DESIGNED BY		CHECKED BY	
POSTED TO LBIS		DDW		[Signature]	
		DRAWN BY		APPROVED BY	
		GCN		[Signature]	
		HOR. SCALE		RELEASED FOR CONSTRUCTION	
		N.T.S.		[Signature]	
		VERTICAL		DATE	
		N.T.S.		2014 04 04	
0 ISSUED FOR CONSTRUCTION		14/12/15		AP	
NO. REVISIONS		DATE		BY	

ENGINEER'S SEAL

D-E40.1

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

FLOOD PUMPING STATION UPGRADES
 DUMOULIN STATION
ELECTRICAL
 RTU PANEL ENCLOSURE
 LAYOUT AND DETAILS

SHEET 1 OF 2
 CITY DRAWING NUMBER
 1-0139F-E0005-001