


DWG NORTH

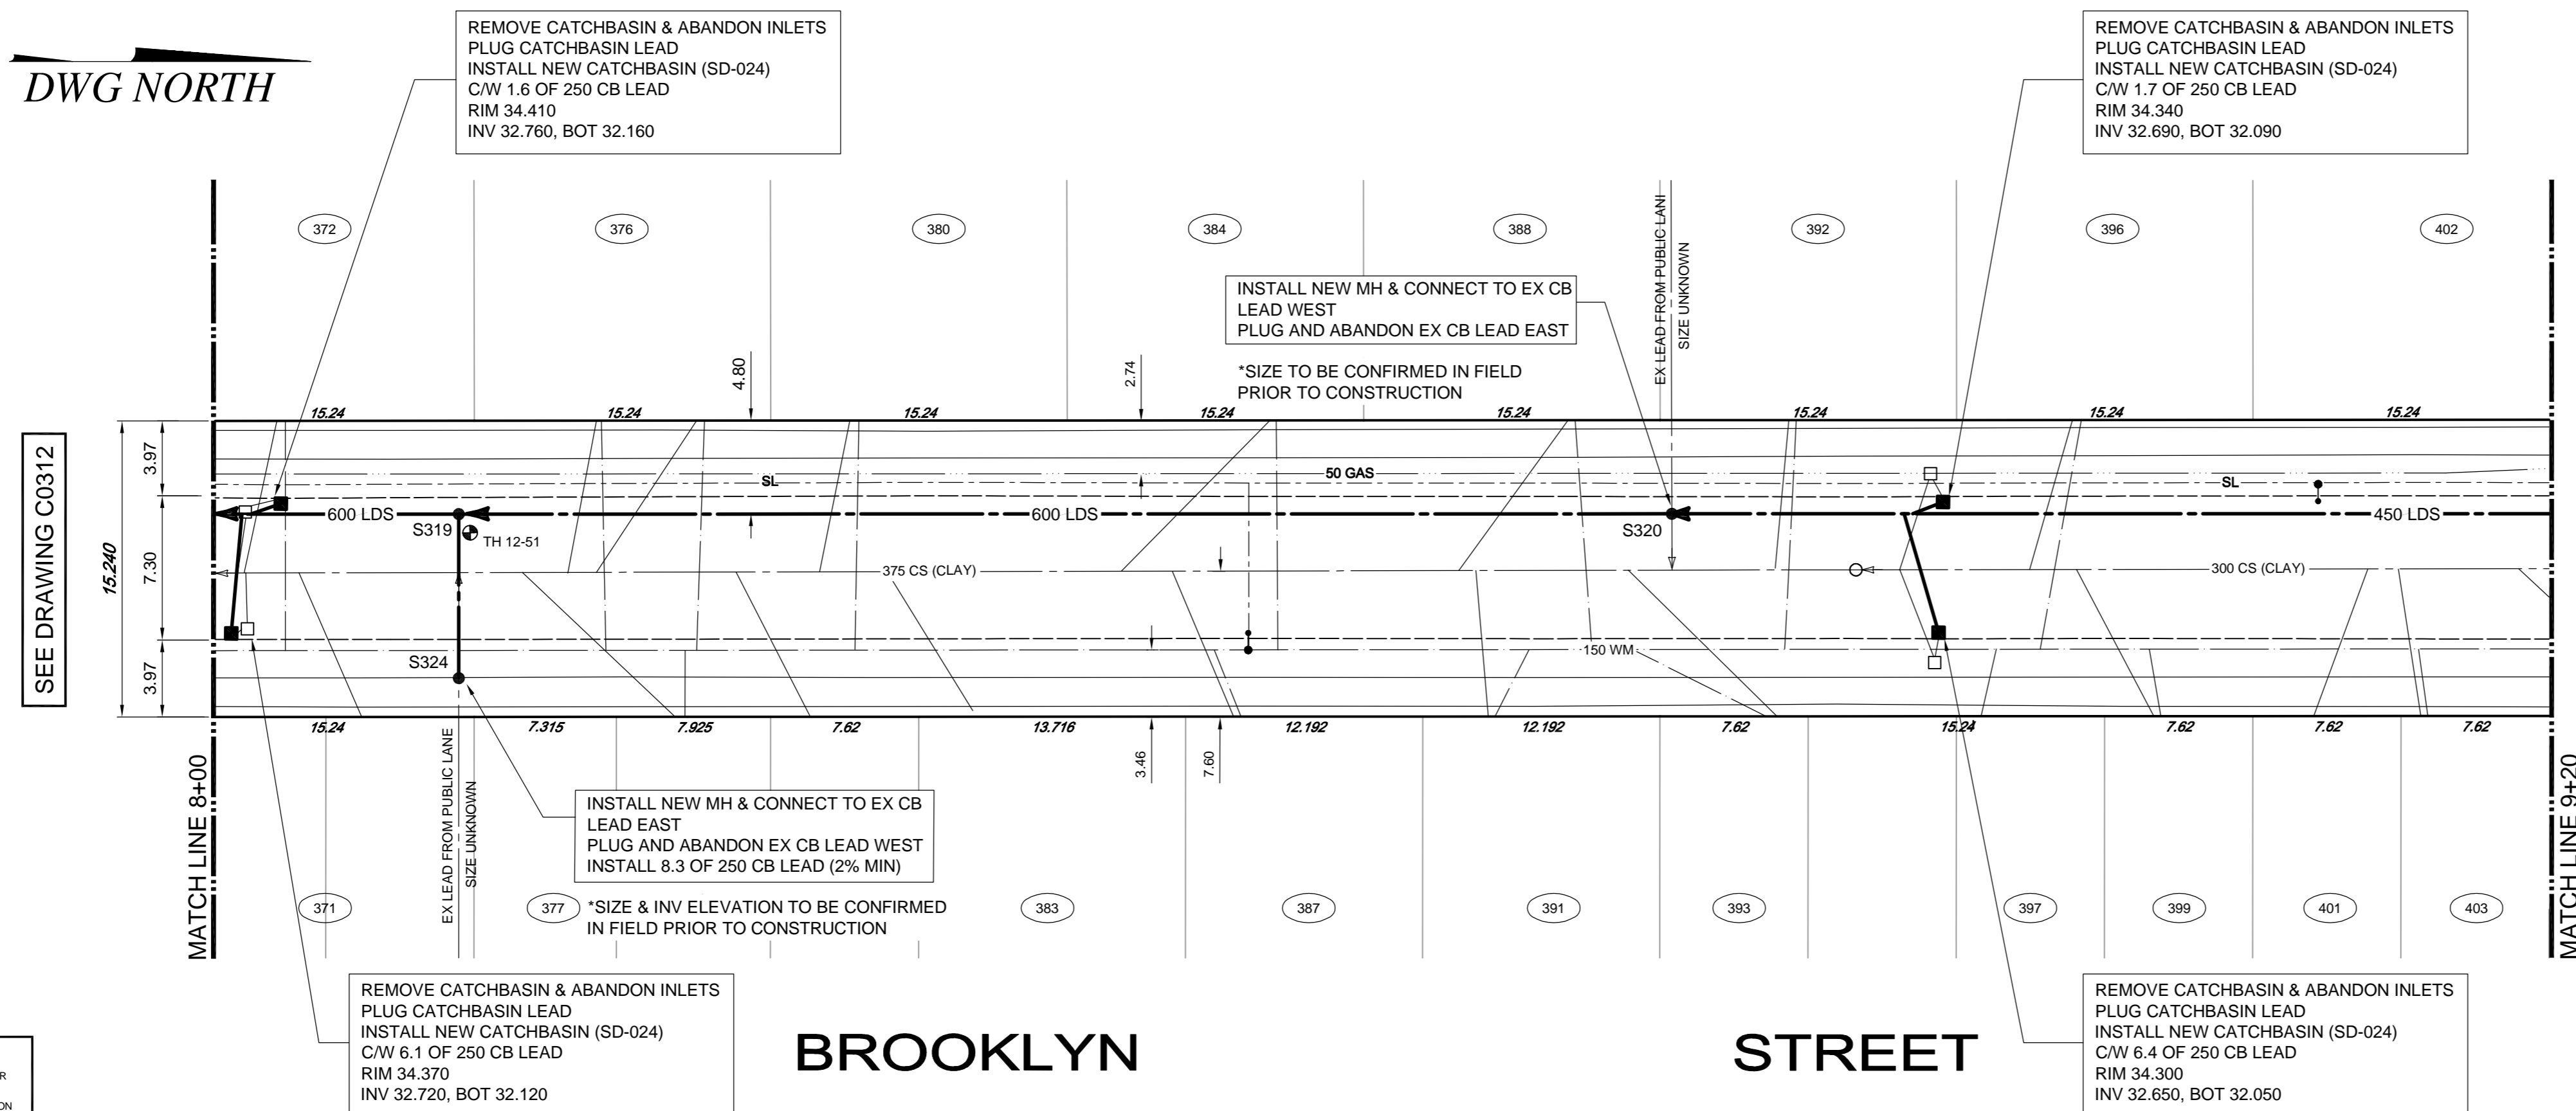

- CONSTRUCTION NOTES:**
- LOCATION OF ALL SEWER AND WATER LINES TO BE CONFIRMED IN THE FIELD.
 - SEWER AND WATER SERVICES SHOWN ON DRAWINGS ARE APPROXIMATE ONLY.
 - INSTALL NEW SEWER AND CATCHBASIN LEADS BY TRENCHLESS METHODS, UNLESS NOTED OTHERWISE.
- GENERAL NOTES:**
- CHAINAGE IS ALONG WEST LIMIT OF BROOKLYN STREET.
 - STATION 6+00 = SOUTH LIMIT OF NESS AVENUE.
 - SEE SPECIFICATIONS FOR DETAILED TEST HOLE INFORMATION.

APEGM
Certificate of Authorization
TETRA TECH WEI Inc.
No. 5313 Date: April 30, 2014

WARNING
IF POWER EQUIPMENT OR EXPLOSIVES ARE TO BE USED FOR EXCAVATION ON THIS PROJECT THE CONTRACTOR MUST:
1. NOTIFY THE GAS COMPANY OF THE PROPOSED LOCATION OF EXCAVATION.
2. TAKE PRECAUTION TO AVOID DAMAGE TO GAS COMPANY INSTALLATIONS. SEE PROVINCIAL REGULATION 140/92 FOR DETAILS.

EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED	EXISTING	LEGEND-PLAN	PROPOSED
150 WM	WATERMAIN	150 WM	ANCHOR	ANCHOR	ANCHOR	LOCATION APPROVED UNDERGROUND STRUCTURES	LOCATION APPROVED UNDERGROUND STRUCTURES	LOCATION APPROVED UNDERGROUND STRUCTURES
400 FM	FEEDERMAIN	400 FM	TREE	TREE	TREE	SUPV. U/G STRUCTURES COMMITTEE	SUPV. U/G STRUCTURES COMMITTEE	SUPV. U/G STRUCTURES COMMITTEE
300 LDS	LAND DRAINAGE SEWER	300 LDS	CURB STOP	CURB STOP	CURB STOP	NOTE:	NOTE:	NOTE:
250 WWS	WASTEWATER SEWER	250 WWS	PLUG	PLUG	PLUG	LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.	LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.	LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.
300 CS	COMBINED SEWER	300 CS	MANHOLE	MANHOLE	MANHOLE			
200 FCM	FORCEMAIN	200 FCM	CATCHBASIN	CATCHBASIN	CATCHBASIN			
	JUNCTIONS		CURB INLET	CURB INLET	CURB INLET			
	HYDRANT		ADDRESS	ADDRESS	ADDRESS			
	VALVE		HYDRO POLE	HYDRO POLE	HYDRO POLE			
	REDUCER		LIGHT STANDARD	LIGHT STANDARD	LIGHT STANDARD			

NO.	REVISIONS	DATE	BY
01	ISSUED FOR TENDER	14.01.28	KJM
00	ISSUED FOR APPROVAL	14.01.27	KJM

TETRA TECH


DESIGNED BY: KJM, GWC
CHECKED BY: BLM
DRAWN BY: NL
APPROVED BY: GS

HOR. SCALE: 1 : 250
VERTICAL: 1 : 50

RELEASED FOR CONSTRUCTION

ORIGINAL DRAWING REVISION "00" SEALED BY
K.J. McRAE
14.01.27

CONSULTANT DRAWING NO.
1000120300-DWG-C0140

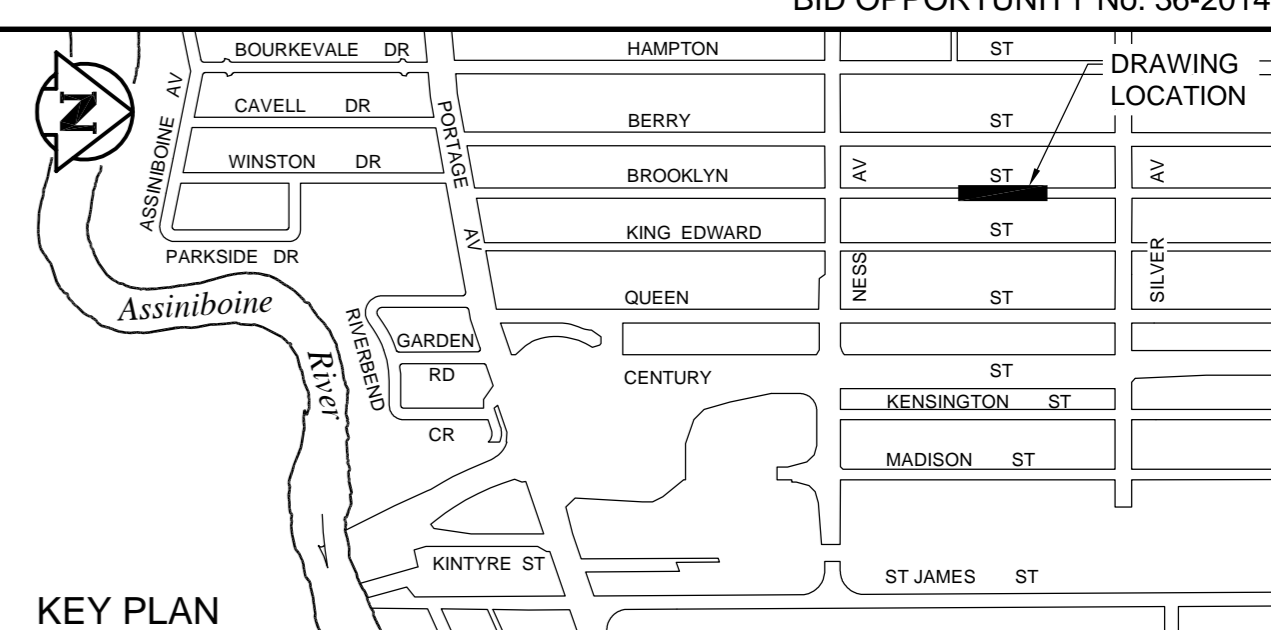

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

FERRY ROAD AND RIVERBEND
COMBINED SEWER RELIEF WORKS
CONTRACT 3

CITY DRAWING NUMBER
10676
SHEET 13 OF 14

C0313

177m NORTH OF NESS AVENUE TO
107m SOUTH OF SILVER AVENUE

BID OPPORTUNITY No. 36-2014