

Location	City Drawing Number	Equipment Identifier	Equipment Type	Picture Figure
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LB2	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LB2-5	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LB5	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LBT8	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LBT9	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LBT10	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LBT11	Non-Drawout Disconnecting Switch	Figure 1&2
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LT8 (600A)	Drawout Air Circuit Breaker	Figure 3
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LT8-10 (600A)	Drawout Air Circuit Breaker	Figure 3
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LT9 (600A)	Drawout Air Circuit Breaker	Figure 3
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LT9-10 (600A)	Drawout Air Circuit Breaker	Figure 3
Secondary Clarifiers Electrical Distribution Room	1-0101S-E0001 Rev.03	LT10 (600A)	Drawout Air Circuit Breaker	Figure 3

Table XX – List of 1960's switching items to be replaced in the Secondary Plant

Location	City Drawing Number	Equipment Identifier	Equipment Type	
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LB1 (LB5)	Non-Drawout Disconnecting Switch	Figure 4 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LB1-6 (LB5-6)	Non-Drawout Disconnecting Switch	Figure 4 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LB6	Non-Drawout Disconnecting Switch	Figure 4 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LBT3 (600A)	Non-Drawout Disconnecting Switch	Figure 4 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LBT4 (600A)	Non-Drawout Disconnecting Switch	Figure 4 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LT3 (600A)	Drawout Air Circuit Breaker	Figure 5 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	LT4 (600A)	Drawout Air Circuit Breaker	Figure 5 & 6
Digesters East Electrical Distribution Room	1-0101D-E0007 Rev.01	1DE11 (600A)	Drawout Air Circuit Breaker	Figure 5 & 6

Table XX – List of 1960's switching items to be replaced in the Digester East Plant

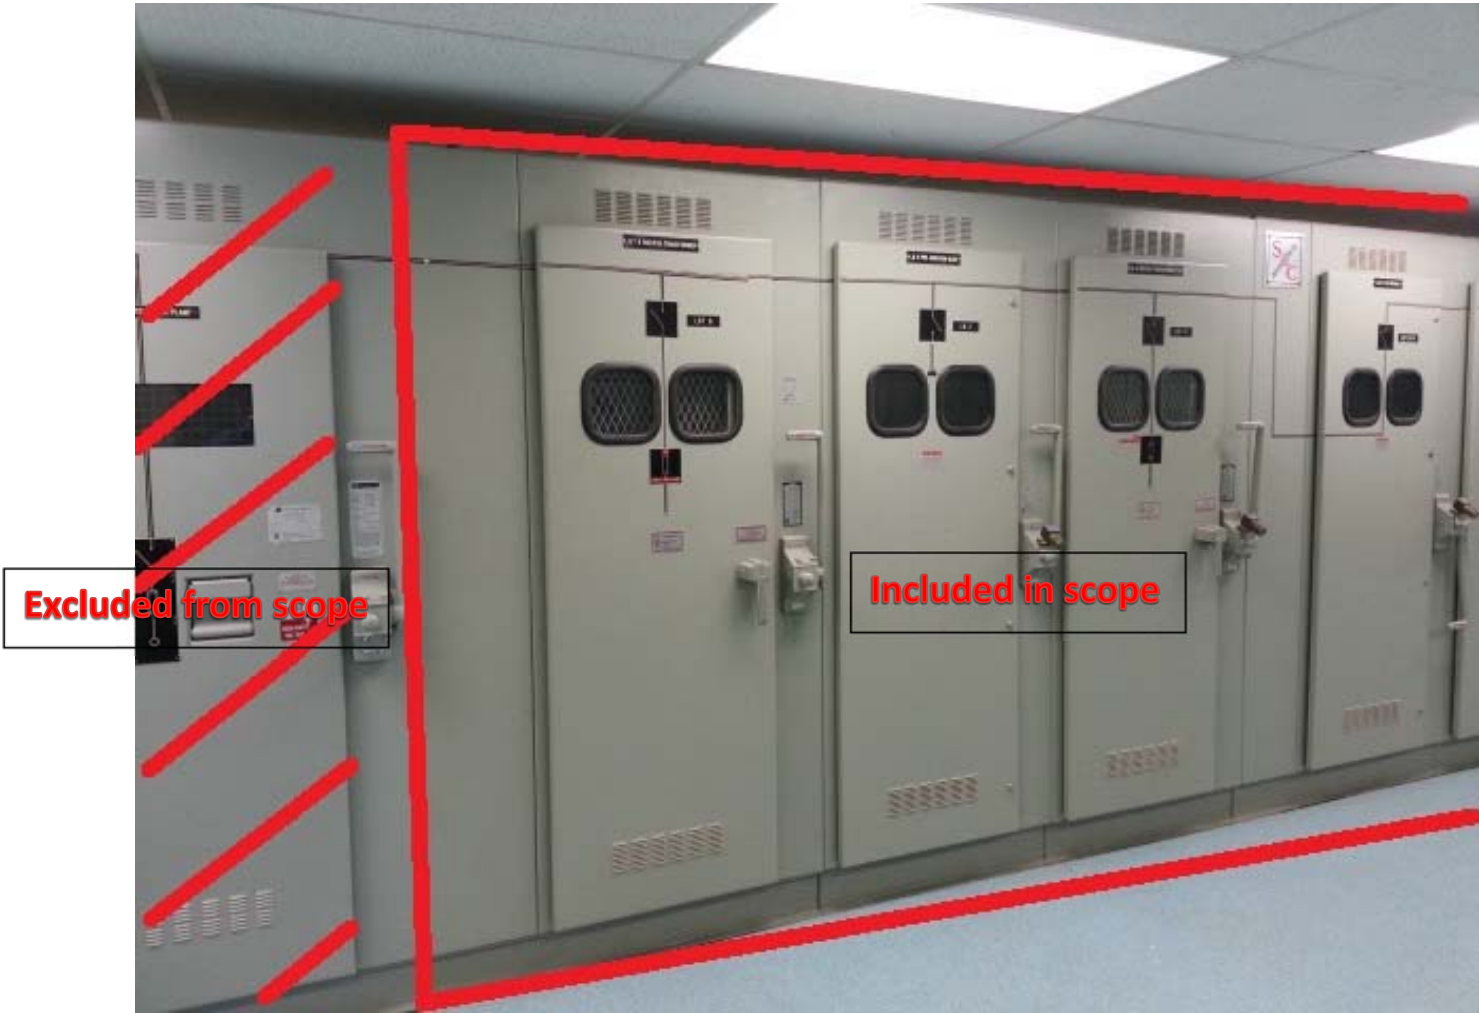


Figure 1 – 1960's Secondary Clarifiers Non-Drawout Disconnect Switches



Included in scope

Excluded from scope

Figure 2 – 1960's Secondary Clarifiers Non-Drawout Disconnect Switches



Figure 3 - 1960's Secondary Clarifiers Drawout Air Circuit Breakers



Figure 4 - 1960's Digester East Non-Drawout Disconnect Switches



Included in scope

Excluded from scope

Figure 5 - 1960's Digester East Drawout Air Circuit Breakers



Figure 6 – Underneath the Digester East Electrical Distribution Room