



DRAWING NOTES

- 1 APPROXIMATE LOCATION OF ELECTRICAL ROOM IN 40 MAYFAIR. EXISTING TIME CLOCK (T3) & CONDUIT PULL CORD ARE IN PLACE.
- 2 CONNECT NEW LIGHT FIXTURE TYPE A AS PER DETAIL 4/E3.0.
- 3 CARRY ALL NECESSARY ALLOWANCES FOR NEW LIGHTING RELAY & NEW CIRCUITS BREAKERS FOR EXISTING PANEL MD(2+30A,120V)
- 4 LIGHT FIXTURES TYPE 'A' SHALL BE VISIONAIRE LIGHTING, BOW LX, PART# BLX-8-T3-256LC-10-4K-UNV-KM-BZ.TYPICAL.

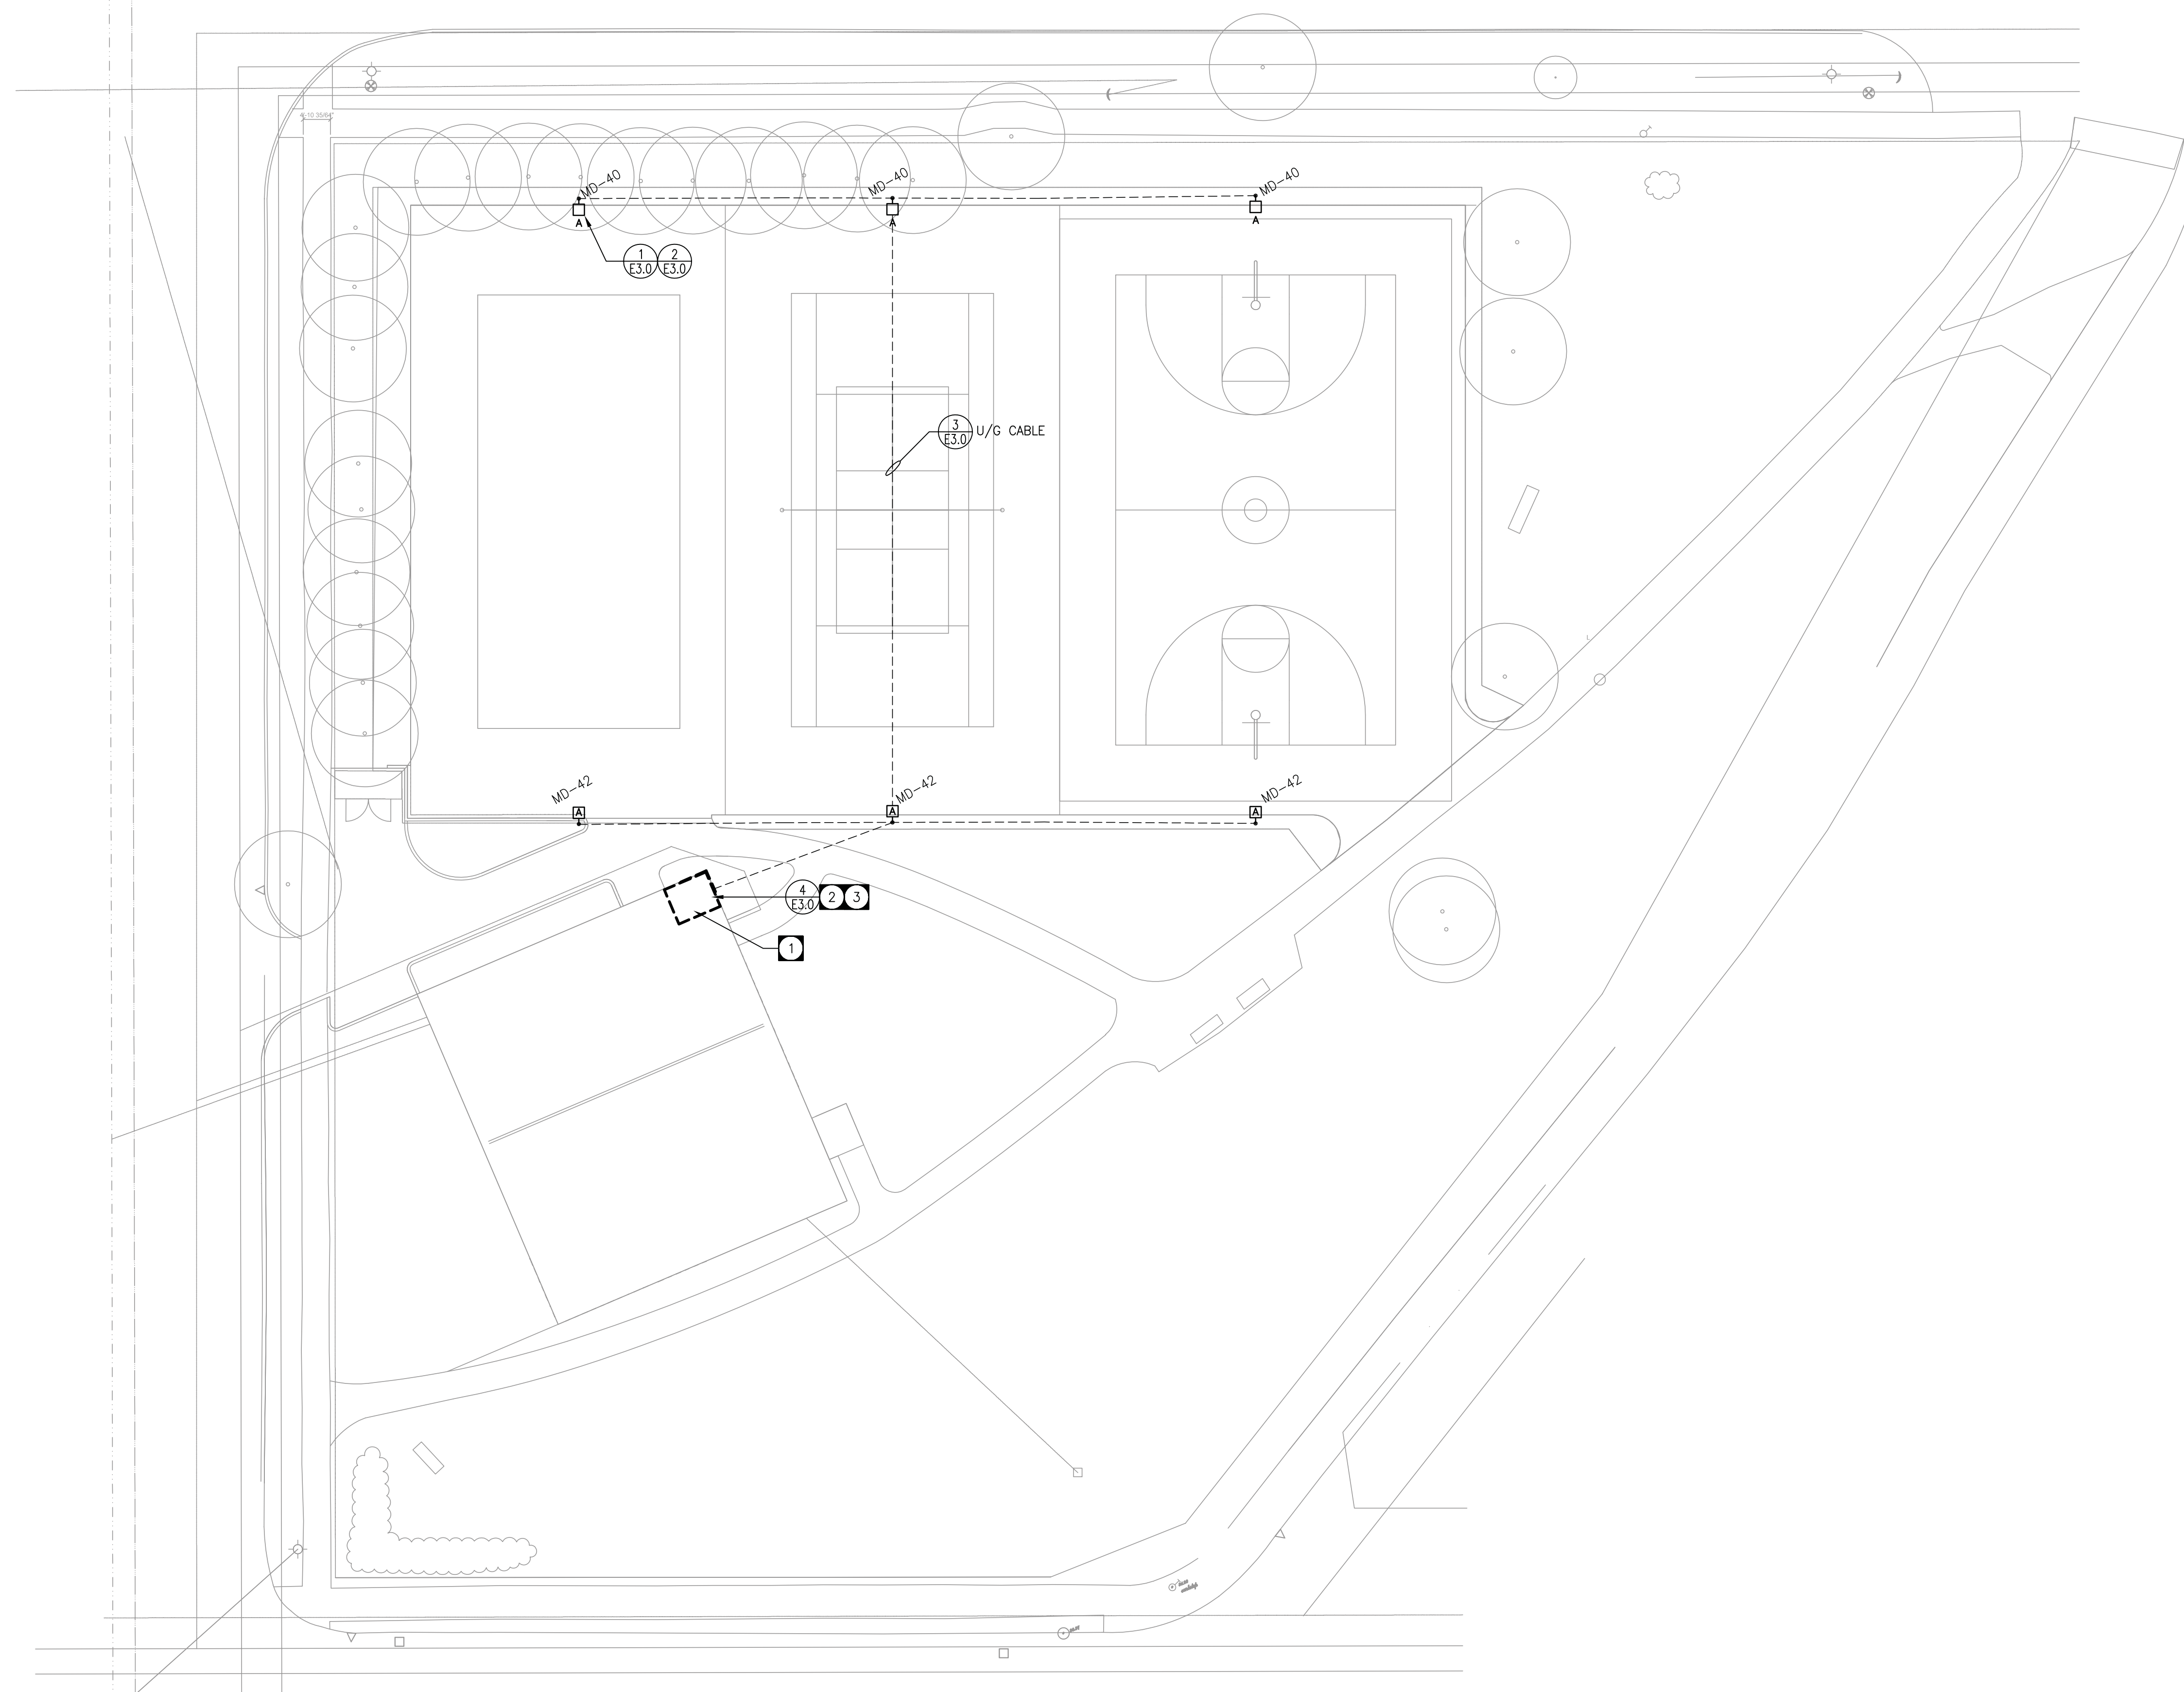

SITE PLAN
SCALE: 1:200

| No. | Date | Issue/Revision | By |
|-----|------------|------------------------|----|
| 0 | 05/26/2014 | ISSUED FOR TENDER | YL |
| B | 04/29/2014 | ISSUED FOR 100% REVIEW | YL |
| A | 03/18/2014 | ISSUED FOR 30% REVIEW | YL |

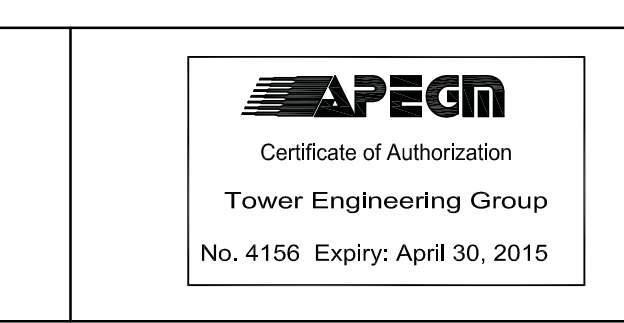

CONSULTANT
These design documents are prepared solely for the use by the party with whom the design professional has entered into a contract and there are no representations of any kind made by the design professional to any party with whom the design professional has not entered into a contract.
Any use of the drawing, disk or electronic data without the expressed written permission of Tower Engineering Group is strictly prohibited. The contractor is responsible to verify all dimensions with conditions on the site and report discrepancies to Tower Engineering for adjustment. All prints to be returned.

TOWER ENGINEERING GROUP
Electrical Engineer
TOWER PROJECT NO. : 131441
UNIT 1 - 1140 WAVERLEY ST. WINNIPEG, MB R3T 0P4
TEL: (204) 925-1150 FAX: (204) 925-1155
EMAIL: towereng@towereng.ca WEB: www.towereng.ca
• WINNIPEG • CALGARY • CAMBRIDGE

HTFC
PLANNING & DESIGN
500-115 Bannatyne Avenue East Winnipeg, MB R3B 0R3
PH: (204) 944-9907 FAX: (204) 944-9907
WWW.htfc.mb.ca

The general contractor shall check & verify all dimensions and report any errors or omissions to the Contract Administrator.

| Design | Drawn | Checked | Scale | Date | File | Sheet No. | Rev. |
|--------|-------|---------|-----------|-----------|--------|-----------|------|
| YL | WD | YL | AS MARKER | 5.27.2014 | 14-008 | E-2.0 | 0 |