WO 101-84

NOTE:

1. SEE SHEET E9 FOR JUNCTION BOX DETAILS.
2. MOUNTING HEIGHTS FOR ALL VIDEO CAMERAS TO BE ADJUSTABLE FROM 4m TO 5m.
3. POWER CABLES FOR CAMERAS TO BE INSTALLED IN SEPARATE 50mm HDPE CONDUIT WITH 50% SPARE CAPACITY AND NYLON PULL CORDS CLEARLY LABELLED.
4. VIDEO CABLE, FIBRE OPTIC CABLE AND ANY CAT6, SHALL BE INSTALLED IN 50MM HDPE CONDUIT.
5. SECURITY CAMERAS:
   a. ACTUAL FIELD OF VIEW TO BE DETERMINED ONSITE BY THE CONTRACT ADMINISTRATOR.
   b. ALL CAMERAS PLACEMENTS AND TYPES MUST BE CONFIRMED BY THE CONTRACTOR. ALL SITE CONDITIONS
   c. CONTRACTOR SHALL FOLLOW ALL MANUFACTURERS GUIDELINES FOR INSTALLATION OF CAMERAS.

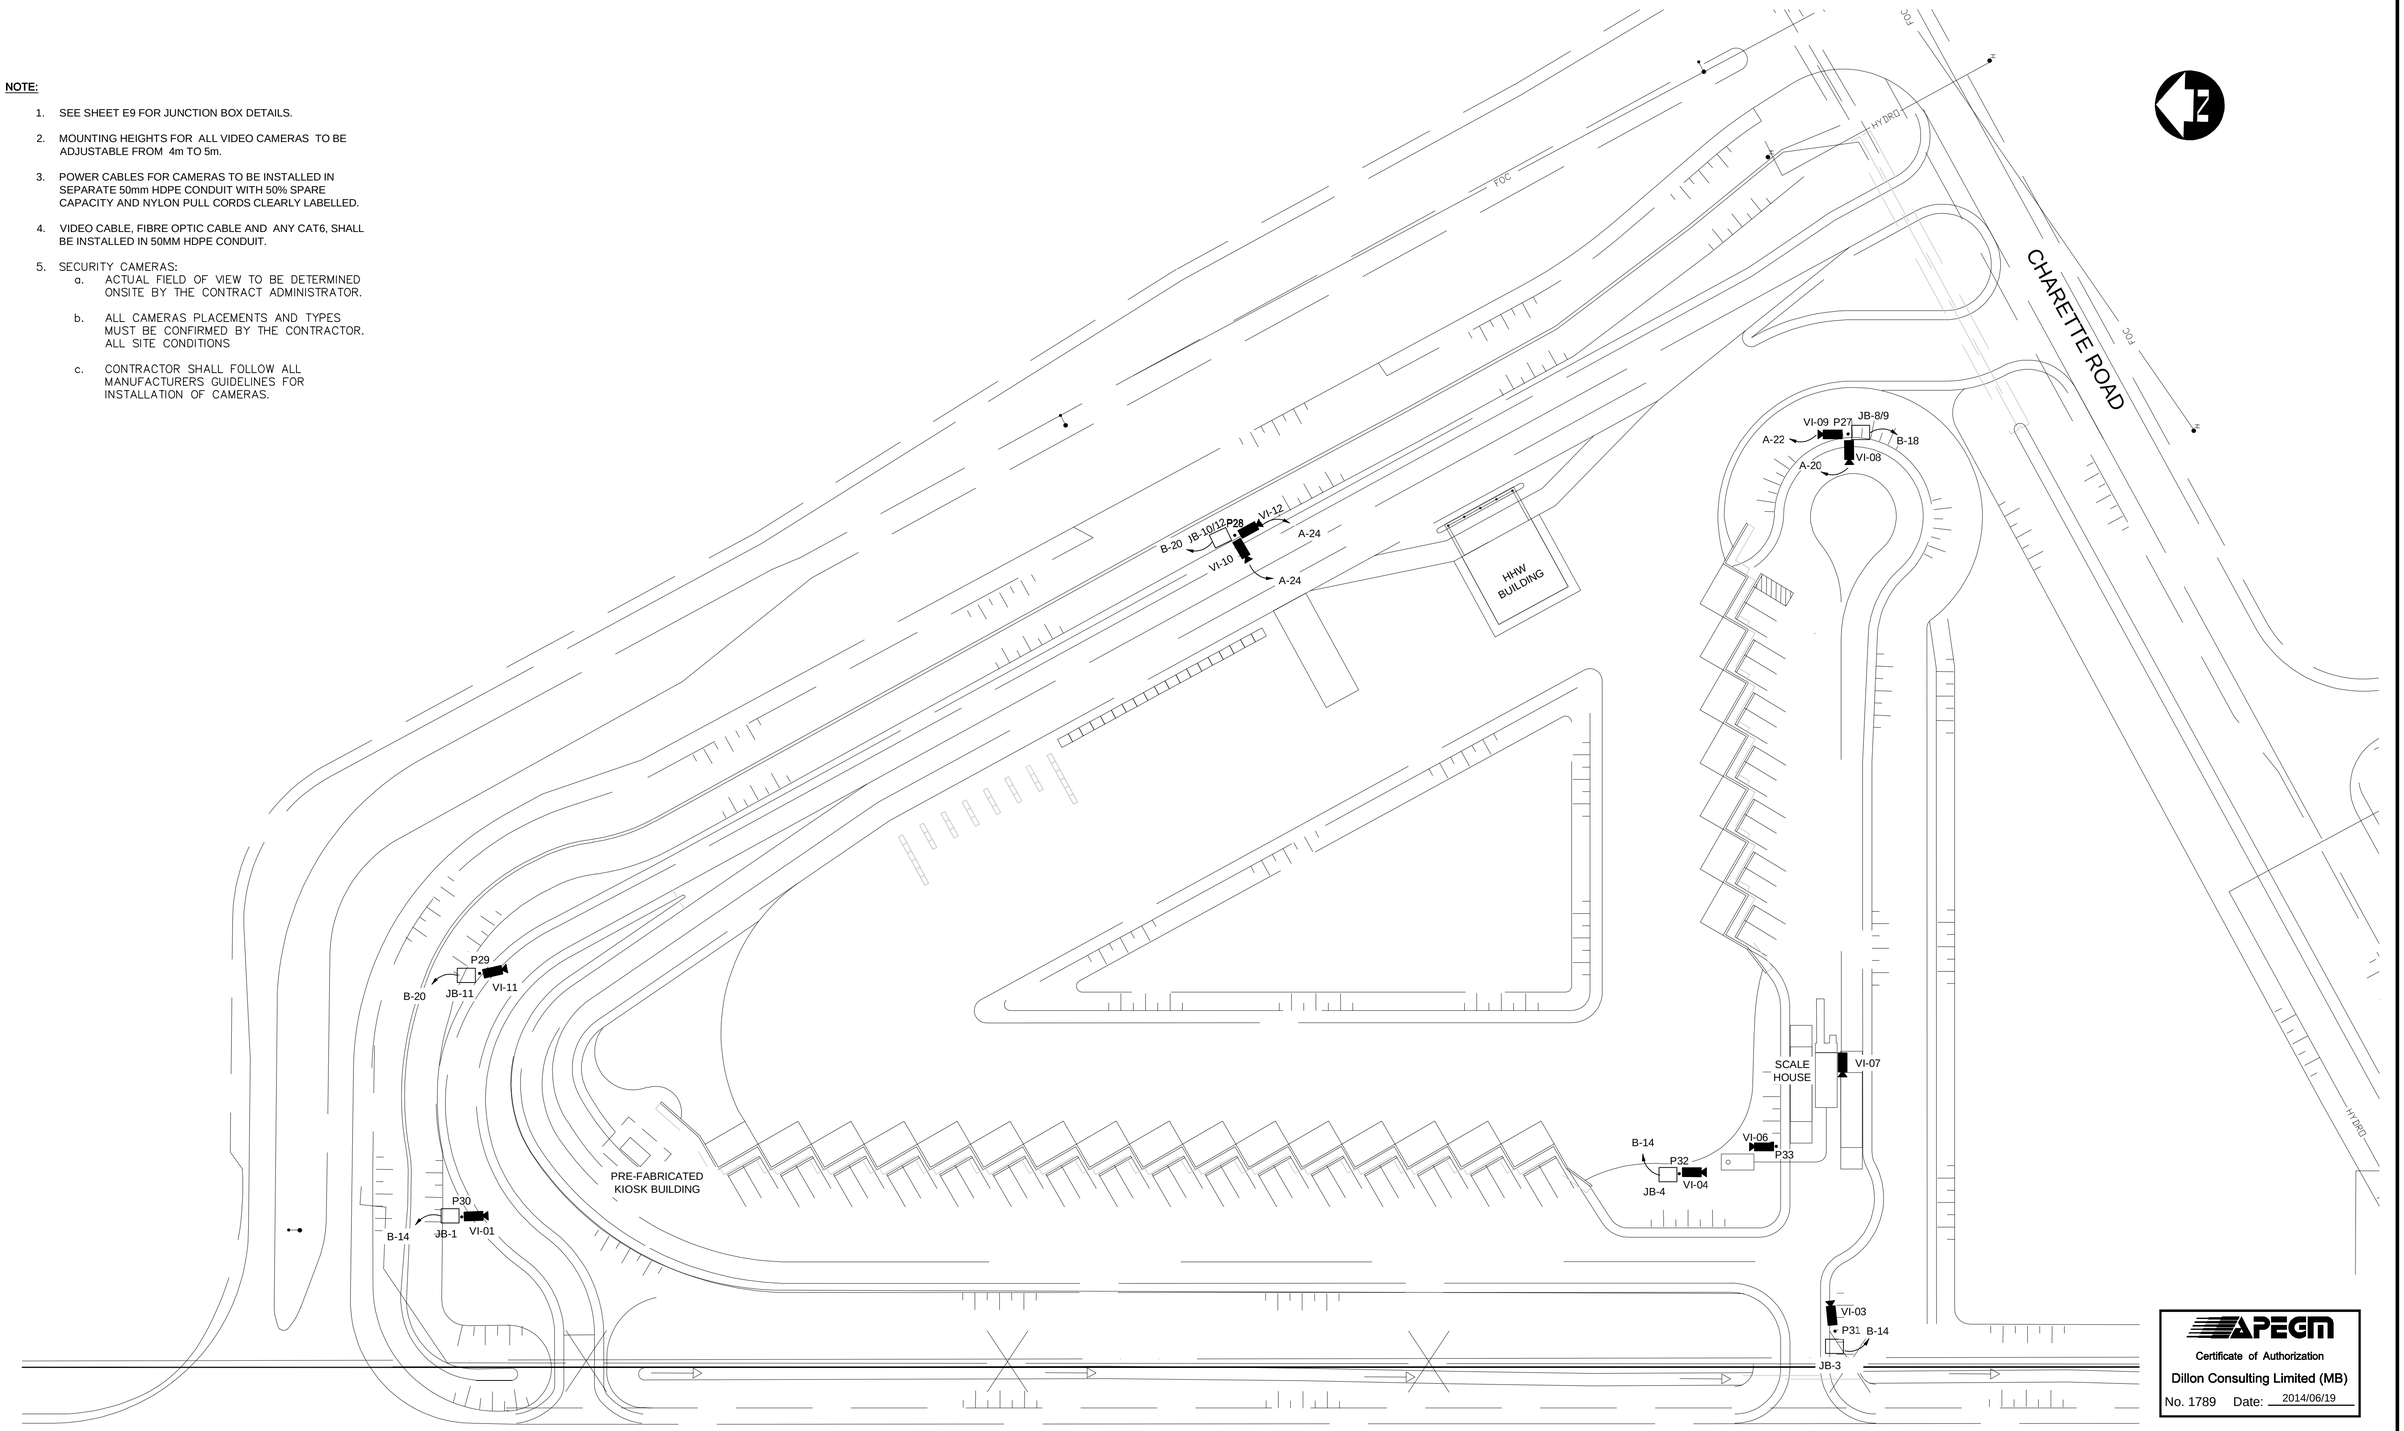

APEGM
Certificate of Authorization
Dillon Consulting Limited (MB)
No. 1789 Date: 2014/06/19

METRIC

WHOLE NUMBERS INDICATE MILLIMETRES
DECIMALIZED NUMBERS INDICATE METRES

SITE PLAN - SECURITY CAMERA LAYOUT
1:500

NO.	REVISIONS	DATE	BY
B	ISSUED FOR 100% REVIEW	14/05/30	ARR
A	ISSUED FOR 90% REVIEW	14/03/25	ARR

B.M. ELEV.

DESIGNED BY JAD
DRAWN BY MS
CHECKED BY BM
APPROVED BY ARR
HOR. SCALE 1:500
VERTICAL
DATE MARCH 2014

DILLON CONSULTING

RELEASED FOR CONSTRUCTION
DATE

ENGINEER'S SEAL
PROVINCE OF MANITOBA
ORIGINAL STAMPED BY
B.L. MOORE
2014/06/19
REGISTERED PROFESSIONAL ENGINEER

CONSULTANT PROJECT NUMBER
13-8224

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

4R WINNIPEG DEPOT
BRADY ROAD RESOURCE
MANAGEMENT FACILITY

CITY DRAWING NUMBER
1-0400A-E0007-001

SHEET 32 OF 35

SITE PLAN SECURITY CAMERAS LAYOUT

CONSULTANT DRAWING NUMBER
E7

G:\CAD\DFS\138224\04-Electrical\01-Contract\138224-04-ELEC-CON.dwg