

FROM TSDC-FU15
(NOTE 1)
24 VDC

FROM TSDC-C15
(NOTE 1)
0 VDC

SCADAPAK EXTERNAL
5605 I/O MODULE
16-PT DISCRETE
OUTPUT

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE

SPARE



SPARE

SPARE

SPARE

CONNECTOR (P5)

CONNECTOR (P6)

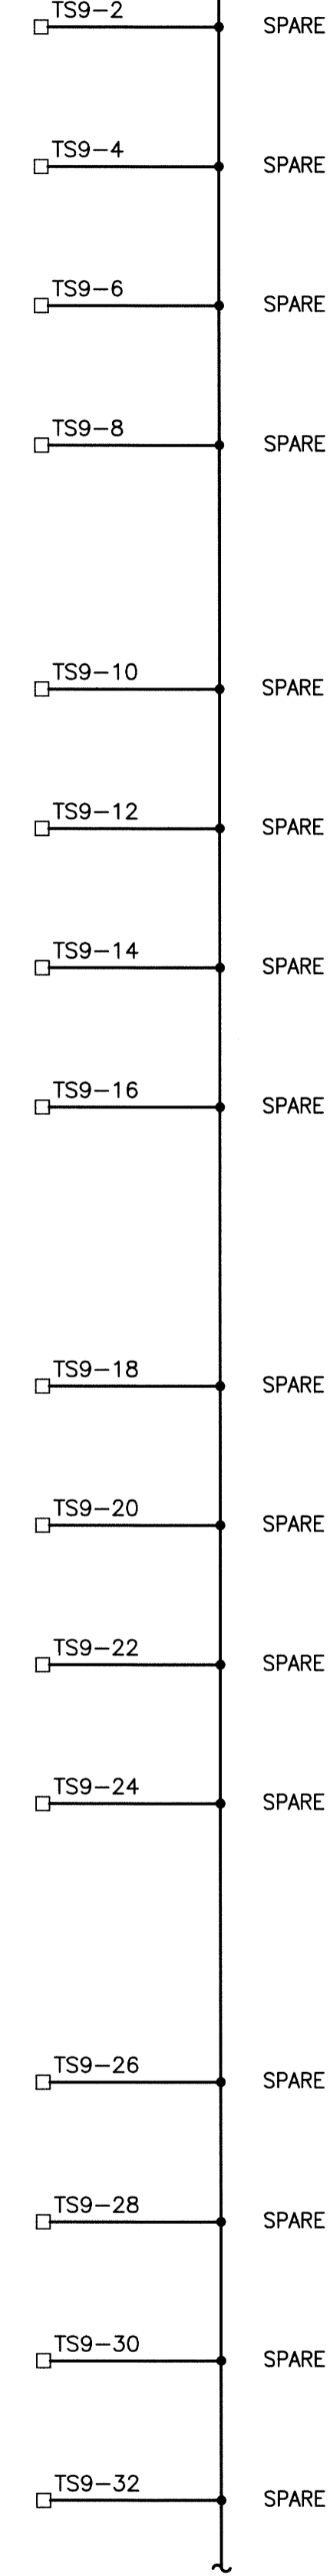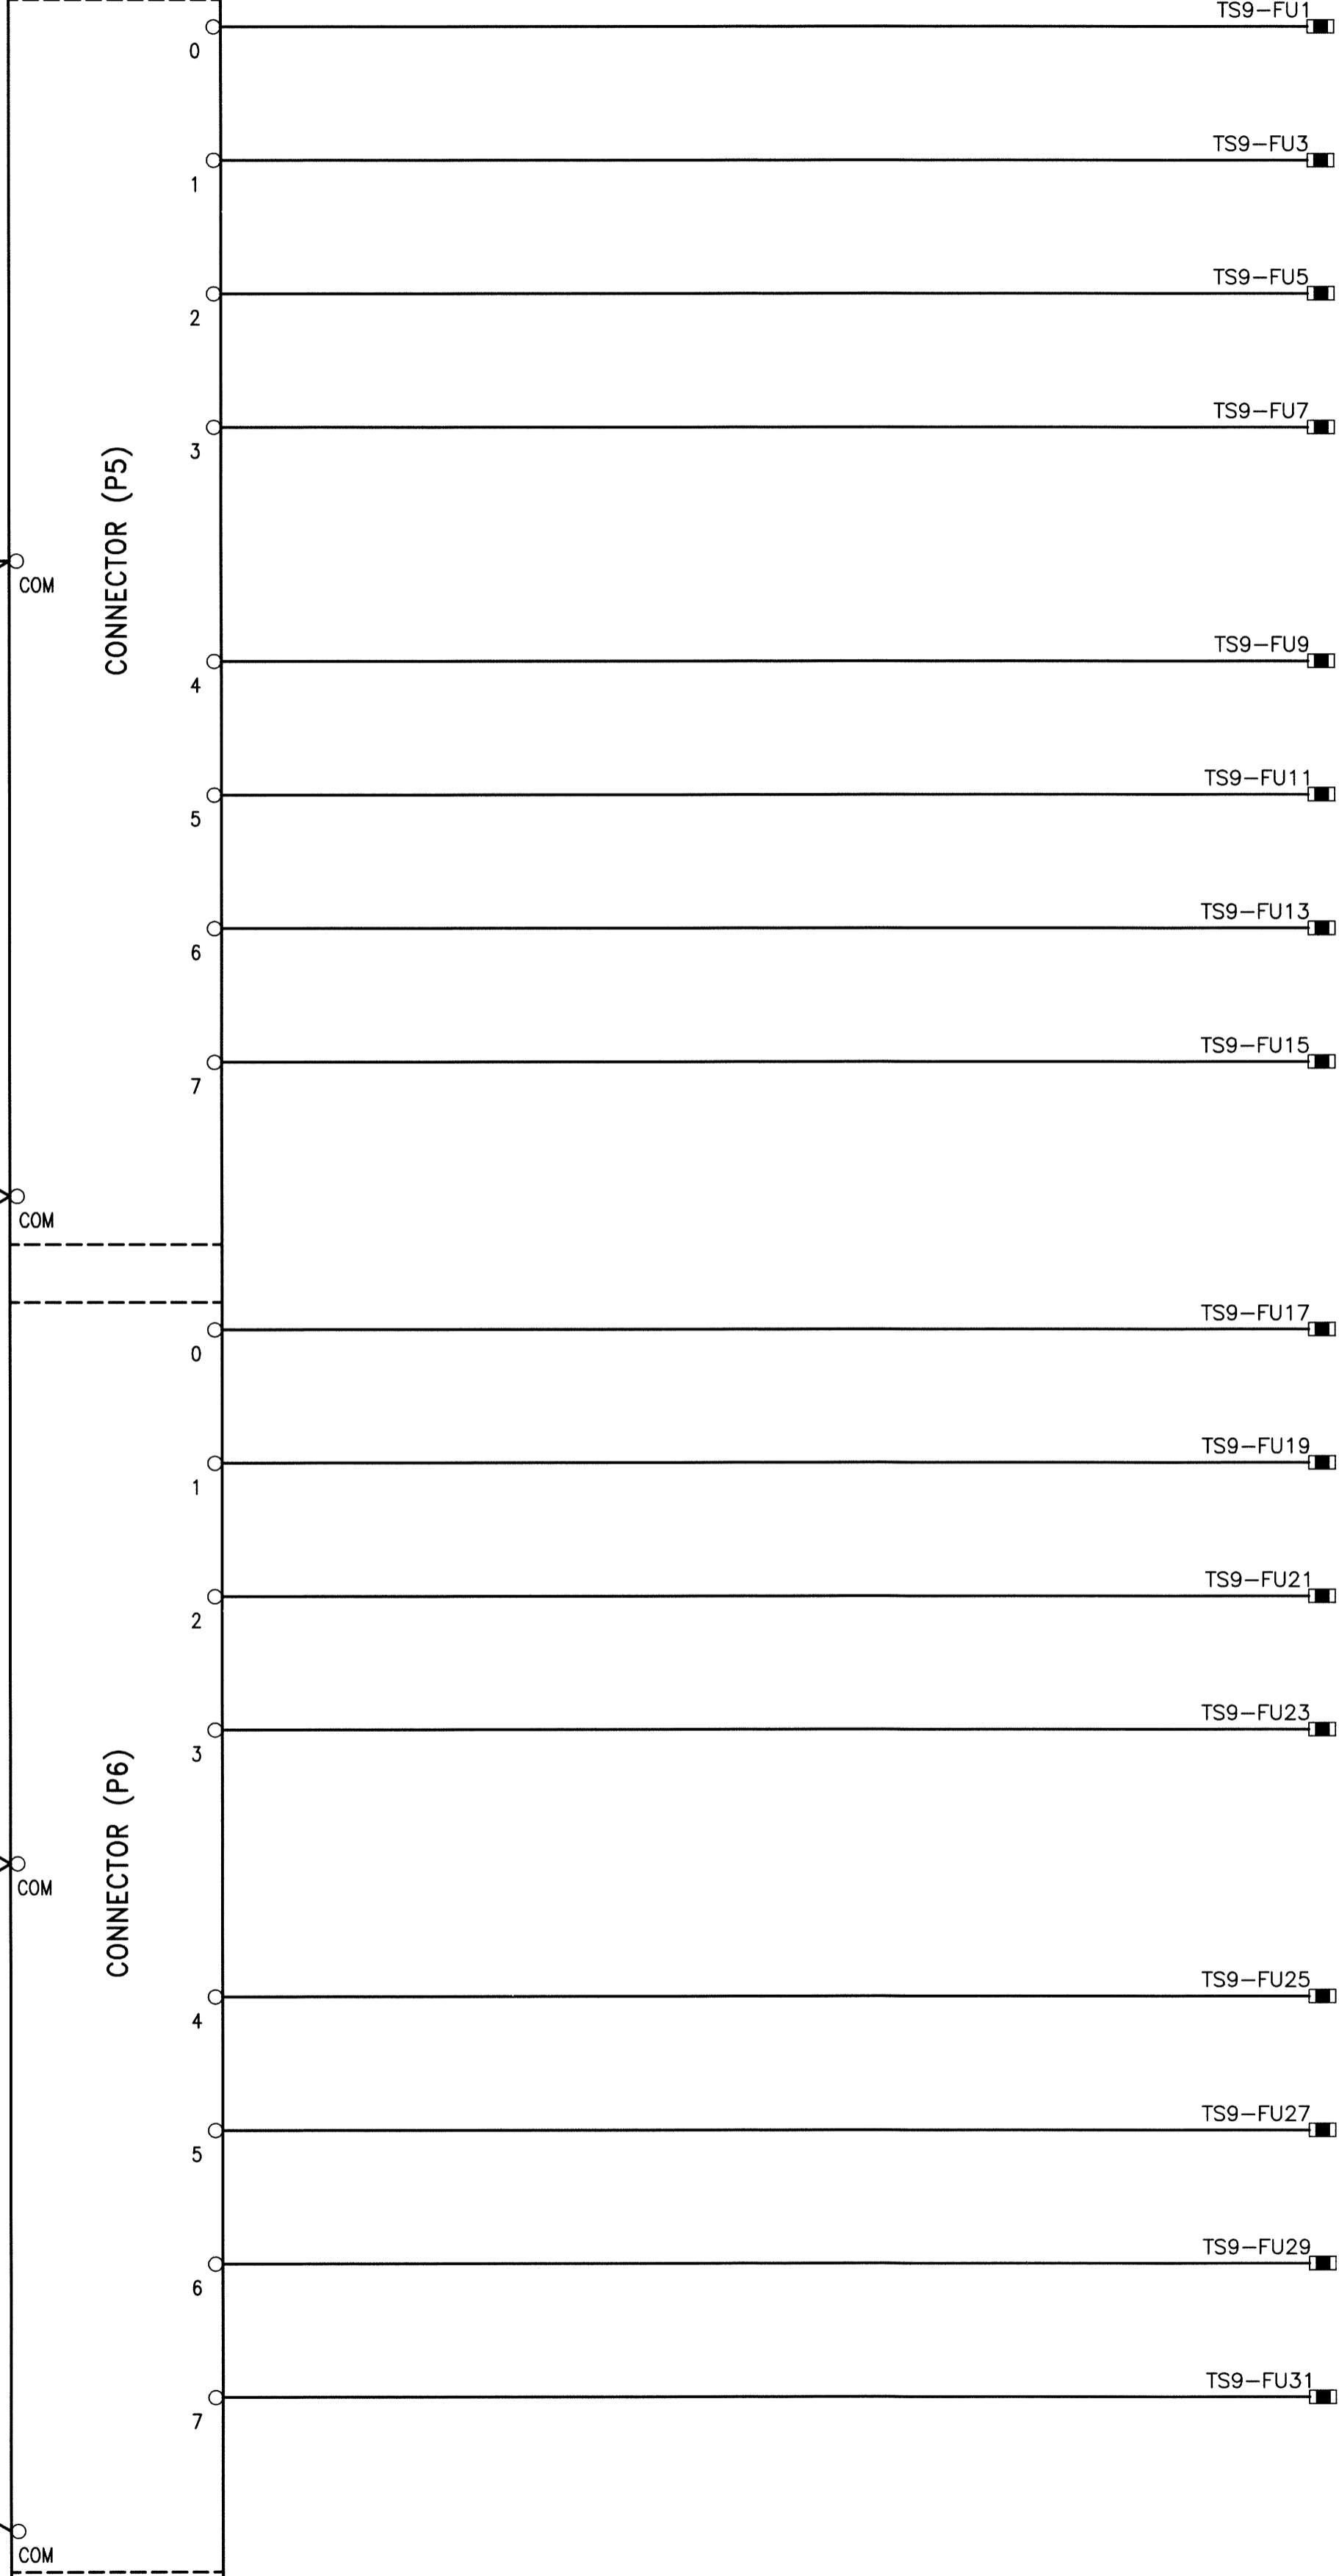

NOTES:

1. REFER TO DRAWING 1-0159F-E0011-001 (M-E21.1) FOR ADDITIONAL DETAILS.

LEGEND:

- PANEL WIRING
- - - FIELD WIRING
- RTU TERMINAL
- FUSED TERMINAL

Filename: P:\Projects\2013\13-0107-026\Draw\Elec\13-0107-026-M-E35.dwg - Tab: E35 Plotted By: cderoche 08/19/2014 [Tue 8:30am]



FIELD BOOK #:	
POSTED TO LBIS	
NO.	REVISIONS
0	ISSUED FOR CONSTRUCTION
	DATE
	BY

DESIGNED BY	DDW/MAM	CHECKED BY	
DRAWN BY	GCN	APPROVED BY	
HOR. SCALE	N.T.S.	RELEASED FOR CONSTRUCTION	
VERTICAL			
DATE	2014.01.17	DATE	

ENGINEER'S SEAL

M-E35

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

FLOOD PUMPING STATION UPGRADES
MARION STATION
ELECTRICAL
RTU PANEL - 5605 I/O BOARD NO.2
DISCRETE OUTPUTS

SHEET 1 OF 1
CITY DRAWING NUMBER
1-0159F-E0022-001