


FROM 24 VDC
POWER SUPPLY
24 VDC
(NOTE 1)

FROM 24VDC
POWER SUPPLY
0 VDC
(NOTE 1)

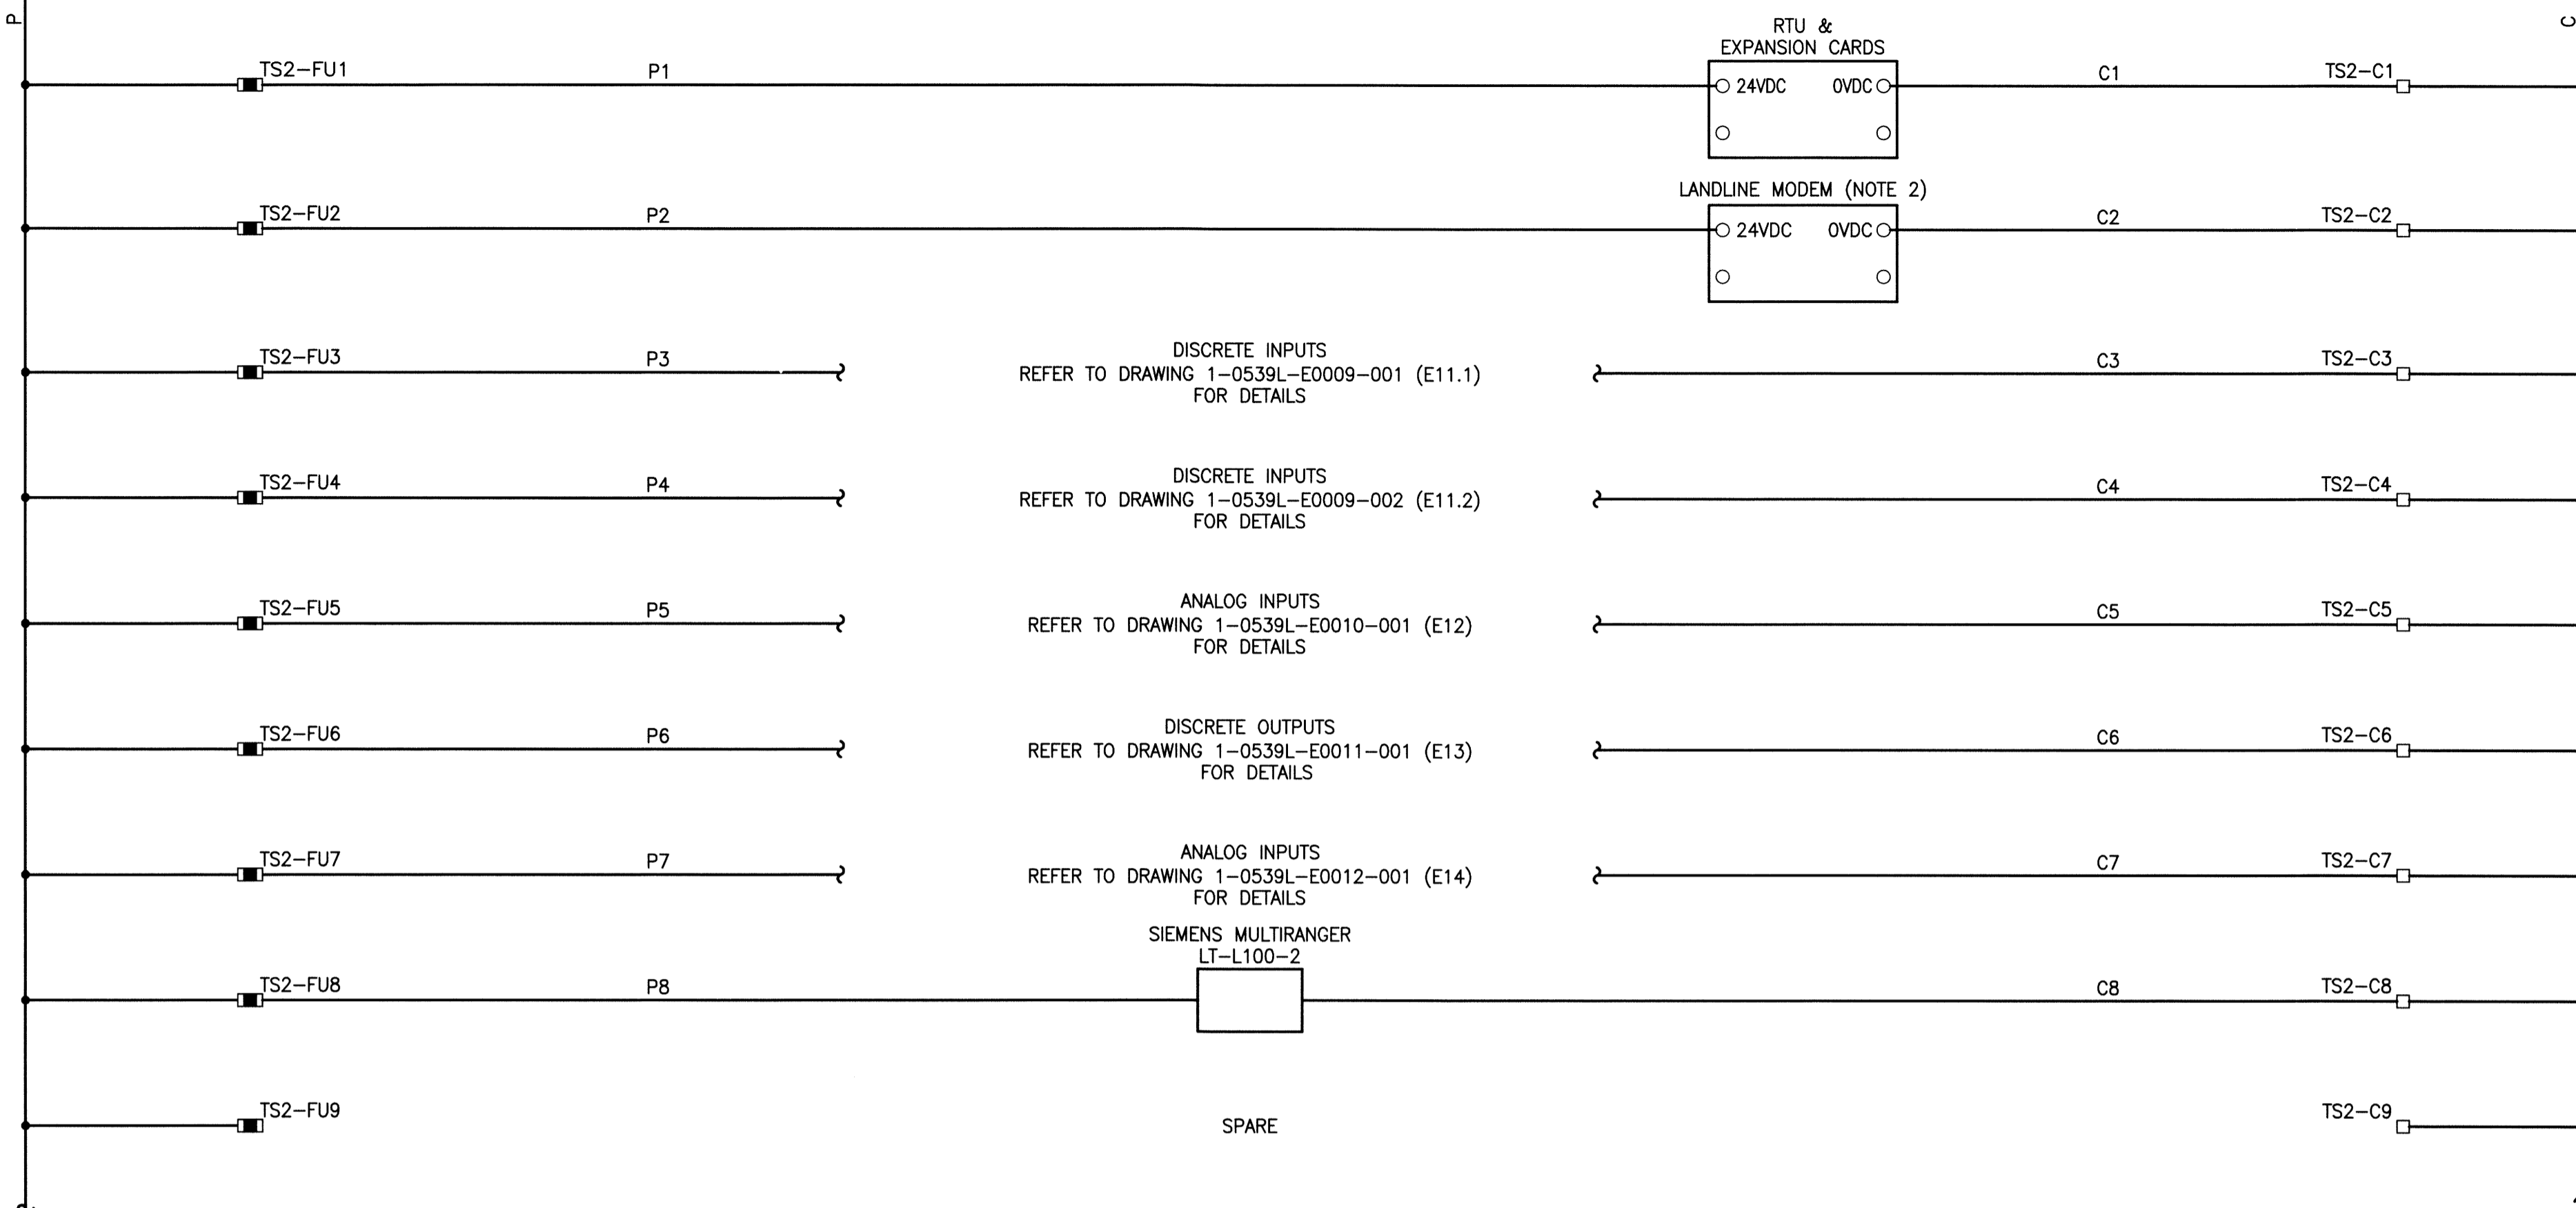


NOTES:

- REFER TO DRAWING 1-0539L-E0008-001 (E10) FOR ADDITIONAL DETAILS.
- LANDLINE MODEM SHALL BE A PHOENIX CONTACT PSI-DATA/FAX-MODEM/RS232 (PART No.2708203). PROVIDE RS-232 DATA CABLE BETWEEN RTU AND MODEM.

LEGEND:

- RTU TERMINAL
- ⊗ FIELD DEVICE TERMINAL
- FUSED TERMINAL
- PANEL WIRING
- - - - - FIELD WIRING

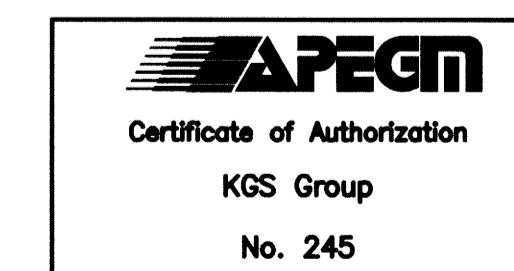

NO.	REVISIONS	DATE	BY
0	ISSUED FOR TENDER	14/10/14	gms

DESIGNED BY	SEB	CHECKED BY	gms
DRAWN BY	GCN	APPROVED BY	
HDR. SCALE	N.T.S.	RELEASED FOR CONSTRUCTION	
DATE	2014 06 28	DATE	

ENGINEER'S SEAL

E09

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

LEE BOULEVARD OUTLET CHAMBER UPGRADES
LEE BOULEVARD
ELECTRICAL
RTU PANEL
24VDC POWER AND FUSE DISTRIBUTION

SHEET 1 OF 1
CITY DRAWING NUMBER
1-0539L-E0007-001