


FILE NAME: 14-0107-021_E15A1 DATE: 2014.10.27 PROJECT TITLE: MEZZANINE FLOOR LIGHTING SHEET No: 2013-173 ADDRESS: 381 SHERBROOK STREET

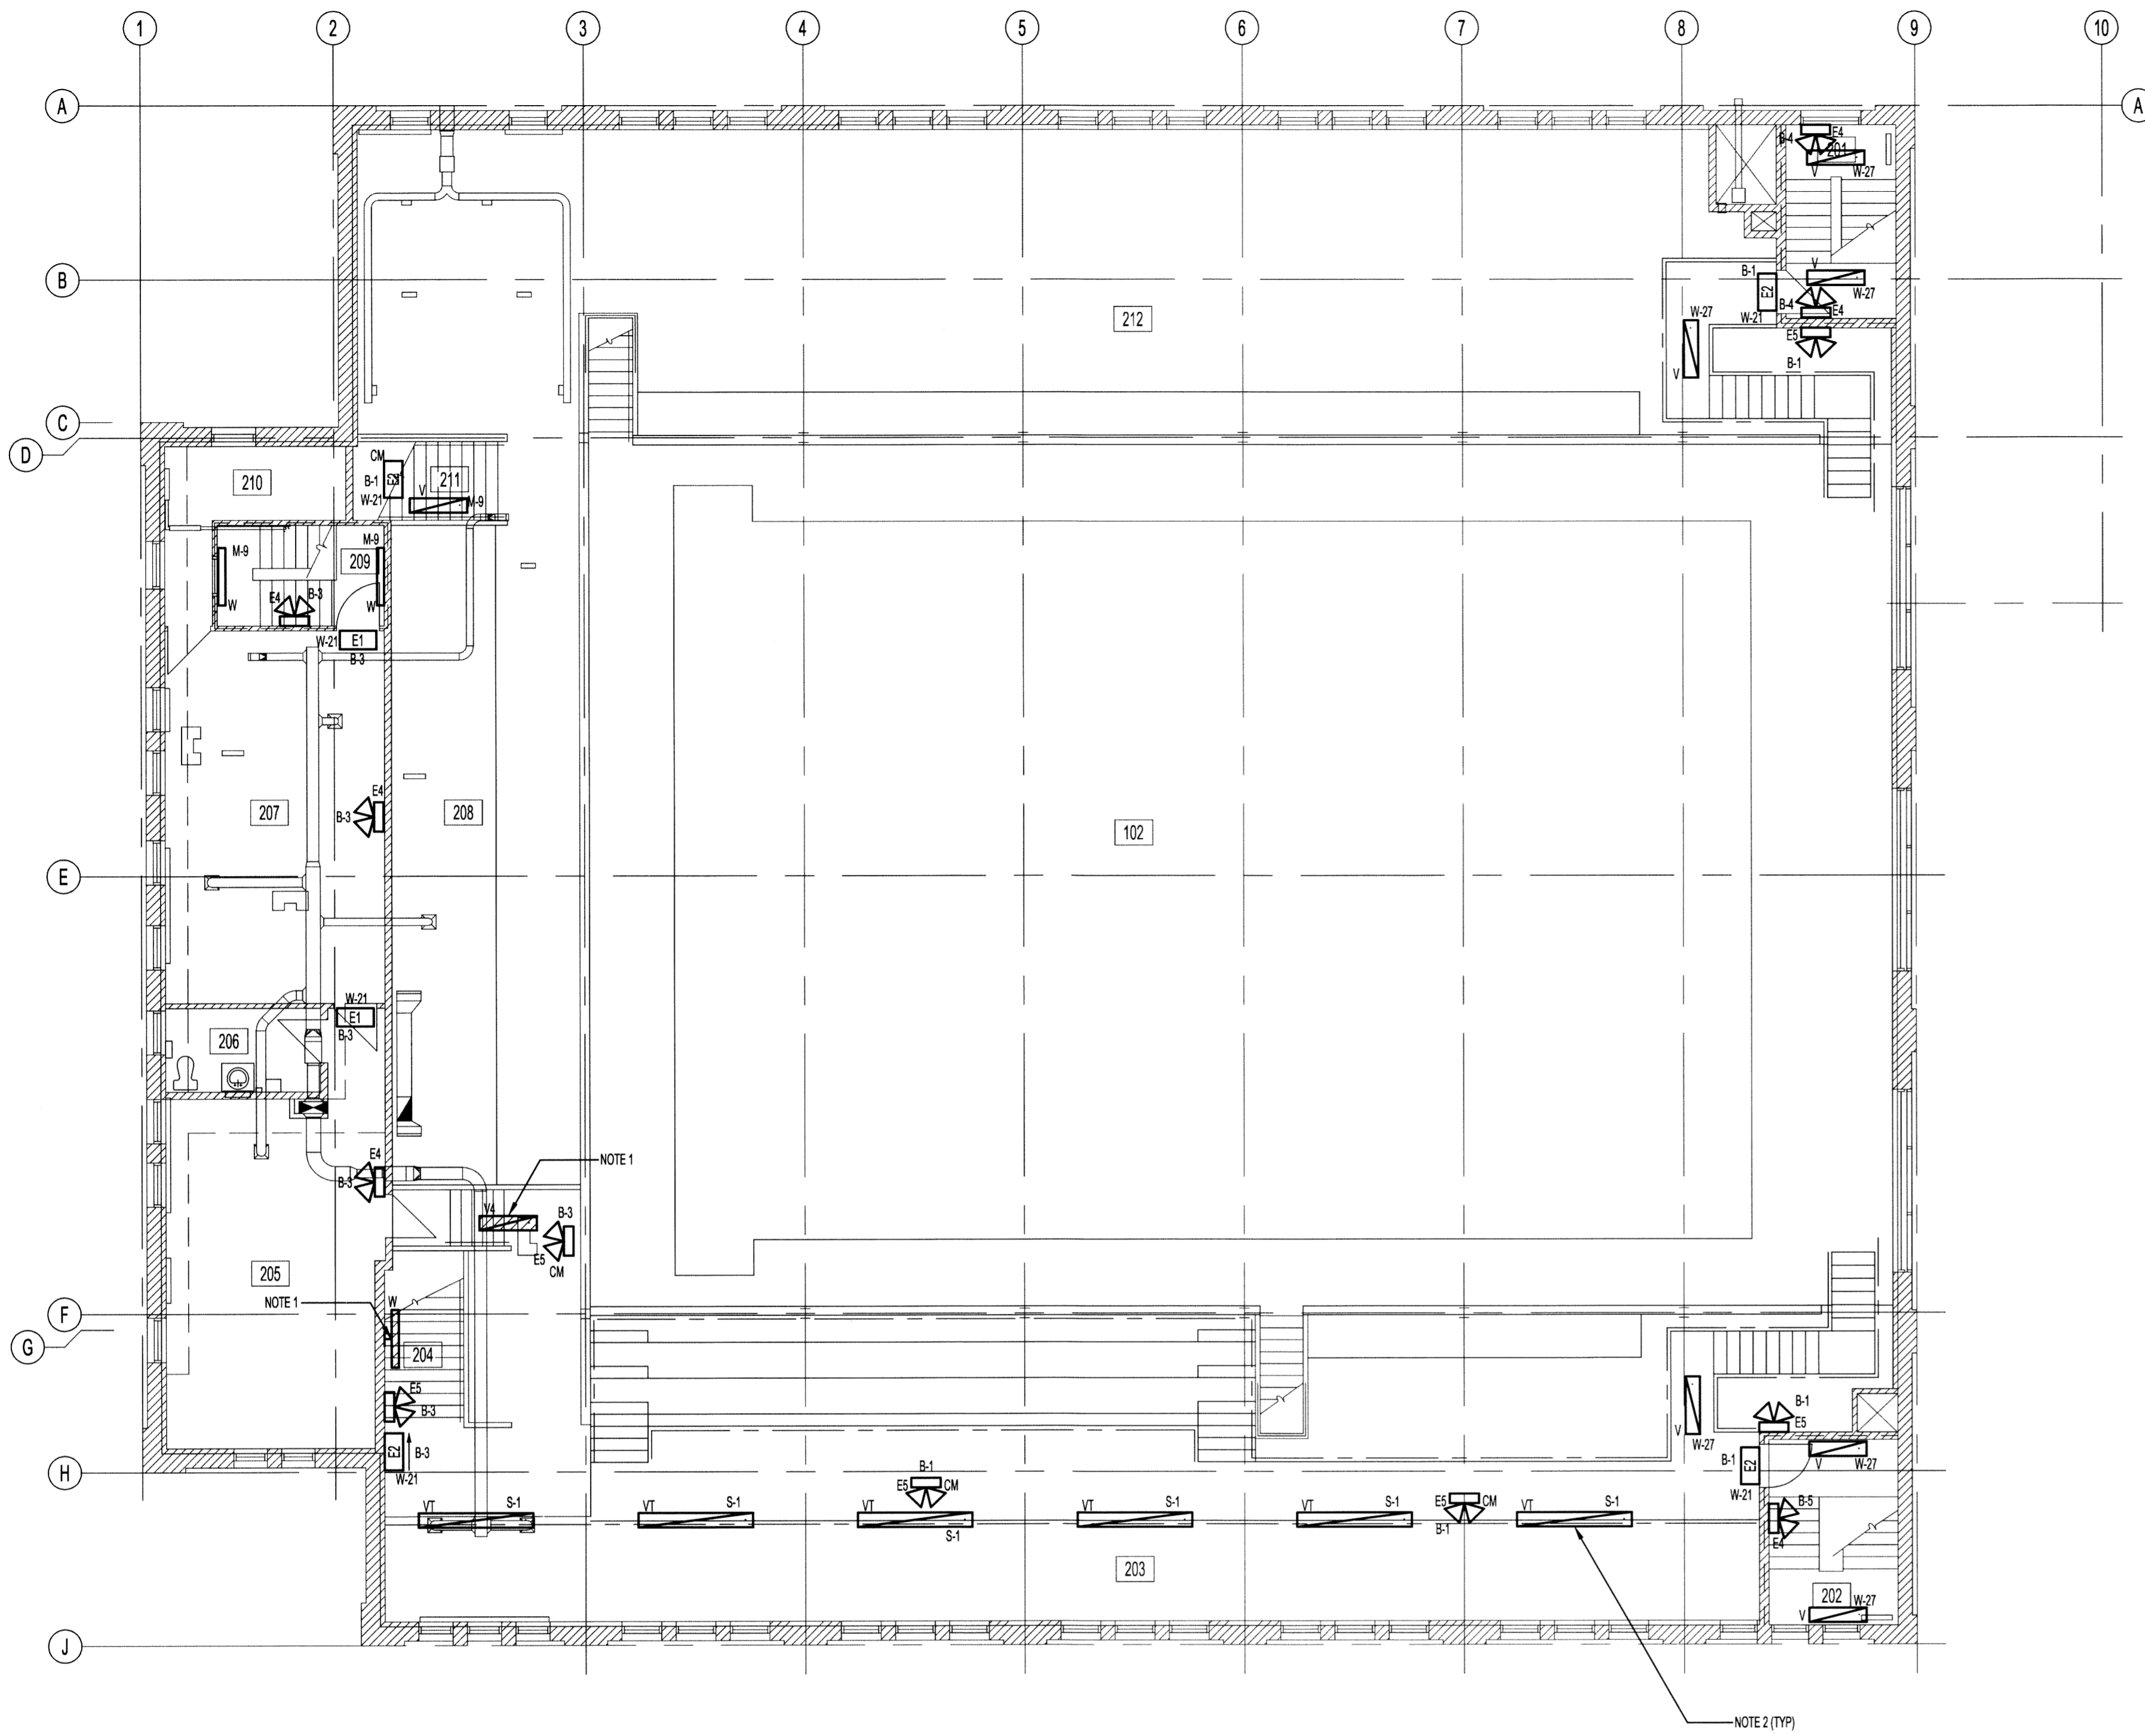

MEZZANINE FLOOR PLAN - LIGHTING
SCALE: 1/8"=1'-0"

ELECTRICAL NOTES:

1. TIE IN THE NEW LIGHTS INTO THE EXISTING LOCAL NIGHT LIGHTING CIRCUIT. CONTRACTOR TO VERIFY THE LOAD ON THE EXISTING CIRCUIT PRIOR TO CONNECTING THE NEW LOAD.
2. CHAIN MOUNT VAPOUR TIGHT FIXTURES 10'-0" ABOVE THE WALKWAY DECK. ALL SUSPENSION HARDWARE SHALL BE STAINLESS STEEL (316).

NOTES:

THESE DRAWINGS SHALL NOT BE SCALED.

THE CONTRACTOR SHALL VISIT THE SITE AND SATISFY ONESELF ALL DIMENSIONS, DATUM, AND DETAILED INFORMATION SHOWN ARE CORRECT.

THE CONTRACTOR IS TO REVIEW AND COORDINATE ALL ARCHITECTURAL, MECHANICAL, ELECTRICAL AND STRUCTURAL DRAWINGS FOR ADDITIONAL OPENINGS THROUGH FLOORS, WALLS, AND CEILINGS FOR DUCT, PIPE & ELECTRICAL RISERS AND ALL OPENINGS NOT SHOWN ON DRAWINGS.

ALL OPENINGS THROUGH FIRE ASSEMBLIES ARE TO BE FIRE STOPPED AND SEALED WITH ULC APPROVED FIRE STOPPING TO MAINTAIN THE INTEGRITY OF THE FIRE SEPARATION, AND PROVIDE A SMOKE-TIGHT BARRIER.

ALL PRODUCTS AND MATERIALS TO BE USED AND INSTALLED SHALL CONFORM WITH MANUFACTURER'S SPECIFICATIONS & APPLICABLE CODES.

THE CONTRACTOR SHALL BE RESPONSIBLE TO PATCH AND MAKE GOOD ALL EXISTING CONSTRUCTION AFFECTED BY THE REMOVAL OF ALL ITEMS FORMING THE PART OF THE RENOVATION WORK.


WHERE NEW FLOORING AND BASE IS TO BE INSTALLED IN EXISTING AREAS (REFER TO FLOOR PLAN AND ROOM SCHEDULE) THE EXISTING FLOORING SURFACE AND BASE MUST BE REMOVED, UNLESS OTHERWISE NOTED. ALL FLOOR SURFACES SHALL BE PREPARED IN ACCORDANCE TO MANUFACTURER'S RECOMMENDATIONS FOR INSTALLATION OF NEW FLOOR.

WHERE PAINTING OF EXISTING WALLS IS INDICATED ON THE ROOM SCHEDULE, THESE WALLS MUST BE CLEANED OF ANY EXISTING WALL COVERING, PATCHED & PREPARED TO ACCEPT NEW MATERIAL, UNLESS OTHERWISE NOTED.

GENERAL CONSTRUCTION NOTES:

1. ALL NEW WIRING SHALL BE RUN IN NEW CONDUIT.
2. ALL PENETRATIONS THROUGH FIRE SEPARATIONS SHALL BE FIRE STOPPED. FOR ALL FIRE STOPPING, CONTRACTOR SHALL ENSURE THE WALL RATING IS MAINTAINED.
3. VERIFY LOAD ON EXISTING CIRCUITS PRIOR TO CONNECTION OF NEW LOADS.

LEGEND:

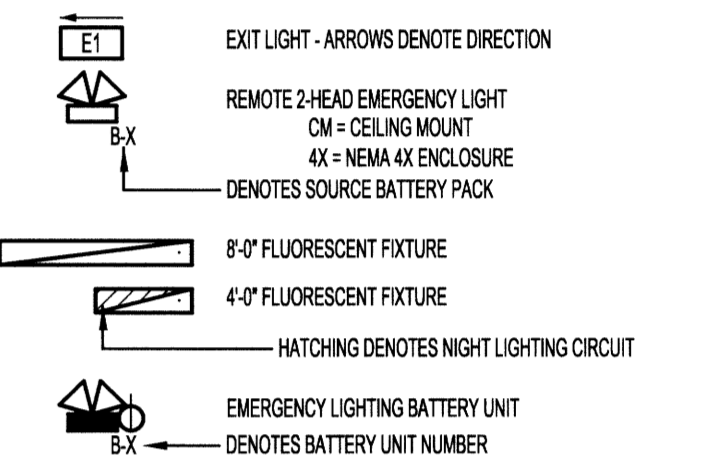

No.	REVISION/DESCRIPTION	BY	DATE
0	ISSUED FOR CONSTRUCTION	UL	15.02.17

SEAL

2015-02-15

DRAWN	GCN	CHECKED	DESIGNED	CLS	APPROVED
DATE	2014.10.27	USER	APPROVAL		

THE CITY OF WINNIPEG
PLANNING, PROPERTY AND
DEVELOPMENT DEPARTMENT
MUNICIPAL ACCOMMODATIONS DIVISION
3-65 GARRY STREET, R3C 4K4

PROJECT
**SHERBROOK POOL
REFURBISHMENT OF SHERBROOK POOL**

381 SHERBROOK STREET
SHEET TITLE

**ELECTRICAL
MEZZANINE FLOOR PLAN
LIGHTING**

SCALE	PROJECT No:	SHEET No:
AS SHOWN	2013-173	E15

