D SIZE 22" x 34" (559mm x 864mm)

PLOT: 4/9/2015 2:03:23 PM

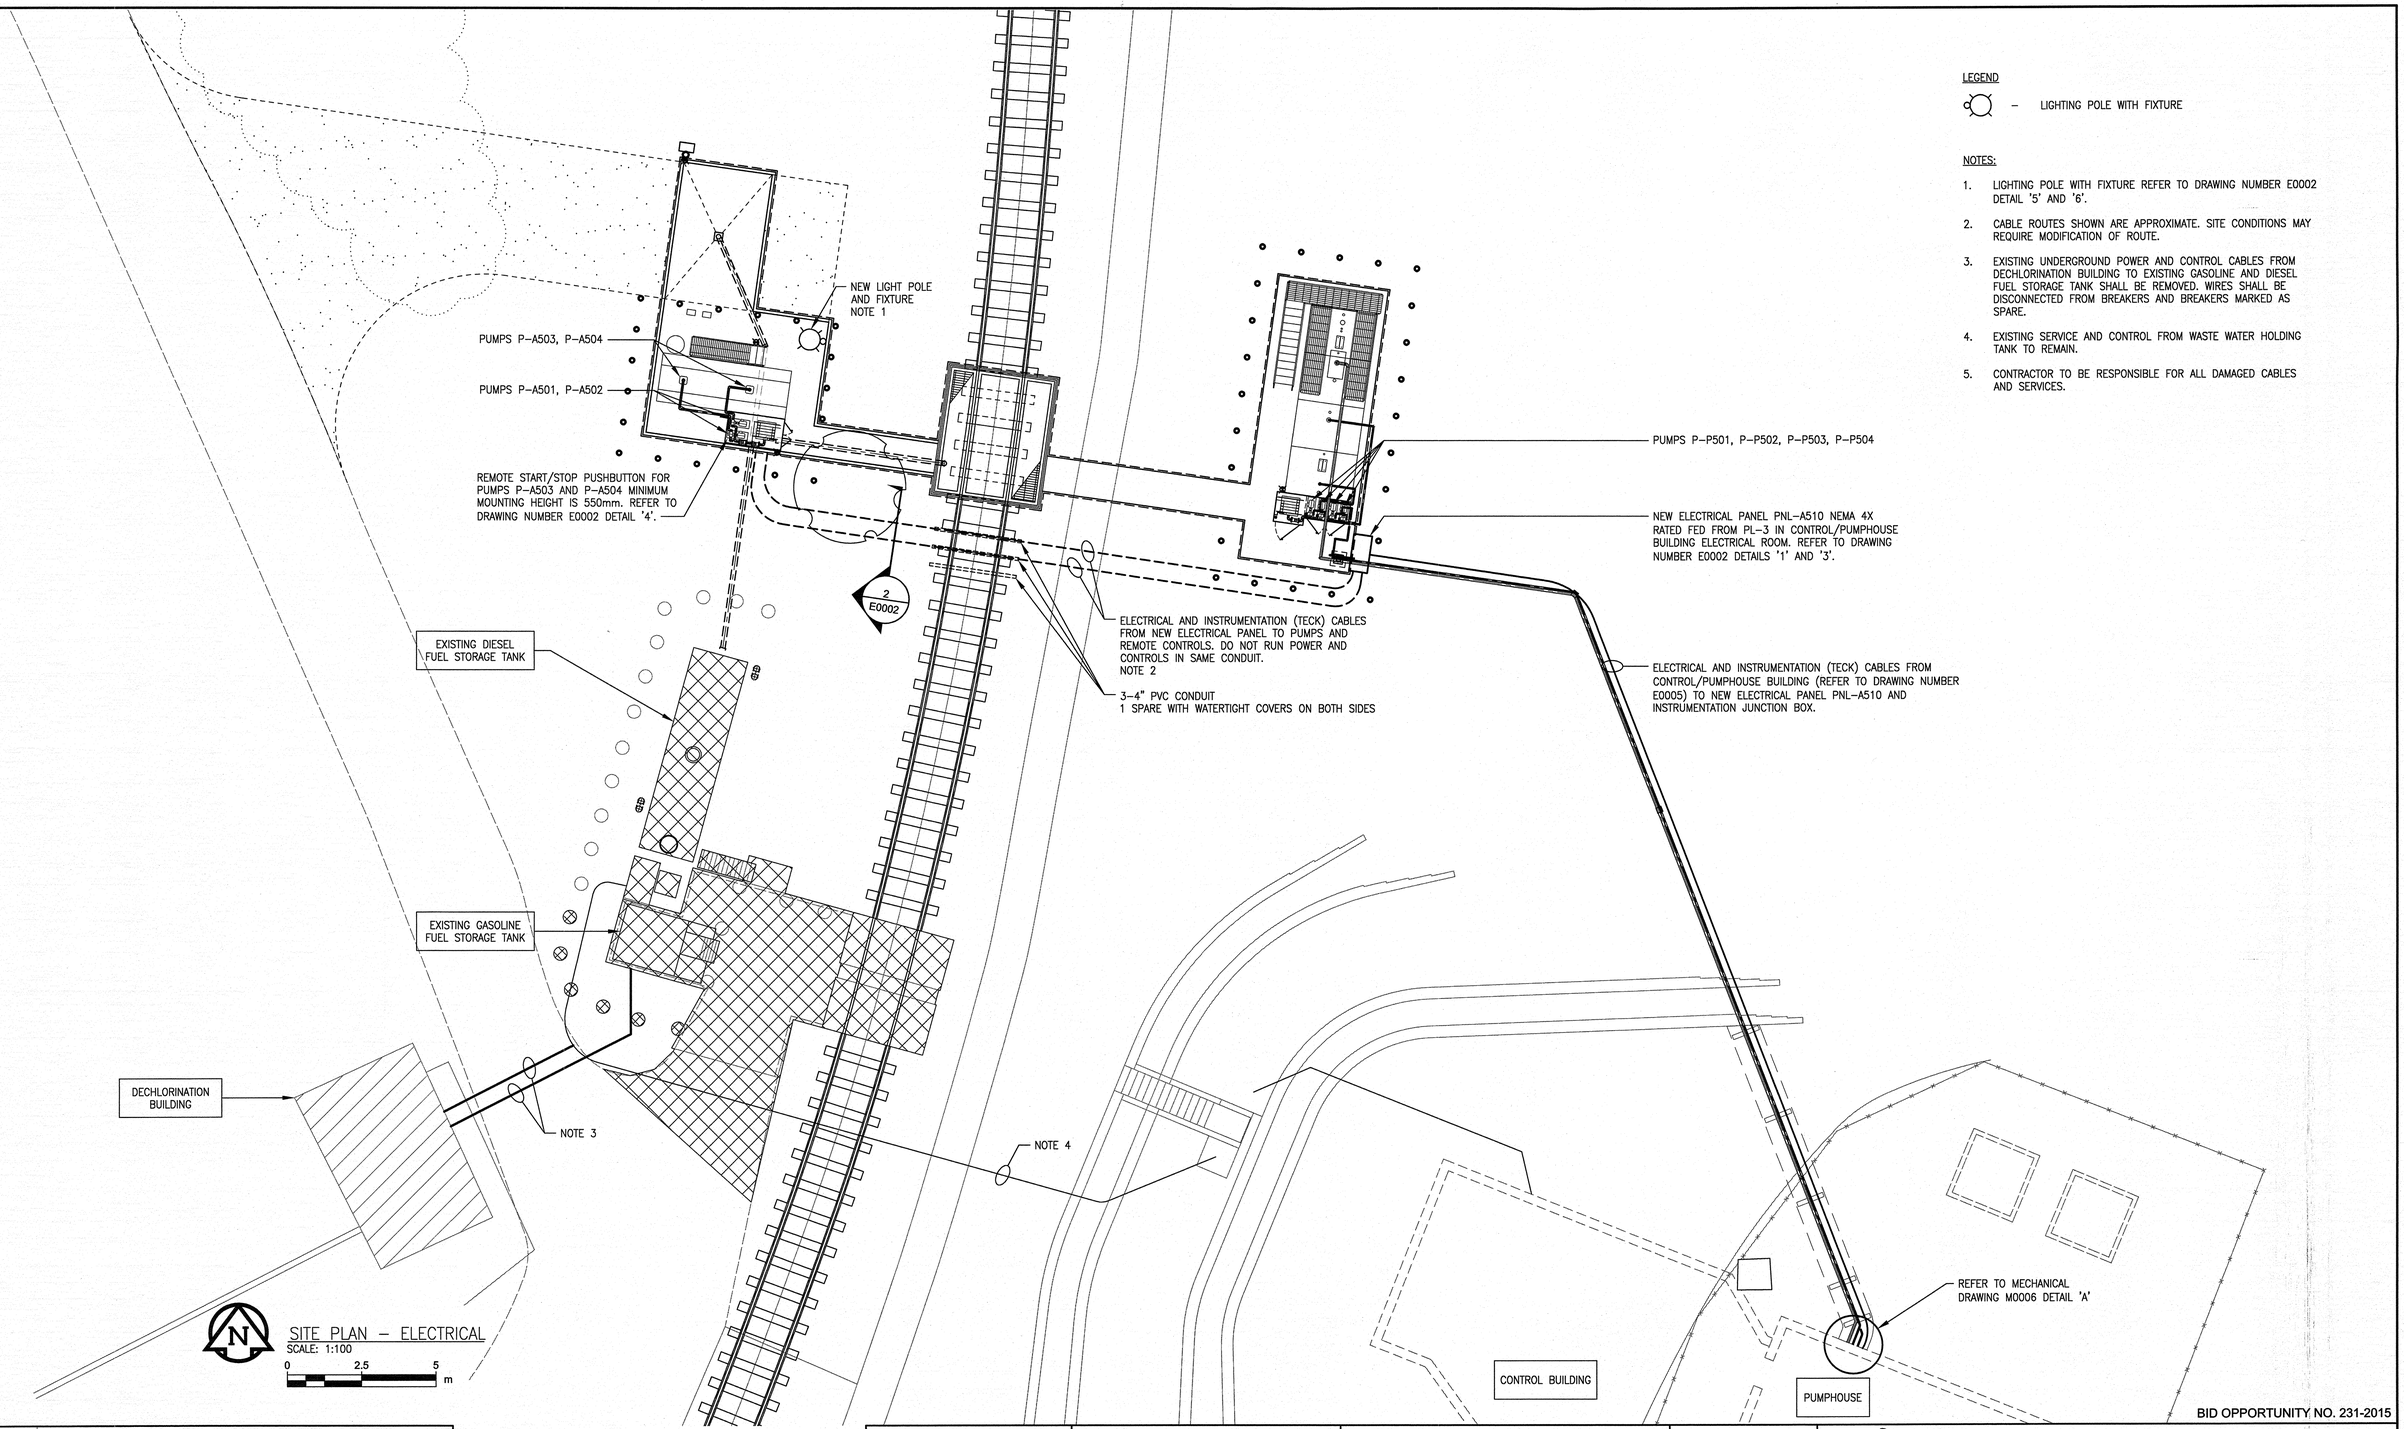

LEGEND

– LIGHTING POLE WITH FIXTURE

NOTES:

1. LIGHTING POLE WITH FIXTURE REFER TO DRAWING NUMBER E0002 DETAIL '5' AND '6'.
2. CABLE ROUTES SHOWN ARE APPROXIMATE. SITE CONDITIONS MAY REQUIRE MODIFICATION OF ROUTE.
3. EXISTING UNDERGROUND POWER AND CONTROL CABLES FROM DECHLORINATION BUILDING TO EXISTING GASOLINE AND DIESEL FUEL STORAGE TANK SHALL BE REMOVED. WIRES SHALL BE DISCONNECTED FROM BREAKERS AND BREAKERS MARKED AS SPARE.
4. EXISTING SERVICE AND CONTROL FROM WASTE WATER HOLDING TANK TO REMAIN.
5. CONTRACTOR TO BE RESPONSIBLE FOR ALL DAMAGED CABLES AND SERVICES.

BID OPPORTUNITY NO. 231-2015

AECOM REVIEW | DRFT CHK

AECOM FILE NAME: E0001.dwg Saved By: chavezr

DRAWING NUMBER	REFERENCE DRAWINGS

APEGM
Certificate of Authorization
AECOM Canada Ltd.
No. 4671 Date: Apr 09, 2015

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPR. U/G STRUCTURES COMMITTEE DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

NO.	REVISIONS	YY/MM/DD	BY
0	ISSUED FOR TENDER, BID OPP. 231-2015	15/04/13	RC

AECOM

DESIGNED BY	RB	CHECKED BY	
DRAWN BY	RC	APPROVED BY	
HOR. SCALE	1:100	RELEASED FOR CONSTRUCTION	
VERT. SCALE			
DATE		DATE	

PROFESSIONAL'S SEAL
PROVINCE OF MANITOBA
Roman Bogdanovich
R. BOGDANOVICH
Apr 09 2015
Member
33564
REGISTERED PROFESSIONAL ENGINEER

CONSULTANT DRAWING NO.
E0001

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SHOAL LAKE
INTAKE FUEL STORAGE AND
DELIVERY SYSTEM REHABILITATION
ELECTRICAL
SITE PLAN

SHEET 18 OF 23

CITY DRAWING NUMBER | REV
1-0600A-E0001-001 | 0