D SIZE 22" x 34" (559mm x 864mm)

PLOT: 4/9/2015 12:01:05 PM

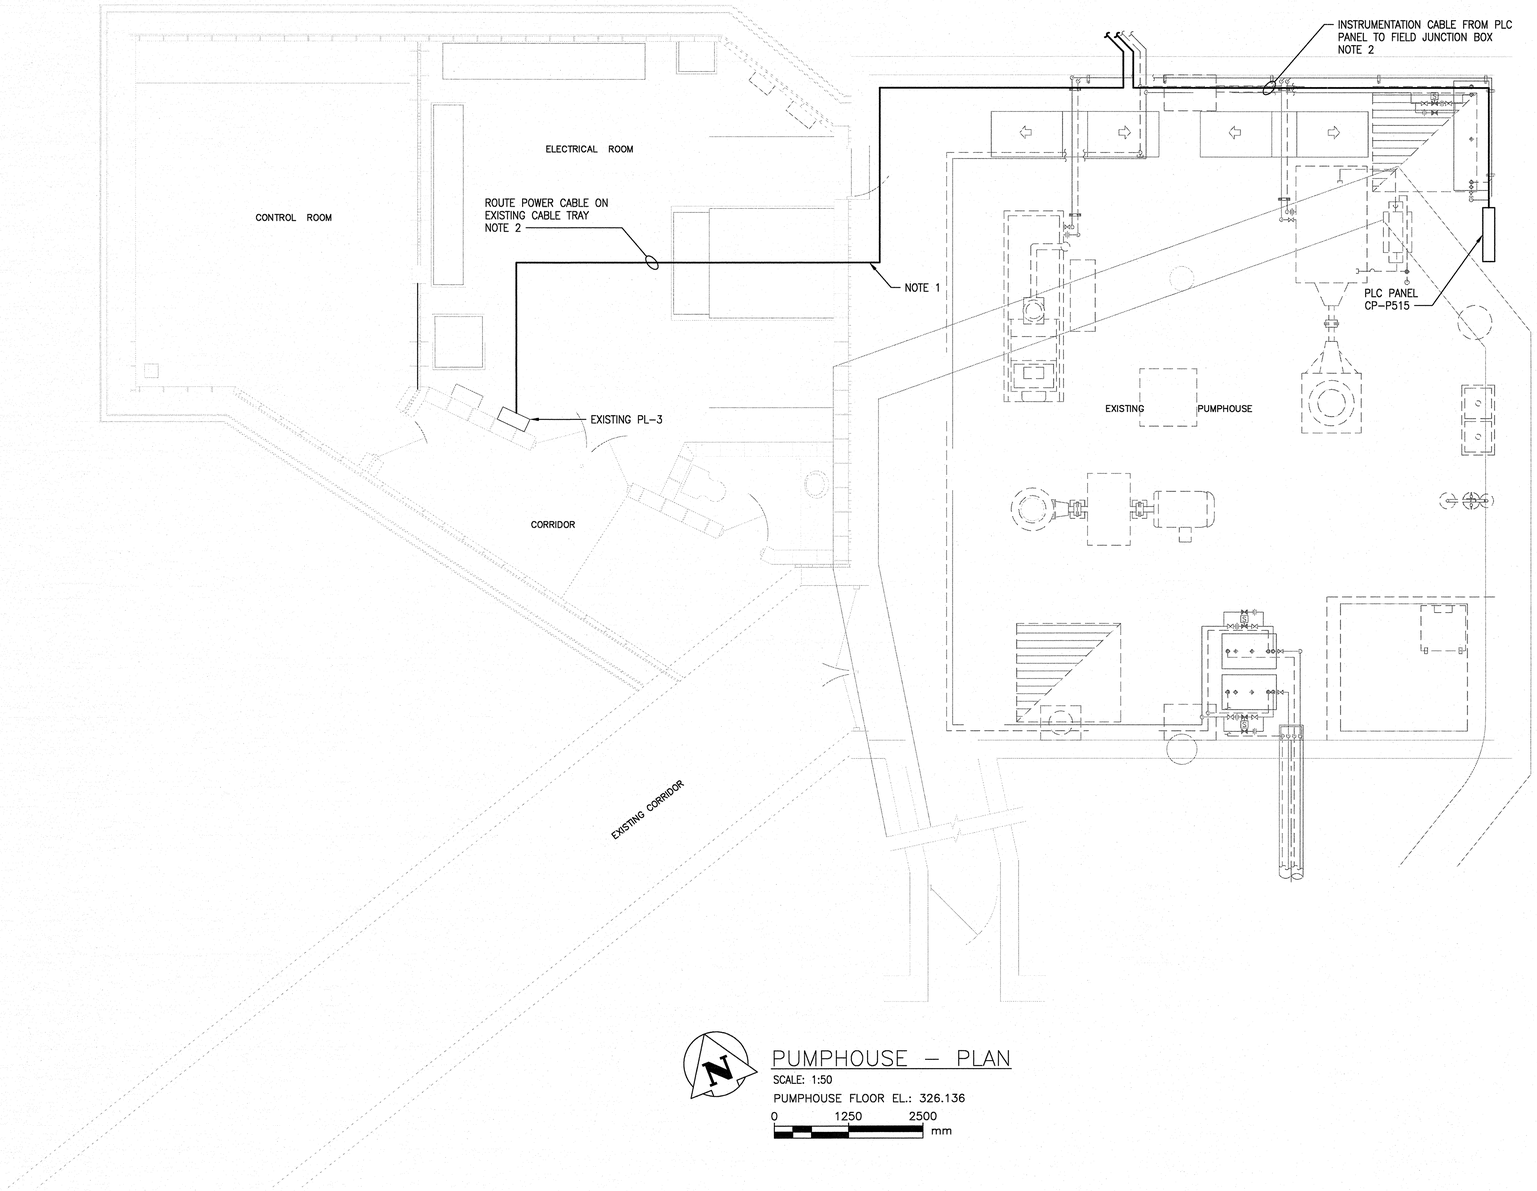

NOTES:

1. SEAL ALL WALL PENETRATIONS.
2. ROUTING OF CABLES SHOWN APPROXIMATELY, WILL BE DETERMINED ON SITE. RUN CABLES IN EXISTING TRAY WHERE SPACE IS AVAILABLE. RUN REMAINING CABLES ON CEILING WITH APPROPRIATE SUPPORTS AND SPACING.

PUMPHOUSE – PLAN

SCALE: 1:50

PUMPHOUSE FLOOR EL.: 326.136

0 1250 2500 mm

BID OPPORTUNITY NO. 231-2015

AECOM REVIEW | DRFT CHK

AECOM FILE NAME: E0005.dwg Saved By: chavezr

DRAWING NUMBER	REFERENCE DRAWINGS

Certificate of Authorization

AECOM Canada Ltd.

No. 4671 Date: Apr 09, 2015

LOCATION APPROVED
UNDERGROUND STRUCTURES

SUPR. U/G STRUCTURES COMMITTEE DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

NO.	REVISIONS	YY/MM/DD	BY
0	ISSUED FOR TENDER, BID OPP. 231-2015	15/04/13	RC

AECOM

DESIGNED BY	KM	CHECKED BY	
DRAWN BY	RC	APPROVED BY	
HOR. SCALE	AS NOTED	RELEASED FOR CONSTRUCTION	
VERT. SCALE			
DATE		DATE	

PROFESSIONAL'S SEAL
PROVINCE OF MANITOBA
R. BOGDANOV
Member
33564
REGISTERED PROFESSIONAL ENGINEER
Roman Bogdanov P.Eng. Apr 09, 2015

CONSULTANT DRAWING NO.
E0005

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SHOAL LAKE
INTAKE FUEL STORAGE AND DELIVERY SYSTEM REHABILITATION
ELECTRICAL
PUMPHOUSE
PLAN

SHEET 22 OF 23

CITY DRAWING NUMBER 1-0600A-E0005-001

REV 0