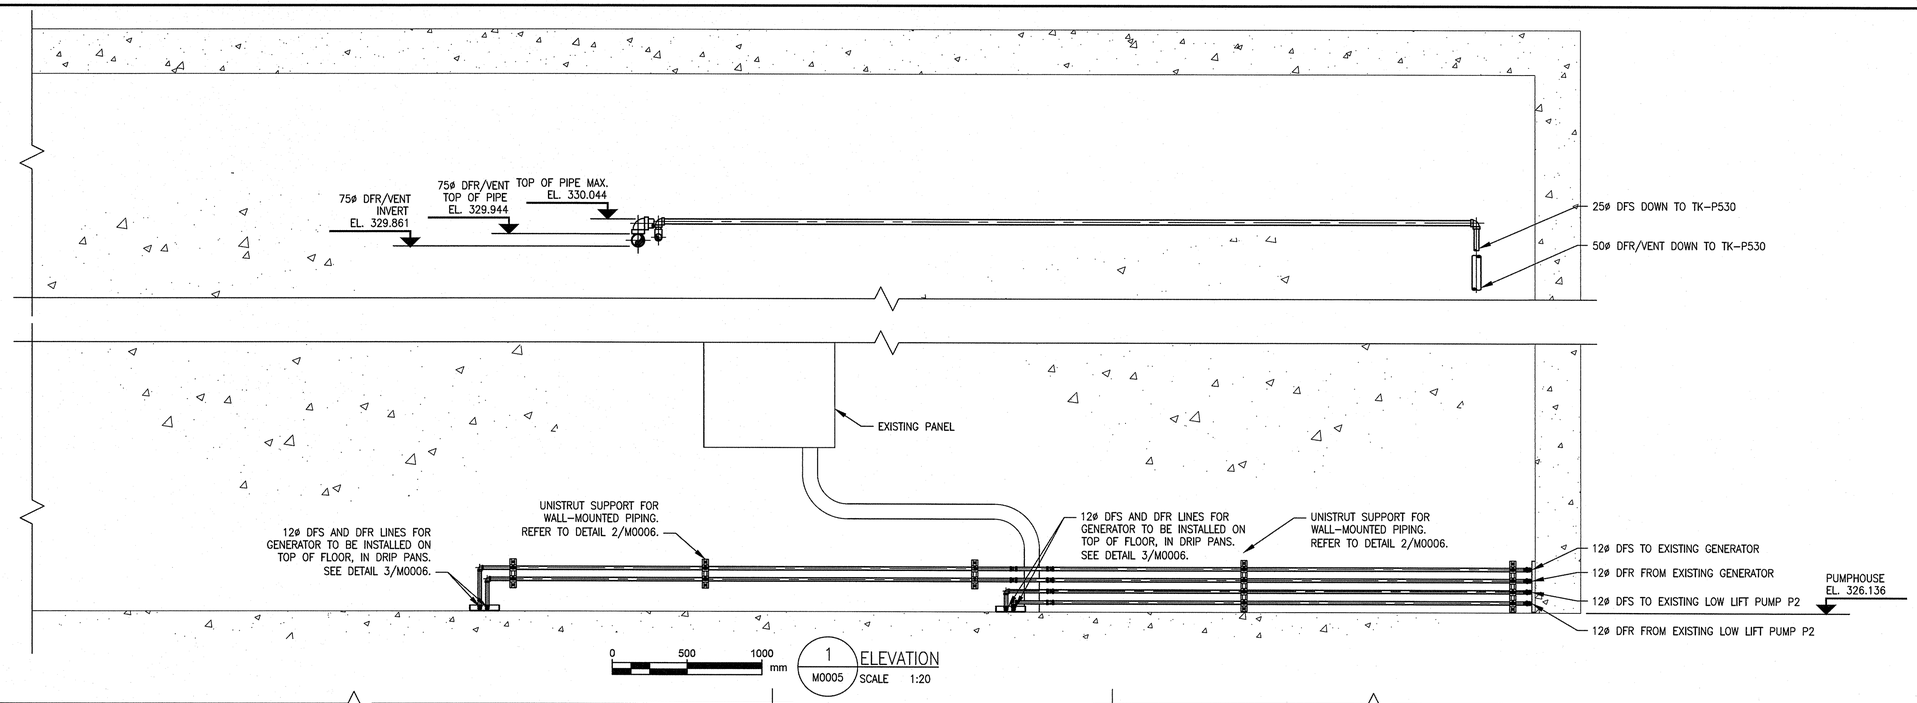

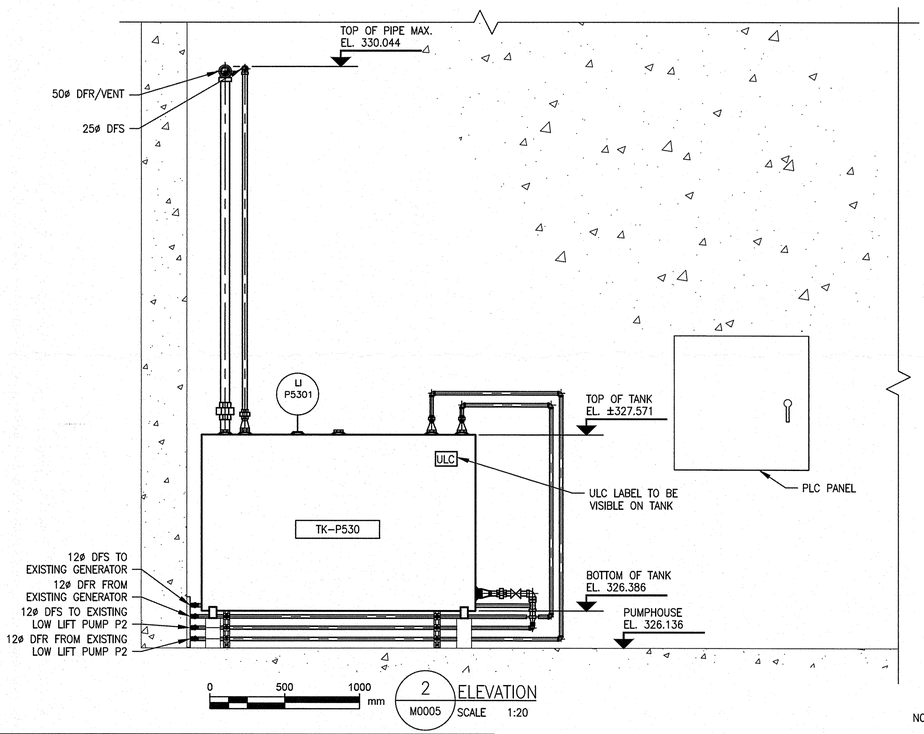

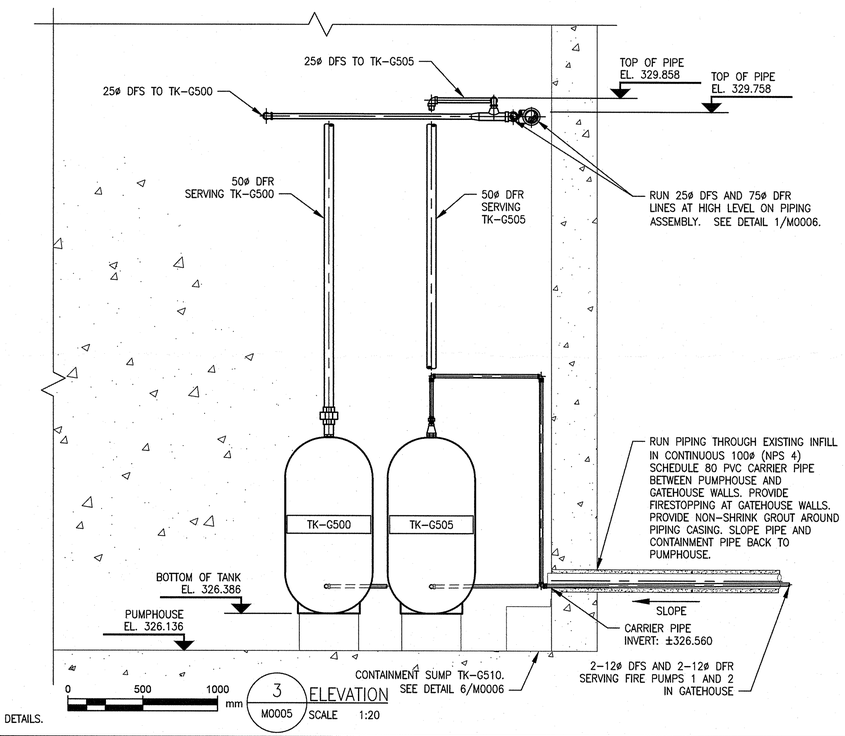

GENERAL NOTES

1. CONTRACTOR SHALL COORDINATE ALL SHUTDOWNS WITH THE CITY. SHUTDOWNS SHALL BE COORDINATED IN ADVANCE DURING PROGRESS MEETINGS. A MINIMUM OF 3 WORKING DAYS ARE REQUIRED. THE CITY MAY RESCHEDULE SHUTDOWN TO ACCOMMODATE OPERATIONAL REQUIREMENTS. THIS WOULD INCLUDE BUT NOT BE LIMITED TO FUEL SYSTEMS, WATER SYSTEMS, ELECTRICAL SYSTEMS AND CONTROL SYSTEMS.
2. FIRE STOP ALL PENETRATIONS THROUGH WALLS. SECONDARY PIPE CASING TO BE FIRE STOPPED INTERNALLY AT THE UPSTREAM END.

NOTE: REFER TO SPECIFICATIONS 33 56 13 FOR TANK DETAILS.

BID OPPORTUNITY NO. 231-2015

DRAWING NUMBER	REFERENCE DRAWINGS

APEGM Certificate of Authorization
AECOM Canada Ltd.
No. 4671 Date: Apr 9/15

LOCATION APPROVED
UNDERGROUND STRUCTURES
SUPR. U/G STRUCTURES COMMITTEE — DATE

NOTE:
LOCATION OF UNDERGROUND STRUCTURES AS SHOWN ARE BASED ON THE BEST INFORMATION AVAILABLE. BUT NO GUARANTEE IS GIVEN THAT ALL EXISTING UTILITIES ARE SHOWN OR THAT THE GIVEN LOCATIONS ARE EXACT. CONFIRMATION OF EXISTENCE AND EXACT LOCATION OF ALL SERVICES MUST BE OBTAINED FROM THE INDIVIDUAL UTILITIES BEFORE PROCEEDING WITH CONSTRUCTION.

NO.	REVISIONS	YY/MM/DD	BY
0	ISSUED FOR TENDER, BID OPP. 231-2015	15/04/13	DRL

AECOM

DESIGNED BY	CC	CHECKED BY	GD
DRAWN BY	DRL	APPROVED BY	
HOR. SCALE	1:20	RELEASED FOR CONSTRUCTION	
VERT. SCALE			
DATE		DATE	

PROFESSIONAL'S SEAL: PROVINCE OF MANITOBA — Apr 9/15 — C.A.D. COURCHAINE — REGISTERED PROFESSIONAL ENGINEER

CONSULTANT DRAWING NO. M0005

Winnipeg

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SHOAL LAKE
INTAKE FUEL STORAGE AND DELIVERY SYSTEM REHABILITATION
MECHANICAL
INTERIOR BUILDING ELEVATIONS

SHEET 13 OF 23
CITY DRAWING NUMBER 1-0600A-M0005-001
REV 0

AECOM REVIEW | DRFT CHK
AECOM FILE NAME: M0005.dwg Saved By: landersd
PLOT: 15/04/09 12:32:28 PM
D SIZE 22" x 34" (559mm x 864mm)