

- 1. ALL PAVEMENT DIMENSIONS ARE TO BACK OF CURB. 2. CONTACT THE WATER AND WASTE DEPARTMENT'S CONSTRUCTION SERVICES COORDINATOR AT 204-986-4289, 7 DAYS PRIOR TO THE COMMENCEMENT OF
- CONSTRUCTION TO ARRANGE FOR AN INSPECTION. 3. PRIOR TO ANY CONSTRUCTION, THE AQUEDUCT MUST BE EXPOSED BY A SOFT DIG METHOD SO AS TO CONFIRM DEPTH AND LOCATION.
- 4. A MINIMUM CLEARANCE OF 0.5m MUST BE PROVIDED BETWEEN THE UNDERSIDE OF THE PROPOSED WORKS AND THE TOP ANY EXISTING AQUEDUCT BY TRENCHLESS OR OPEN TRENCH.

PROPOSED WORKS 0.5m MINIMUM


EXISTING AQUEDUCT


- 5. DO NOT OPERATE VIBRATORY EQUIPMENT OVER OR WITHIN 3.0m OF THE AQUEDUCT CENTERLINE.
- 6. CONCRETE DEMOLITION AND REMOVAL WITHIN 3 METERS HORIZONTALLY OF THE AQUEDUCT SHALL BE COMPLETED BY SAWCUTTING AND REMOVAL, OR BY THE USE OF HAND HELD JACKHAMMERS. USE OF MACHINE MOUNTED CONCRETE BREAKERS ABOVE THE AQUEDUCT SHALL NOT BE PERMITTED.
- 7. ADD 200.000m TO ABBREVIATED ELEVATIONS TO OBTAIN GEODETIC ELEVATIONS.

BID OPPORTUNITY No. 588-2015

THE CITY OF WINNIPEG

WATER AND WASTE DEPARTMENT

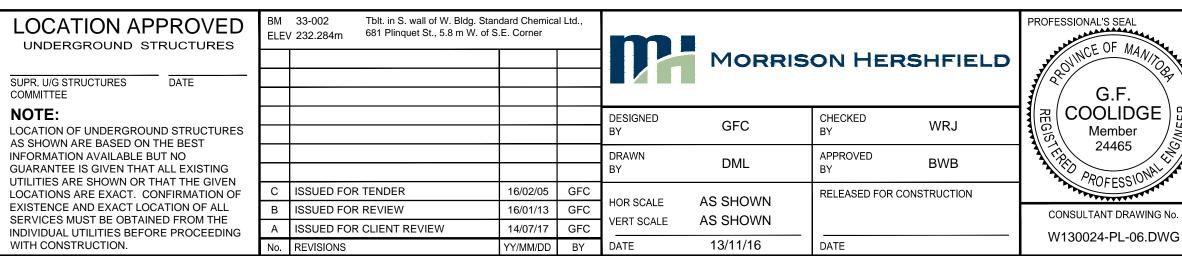



ENGINEERING DIVISION AUTOMATED SECURITY GATES & PAVEMENT WORKS - McPHILLIPS PUMPING STATION &

PLINGUET YARD PLINGUET YARD - DAWSON ACCESS

SITE PLAN & DETAILS

13 CITY DRAWING NUMBER

D-14030