


- NOTES:**
1. PROVIDE 200mm THICK VOID FORMS BETWEEN SOIL AND CONCRETE SLABS.
 2. DESIGN LIVE LOAD FOR PUMP ROOM AND SERVICE GALLERY IS 15 kPa. DESIGN SNOW LOAD IS 5 kPa.
 3. * - DENOTES LOCATION OF TYPE 1 DAVIT CRANE BASE INSERT.
⊗ - DENOTES LOCATION OF TYPE 2 DAVIT CRANE BASE INSERT.



UPPER LEVEL PLAN
1:50

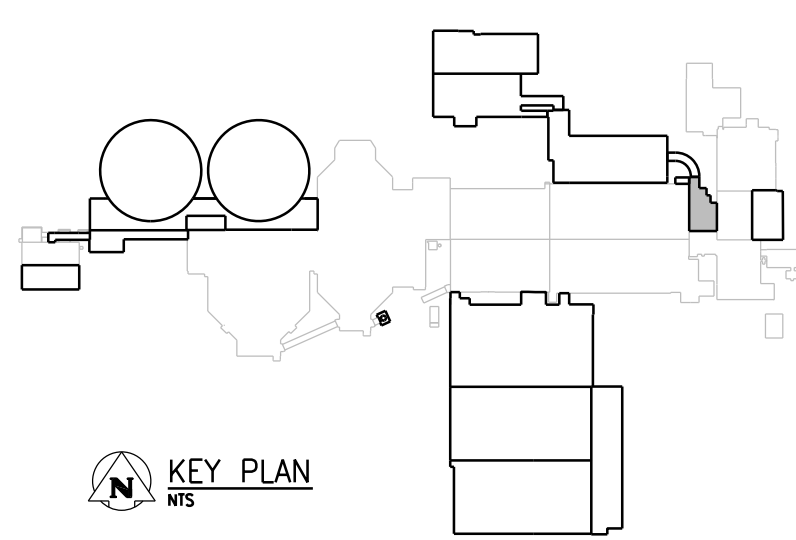

SNC-LAVALIN DESIGNED BY: E. LUI DRAWN BY: G. OMORI SCALE: 1:50		CHECKED BY: R. PARIKH APPROVED BY: E. LUI ISSUED FOR CONSTRUCTION BY: T. TURZAK DATE: 2015/08/13		SOUTH END WATER POLLUTION CONTROL CENTRE SEWPCC UPGRADING/EXPANSION PROJECT STRUCTURAL GRIT TANKS 1 AND 2 UPPER LEVEL PLAN		CITY DRAWING NUMBER: 1-0102-SGAD-G003 SHEET: 01 REV: 01 SIZE: A1	
01 ISSUED FOR ADDENDUM NO. 2 08/2015 C.R. J.C.		09/2015 C.R. J.C.		DATE: 2015/08/13 CONSULTANT NO.: 474248		FILE NAME: 1-0102-SGAD-G003.dgn	