


- NOTES:**
- REFER TO DWG SDTL-A001 FOR GENERAL STRUCTURAL NOTES.
 - PROVIDE 200mm THICK VOID FORMS BETWEEN SOIL AND CONCRETE SLABS.
 - ELEVATION OF NEW FLOOR TO MATCH ELEVATION OF EXISTING GALLERY 5. FIELD VERIFY ELEVATION. NOTIFY CONTRACT ADMINISTRATOR OF DISCREPANCIES.
 - FIELD VERIFY ELEVATION, LOCATION AND CONDITION OF EXISTING PILES. NOTIFY CONTRACT ADMINISTRATOR OF DISCREPANCIES. SEE DWG SFDW-K002 FOR PILE DETAILS.
 - DESIGN LIVE LOAD FOR PUMP ROOM AND SERVICE GALLERY IS 15 kPa. DESIGN LIVE LOAD FOR STAIRS IS 5 kPa.
 - DESIGN SURCHARGE = 10 kPa.
 - "C#" DENOTES COLUMN NUMBER. REFER TO DWG SSCH-K001 FOR COLUMN SCHEDULE.

BASEMENT PLAN
1:100

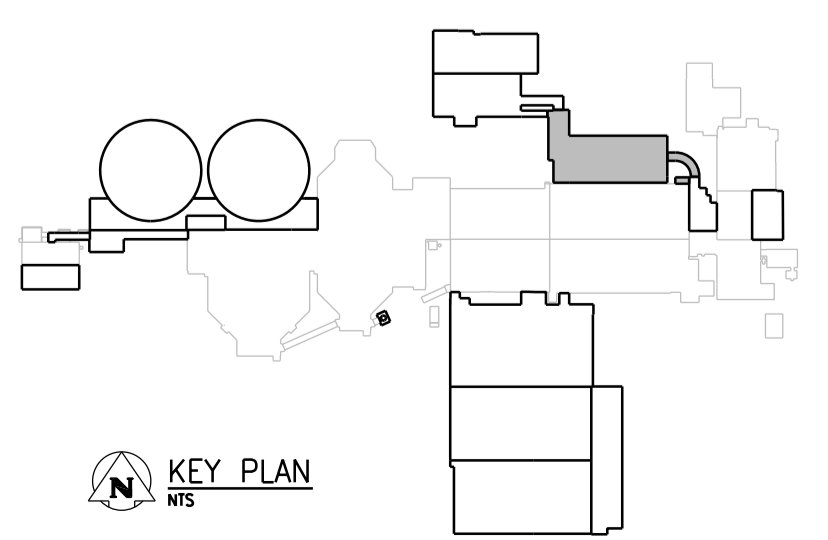

SNC-LAVALIN DESIGNED BY: E. LUJ DRAWN BY: G. OMORI SCALE: 1:100 DATE: 2015/08/13 CONSULTANT NO.: 474248		CHECKED BY: R. PARIKH APPROVED BY: E. LUJ ISSUED FOR CONSTRUCTION BY: T. TURZAK DATE: 2015/08/13			
THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT SOUTH END WATER POLLUTION CONTROL CENTRE SEWPPC UPGRADING/EXPANSION PROJECT STRUCTURAL HIGH RATE CLARIFICATION BUILDING BASEMENT PLAN				CITY DRAWING NUMBER: 1-0102-SGAD-K001 SHEET: 01 REV: 01 SIZE: A1	