



- NOTES:**
1. PROVIDE 200mm THICK VOID FORMS BETWEEN SOIL AND CONCRETE SLABS.
 2. ELEVATION OF NEW EFFLUENT CHANNEL TO MATCH ELEVATION OF EXISTING. FIELD VERIFY ELEVATION. NOTIFY CONTRACT ADMINISTRATOR OF DISCREPANCIES.
 3. FIELD VERIFY ELEVATION, LOCATION AND CONDITION OF EXISTING PILES. NOTIFY CONTRACT ADMINISTRATOR OF DISCREPANCIES.
 4. DESIGN SUPERIMPOSED DEAD LOAD ON UNDERSIDE OF CHANNEL IS 1 kPa.
 5. CARRY OUT SUCCESSFUL LEAKAGE TESTING OF GRIT TANKS PRIOR TO BACKFILLING AND CONSTRUCTION OF EFFLUENT CHANNEL BETWEEN GRIDLINE Hg AND Kg. SEE NOTES ON SECTION D SGAD-G006

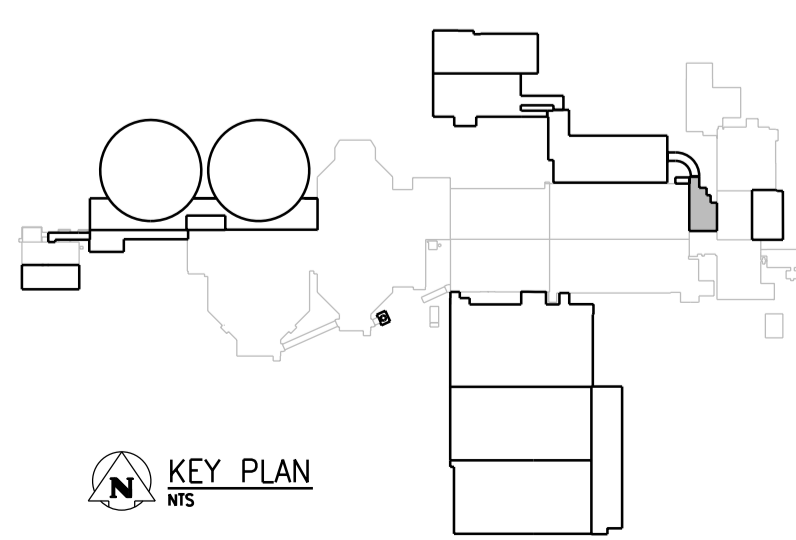

CHANNEL LEVEL PLAN
1:50




APEGM
Certificate of Authorization
CH2M HILL Canada Ltd.
No. 1441

00	ISSUED FOR TENDER	08/2015	G.O.	J.C.
NO.	REVISIONS	DATE	DESIGN	CHECK

CH2MHILL.

SNC-LAVALIN

DESIGNED BY: E. LUJ	CHECKED BY: R. PARIKH
DRAWN BY: G. OMORI	APPROVED BY: E. LUJ
SCALE: 1:50	ISSUED FOR CONSTRUCTION BY: T. TURZAK
DATE: 2015/08/13	DATE: 2015/08/13
CONSULTANT NO.: 474248	

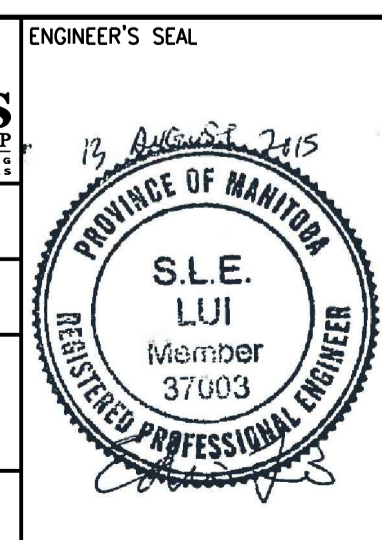

THE CITY OF WINNIPEG
Winnipeg WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
SEWPCC UPGRADING/EXPANSION PROJECT
STRUCTURAL
GRIT TANKS 1 AND 2
CHANNEL LEVEL PLAN

CITY DRAWING NUMBER: 1-0102-SGAD-G002
SHEET: 00
REV: 00
SIZE: A1