


- NOTES:**
- REFER TO DWG SDTL-A001 FOR GENERAL STRUCTURAL NOTES.
  - ELEVATIONS AT BASEMENT AND GROUND FLOOR LANDINGS TO MATCH ELEVATIONS OF EXISTING PRIMARY CLARIFIER TANK 1. NOTIFY CONTRACT ADMINISTRATOR OF DISCREPANCIES.
  - DESIGN LIVE LOAD FOR STAIRS IS 5 kPa.
  - DESIGN LIVE LOAD FOR ROOF IS 1 kPa.
  - DESIGN SNOW LOAD FOR ROOF IS 3 kPa.

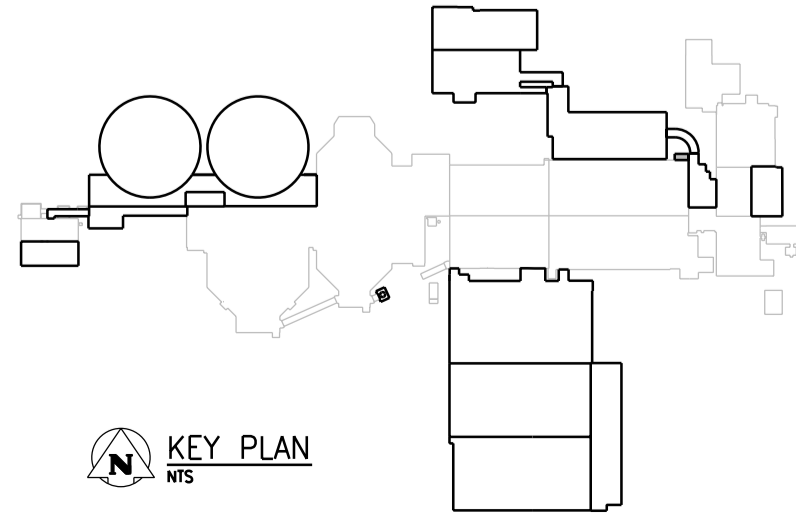

|                        |  |                          |  |  |  |  |  |
|------------------------|--|--------------------------|--|--|--|--|--|
|                        |  |                          |  |  |  |  |  |
| DESIGNED BY:<br>E. LUI |  | CHECKED BY:<br>R. PARIKH |  | APPROVED BY:<br>J. CHENG                 |  | SOUTH END WATER POLLUTION CONTROL CENTRE<br>SEWPPC UPGRADING/EXPANSION PROJECT<br>STRUCTURAL<br>PRIMARY CLARIFIERS<br>PLANS AND SECTIONS |  |
| DRAWN BY:<br>G. OMORI  |  | APPROVED BY:<br>J. CHENG |  | ISSUED FOR CONSTRUCTION<br>BY: T. TURZAK |  | CITY DRAWING NUMBER<br>1-0102-SGAD-P001  |  |
| SCALE:<br>1:50         |  | DATE:<br>2015/08/13      |  | DATE:<br>2015/08/13                      |  | SHEET<br>00  |  |
| DATE:<br>2015/08/13    |  | DATE:<br>2015/08/13      |  | CONSULTANT NO.:<br>474248                |  | REV.<br>00   |  |
| NO. REVISIONS          |  | DATE                     |  | DESIGN CHECK                             |  | SIZE<br>A1   |  |