Last saved by: CLOUSTONC (2015-09-24) Last Plotted: never
Filename: P:\60431277\900-WORK\920-929 (GIS-GRAPHICS)\692-2015_DRAWING_XXX_R0.MXD

Project Management Initials: Designer: Checked: Approved:

ANSI B 279.4mm x 431.8mm

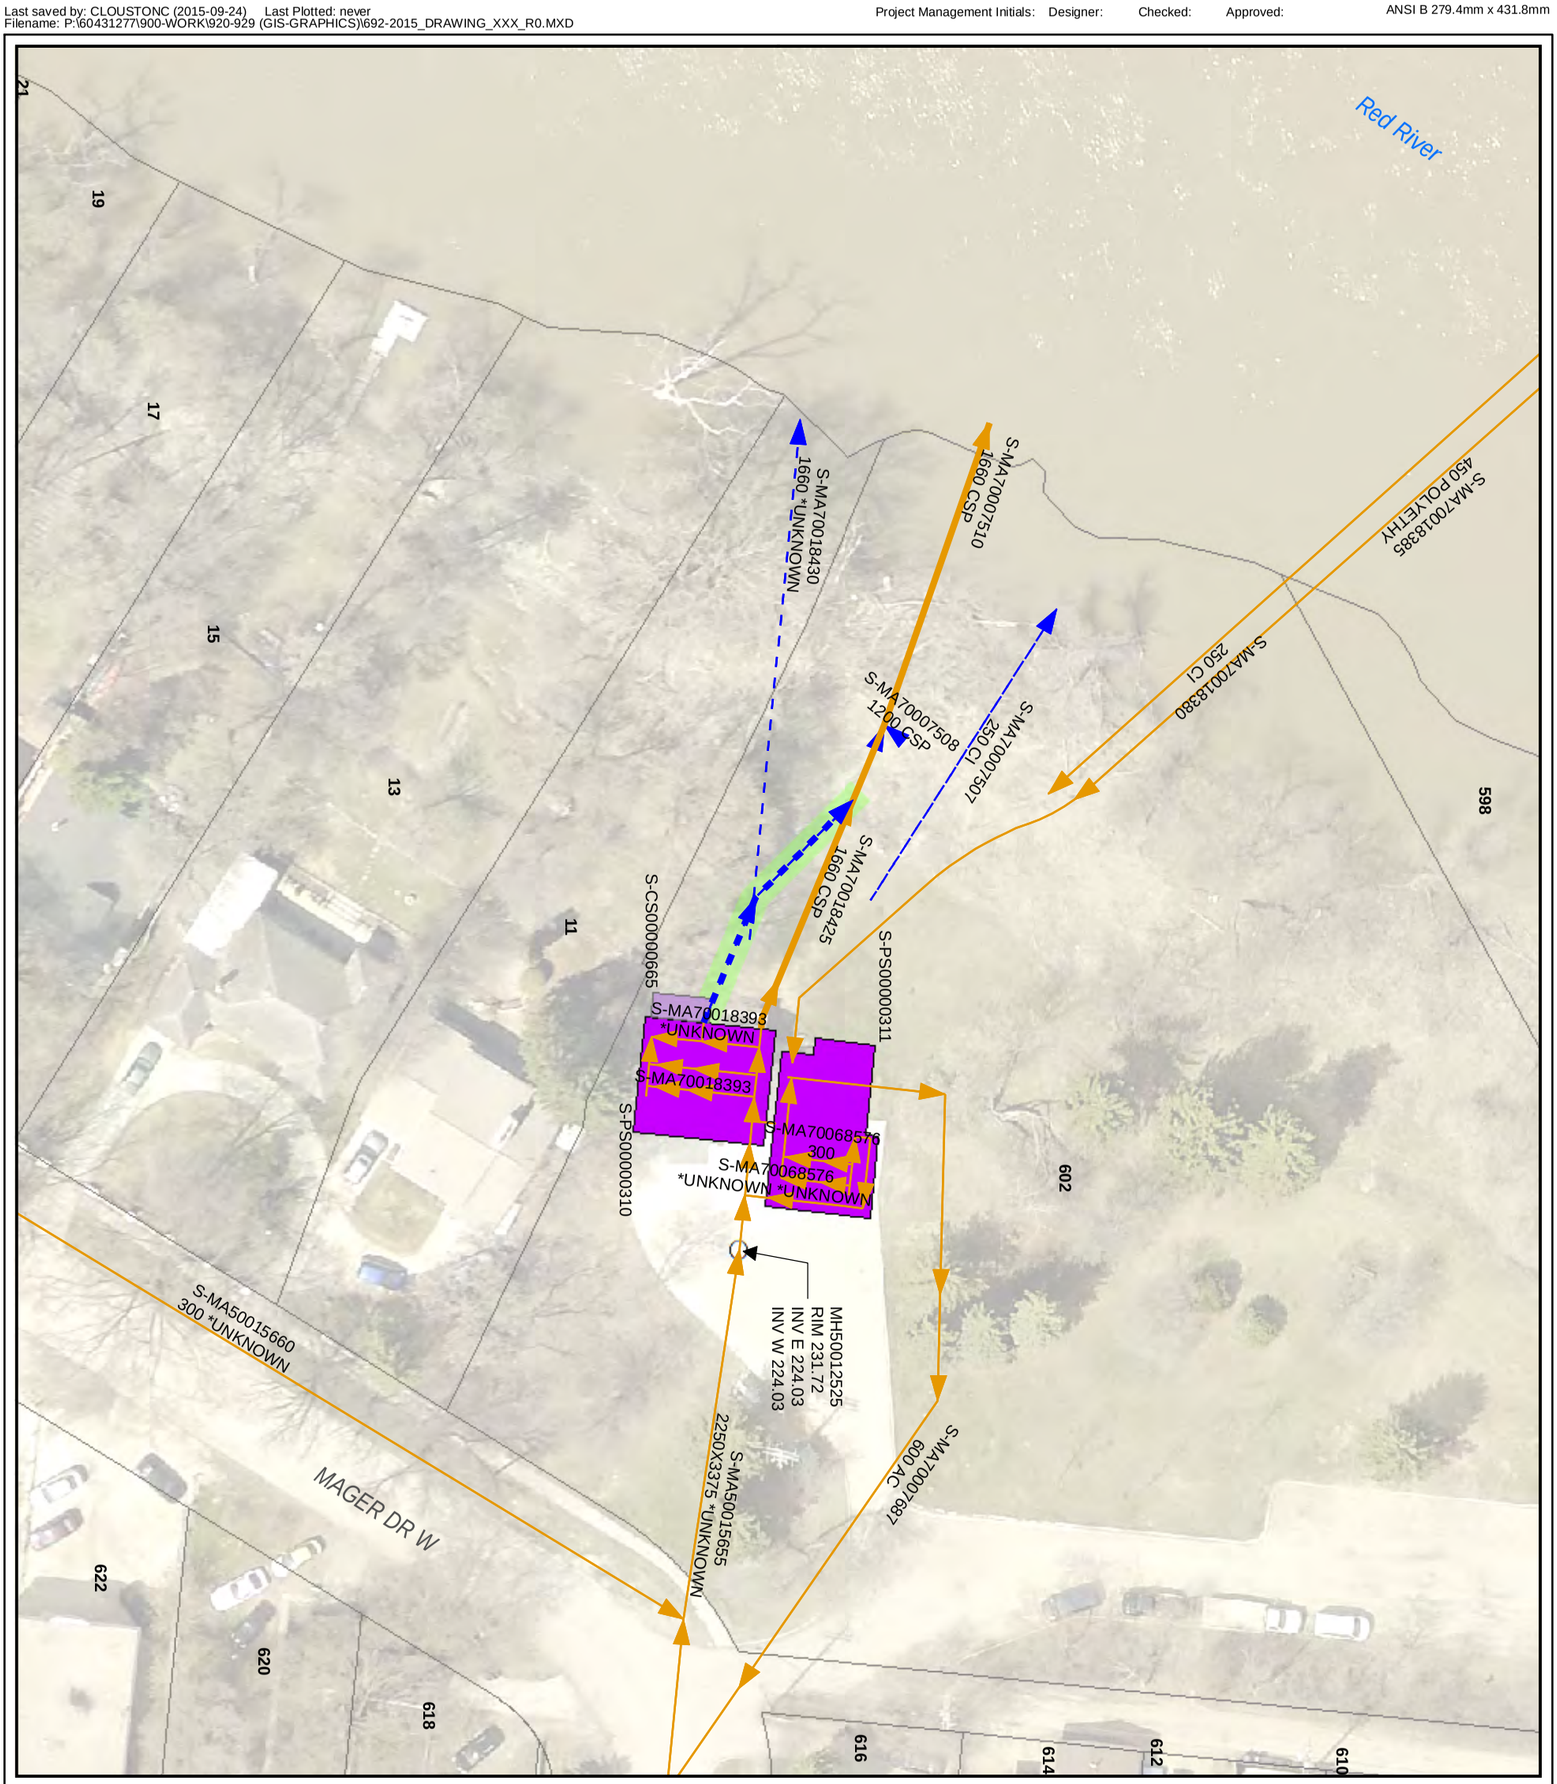

SITE CONSIDERATIONS:
PUMP STATION AND CONTROL STRUCTURE ACCESS REQUIRED

Winter Inspections
LEGEND
CS
LDS
SEWER MANHOLE
SEWER PUMP STATION
CONTROL STRUCTURE

N
1:500
NAD 1983 UTM Zone 14N
7.5 0 7.5 15 22.5 30 m

Issue Status: Tender

2015 Outfall Inspections

City of Winnipeg
BID Opportunity No. 692-2015

Outfall Asset Number: S-MA70018393 - 22.89m

Upstream Sewer Asset Number: None - 0m
Upstream Manhole Coordinates: 635624.9288E, 5525007.6657N
Location: 5 MAGER DR

AECOM

Drawing: 118 of 341