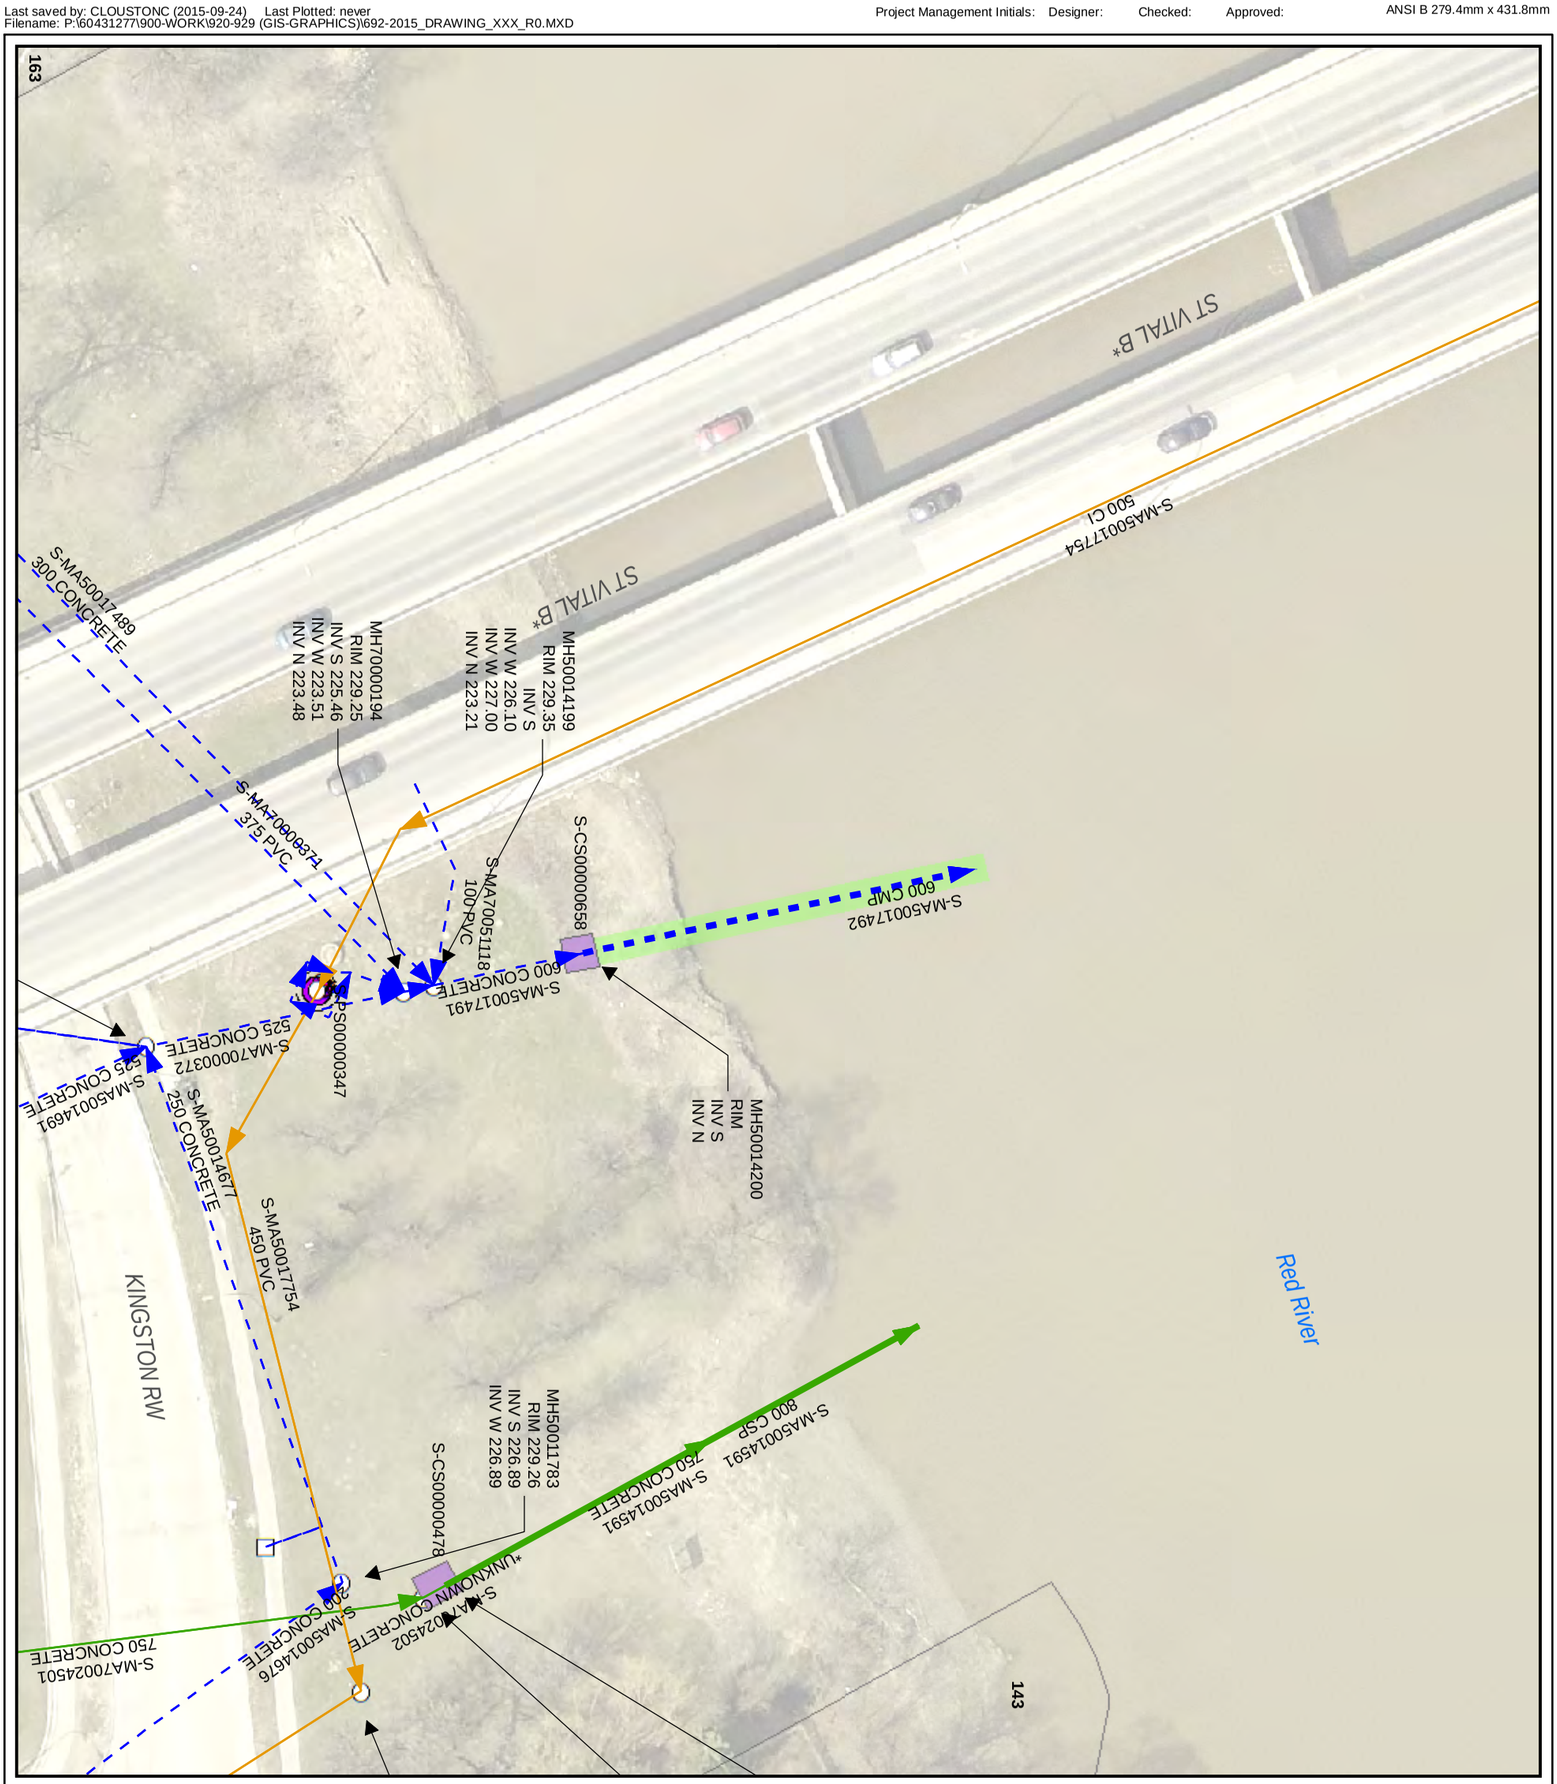

N

1:500

NAD 1983 UTM Zone 14N

7.5 0 7.5 15 22.5 30 m

Unknown Invert

LEGEND

CS
LDS
SRS
CB Lead
SEWER MANHOLE
CATCH BASIN
SEWER VALVE
SEWER PUMP STATION
SEWER CHAMBER
CONTROL STRUCTURE

SITE CONSIDERATIONS:
CONTROL STRUCTURE ACCESS REQUIRED

Issue Status: Tender

2015 Outfall Inspections

City of Winnipeg
BID Opportunity No. 692-2015

Outfall Asset Number: S-MA50017492 - 33.55m

Upstream Sewer Asset Number: None - 0m
Upstream Manhole Coordinates: 634710.7471E, 5524200.6665N
Location: KINGSTON ROW & DUNKIRK DR

AECOM

Drawing: 121 of 341