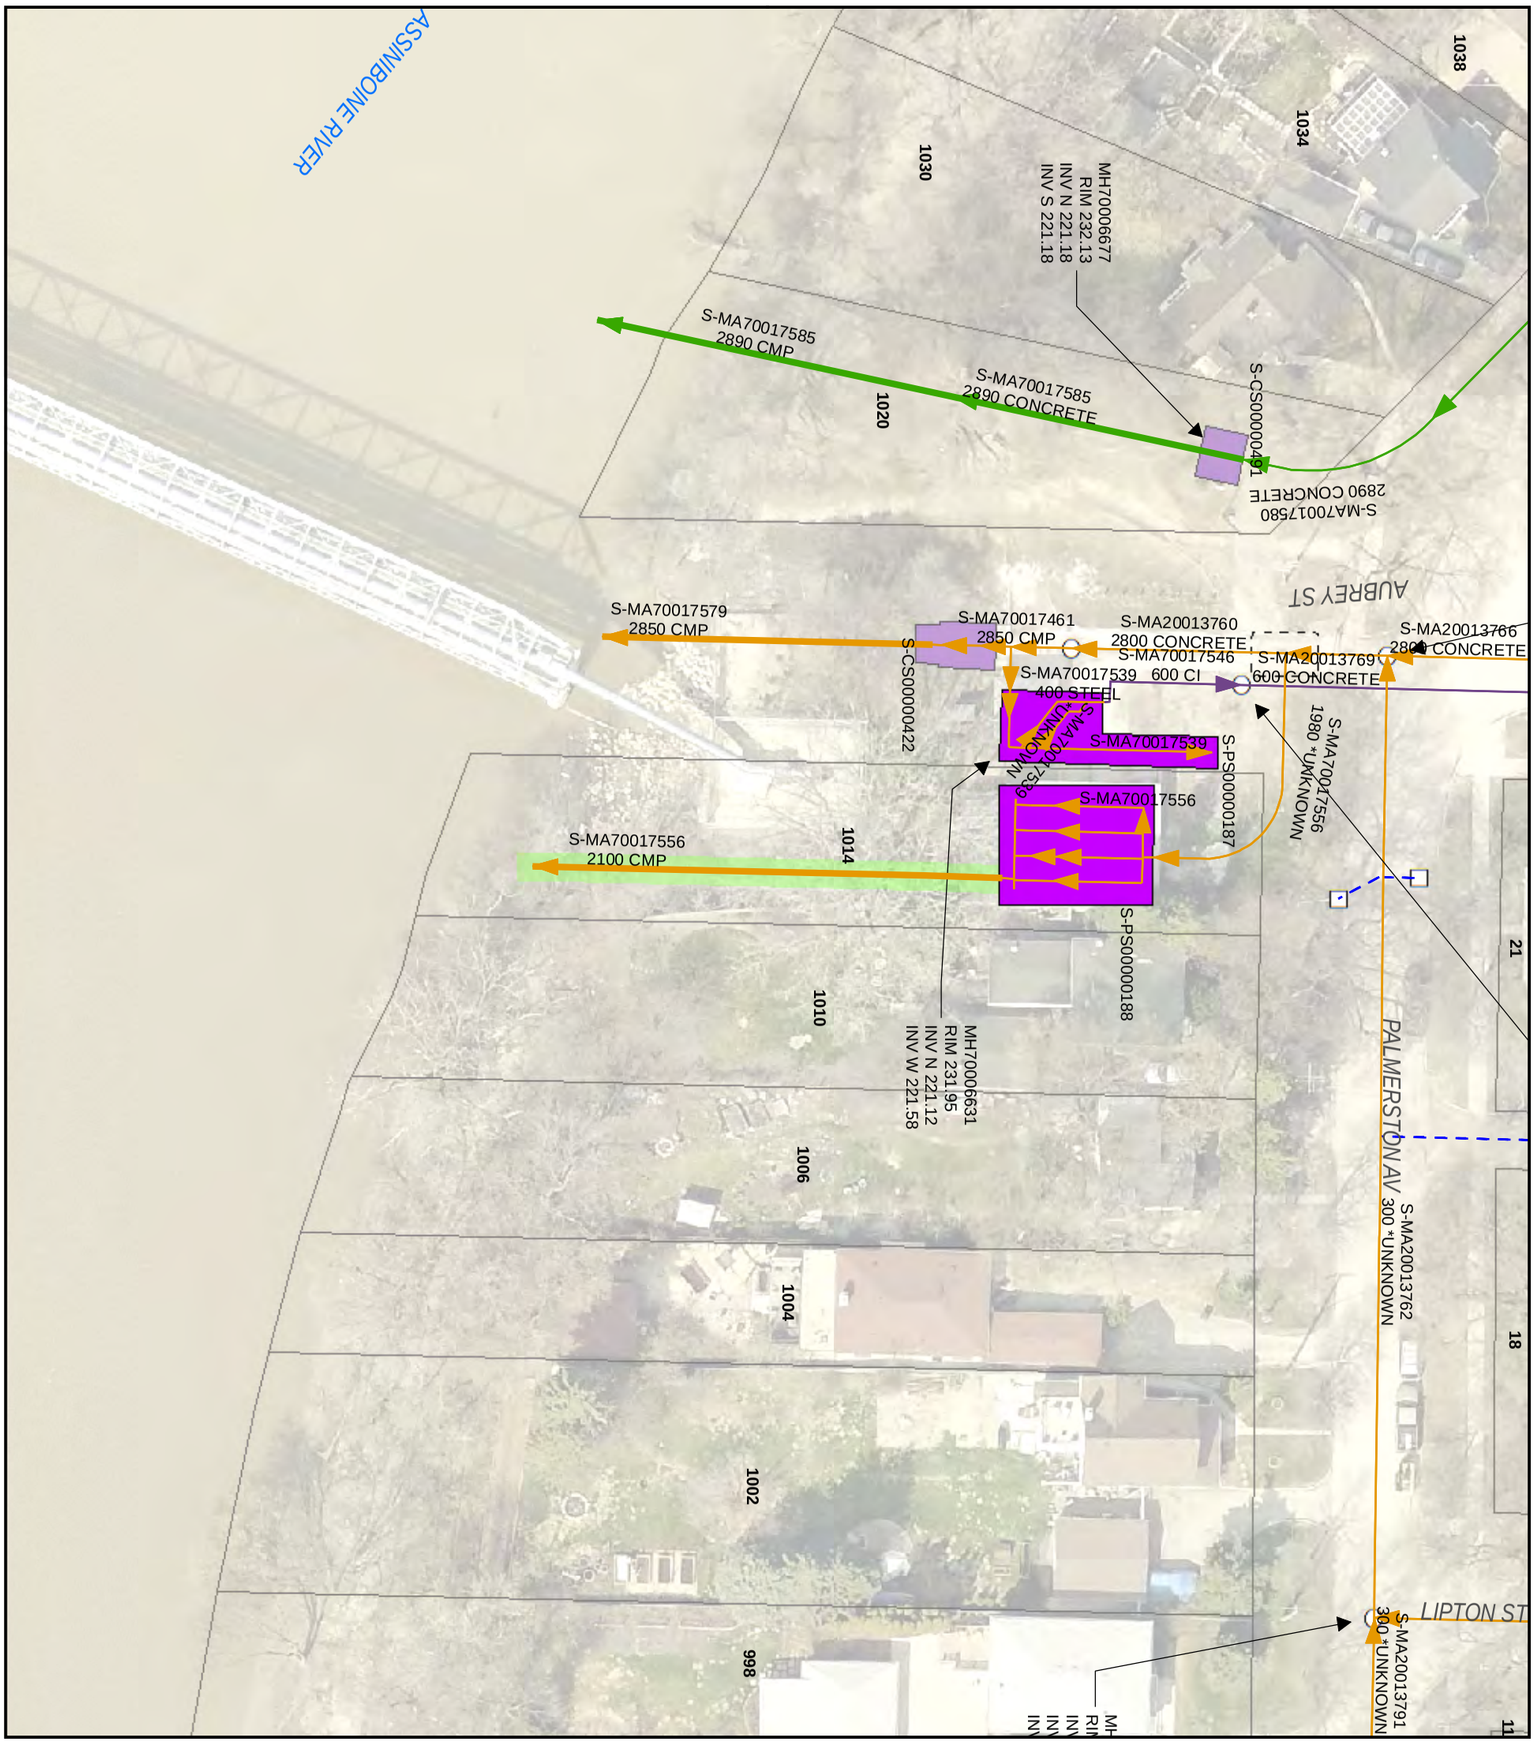

Fall Inspections

LEGEND

- CS
- SRS
- WWS
- CB Lead
- SEWER MANHOLE
- CATCH BASIN
- SEWER PUMP STATION
- SEWER CHAMBER
- CONTROL STRUCTURE

SITE CONSIDERATIONS:
PUMP STATION ACCESS REQUIRED

N

1:500

NAD 1983 UTM Zone 14N

7.5 0 7.5 15 22.5 30 m

Issue Status: Tender

2015 Outfall Inspections

City of Winnipeg
BID Opportunity No. 692-2015

Outfall Asset Number: S-MA70017556 - 39.35m

Upstream Sewer Asset Number: None - 0m
Upstream Manhole Coordinates: 631108.5862E, 5526567.3686N
Location: 1014 PALMERSTON AVE

AECOM

Drawing: 299 of 341