


AREA OF WORK

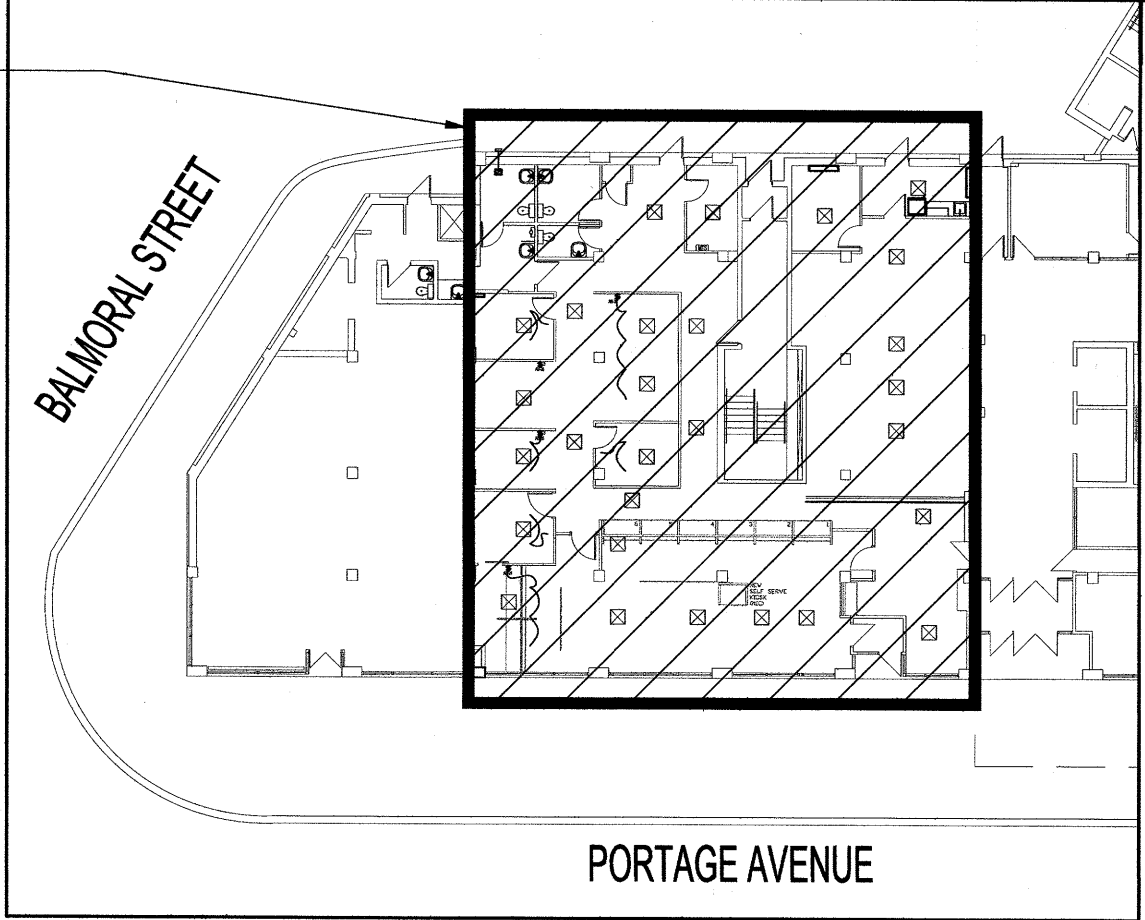

KEY PLAN N.T.S.

**MECHANICAL SYMBOLS**

- BALANCE DAMPER (EXIST)
- SUPPLY DIFFUSER (EXIST)
- RETURN GRILLE (EXIST)
- T HIC RTU-9 (EXIST)
- DIFFUSER OR GRILLE INFO TYPE = "A" EXISTING

**MECHANICAL RENOVATION NOTES:**  
ALSO SEE NOTES & SPECIFICATIONS.

PROVIDE A COMPLETE TESTING, ADJUSTING & BALANCING REPORT ON THE OPERATING FUNCTION FOR THE THREE (3) AIR HANDLING UNITS SERVING THE WPA AREA. SEE MECHANICAL SPECIFICATION, DRAWING M2. REPORT TO ALSO INCLUDE ECONOMIZER DAMPER OPERATION & THERMOSTAT FUNCTIONALITY.

- THE THREE (3) AIR HANDLING UNITS ARE:
- FAN COIL UNIT LOCATED ABOVE W/C WOMEN'S ROOM 115.
  - RTU-7 LOCATED ON SOUTH-EAST ROOF (ACCESSIBLE FROM GATE AT PARKADE LEVEL).
  - RTU-9 LOCATED ON SOUTH-WEST ROOF ABOVE BOOSTER JUICE (ACCESSIBLE FROM STREET LEVEL EXTERIOR LADDER, REAR OF BOOSTER JUICE).

- 1 AIR BALANCE TO CFM SHOWN.
- 2 RELOCATE THERMOSTAT AS SHOWN.
- 3 RELOCATE SUPPLY DIFFUSER AS SHOWN.
- 4 RELOCATE RETURN GRILLE AS SHOWN.
- 5 RELOCATE THERMOSTAT PNEUMATIC LINE RUNNING THROUGH EXISTING CABINET DEMOLITION (SEE ARCHITECTURAL DRAWING) INTO CRAWLSPACE/BASEMENT. LOCATION TO BE DETERMINED.

NOTES:

**DRAWING LIST**

SHEET No:	SHEET TITLE
M1	PARTIAL MAIN FLOOR REFLECTED CEILING PLAN: RENOVATION: MECHANICAL
M2	MECHANICAL SPECIFICATIONS

No.	REVISION/DESCRIPTION	BY	DATE
0	ISSUED FOR CONSTRUCTION	DTA	2015.08.24



DATE	DRAWN	CHECKED	DESIGNED	APPROVED
2015.08.11	USER			

THE CITY OF WINNIPEG  
PLANNING, PROPERTY AND  
DEVELOPMENT DEPARTMENT  
MUNICIPAL ACCOMMODATIONS DIVISION  
3-65 GARRY STREET, R3C 4K4

PROJECT  
RICE BUILDING  
WINNIPEG PARKING AUTHORITY  
RENOVATION DESIGN  
491 PORTAGE AVENUE

SHEET TITLE  
PARTIAL MAIN FLOOR REFLECTED CEILING PLAN  
RENOVATION  
MECHANICAL

SCALE	PROJECT No:	SHEET No:
AS SHOWN	2013-127-01	M1

PARTIAL REFLECTED CEILING PLAN - RENOVATION - MECHANICAL  
SCALE: 1/4"=1'-0"