

FROM TS2-FU15  
(NOTE 1)  
24 VDC

FROM TS2-C15  
(NOTE 1)  
0 VDC

SCADAPACK 357  
RTU  
16-PT DISCRETE  
OUTPUT

SCADAPACK 357  
DIGITAL OUTPUT (24VDC)  
SLIDE GATE ACTUATOR  
OPEN COMMAND

SCADAPACK 357  
DIGITAL OUTPUT (24VDC)  
SLIDE GATE ACTUATOR  
CLOSE COMMAND


SCADAPACK 357  
DIGITAL OUTPUT (24VDC)  
PUMP P-A01  
RUN COMMAND

SCADAPACK 357  
DIGITAL OUTPUT (24VDC)  
PUMP P-A01  
DISABLE PUMP

CONNECTOR (P5)

CONNECTOR (P6)

NOTE 2 (TYP)

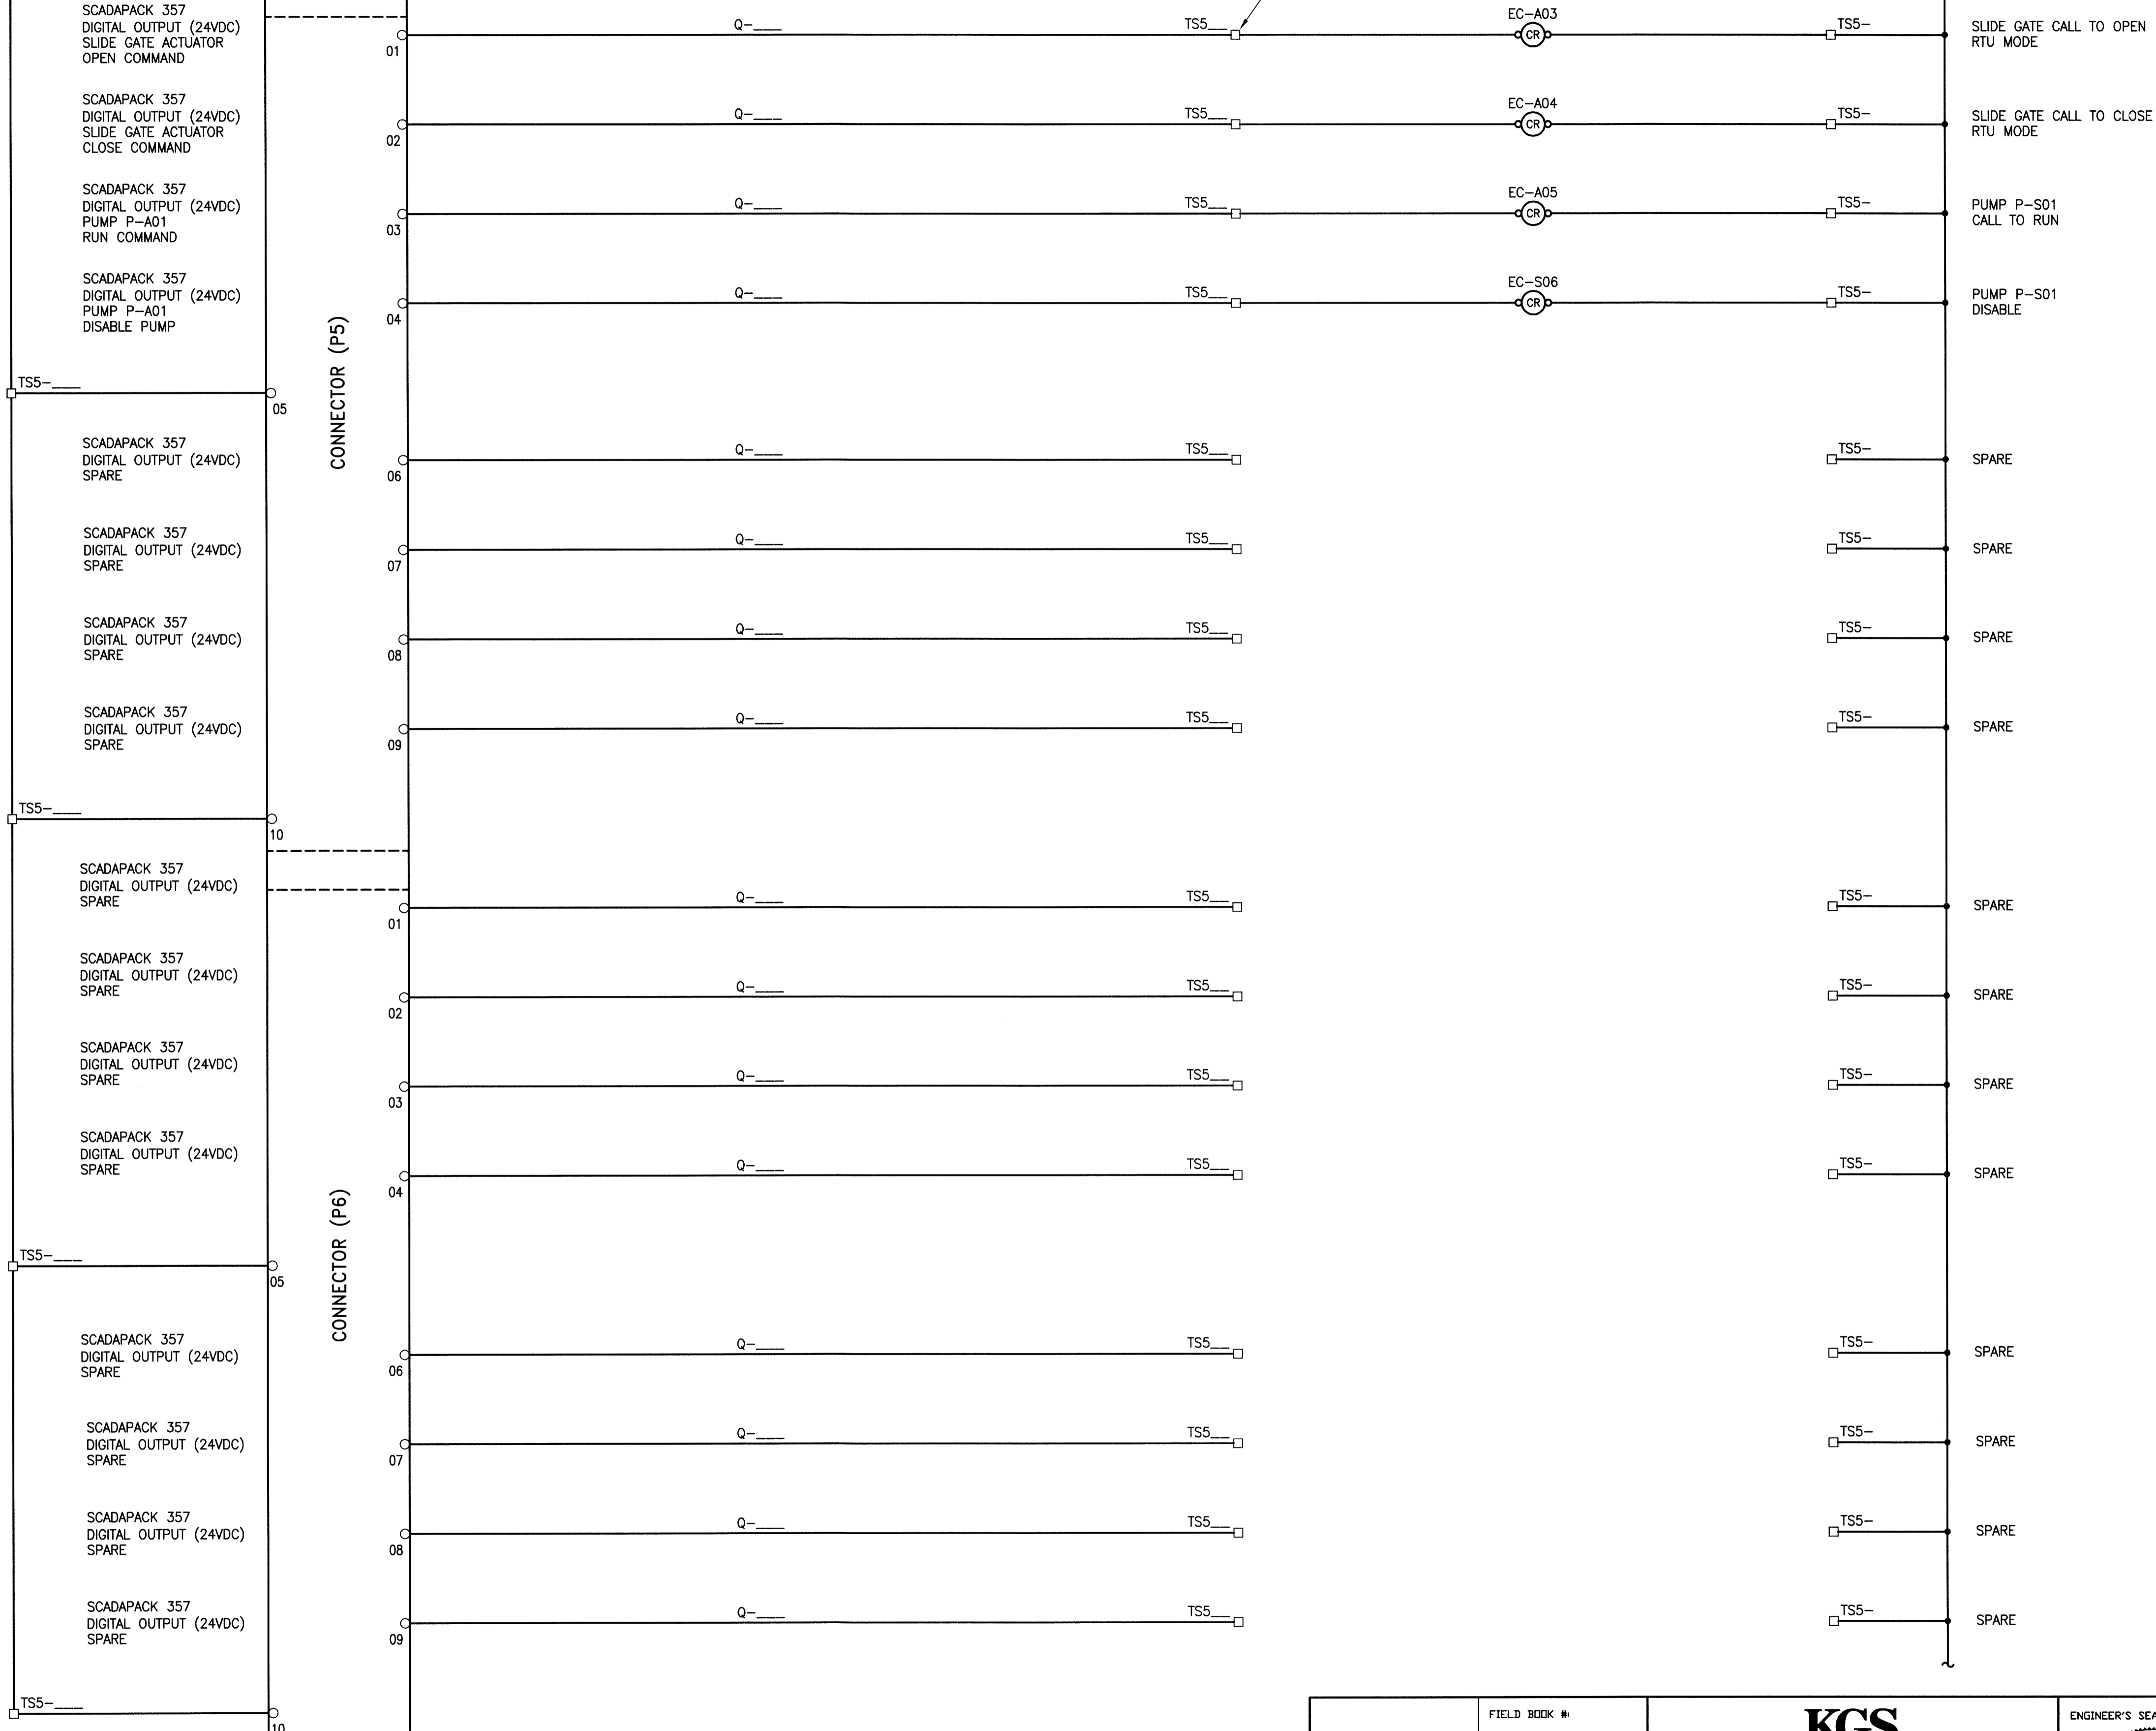

**NOTES:**

- REFER TO DRAWING 1-0204A-E0009-001 (E09) FOR ADDITIONAL DETAILS.
- FINAL TERMINAL BLOCK NUMBERS FOR TERMINALS ON TERMINAL STRIP TS5 SHALL BE DETAILED ON SHOP DRAWINGS.

**LEGEND:**

- RTU TERMINAL
- FIELD DEVICE TERMINAL
- STARTER TERMINAL
- FUSED TERMINAL
- PANEL WIRING
- - - - - FIELD WIRING

File Name: P:\Projects\2015\15-0107-011\Drawings\Elec\15-0107-011\_E15.dwg - Tab: E35 Plotted By: cderoche 10/02/2015 [Fri 11:56am]



POSTED TO LBS		FIELD BOOK #	
DESIGNED BY	SEB	CHECKED BY	<i>gms</i>
DRAWN BY	JPL	APPROVED BY	<i>gms</i>
HDR. SCALE	N.T.S.	RELEASED FOR CONSTRUCTION	-
VERTICAL	N.T.S.	DATE	2015 07 17
NO. REVISIONS	DATE	BY	DATE
0	ISSUED FOR CONSTRUCTION	15/10/02	<i>gms</i>

ENGINEER'S SEAL

15/10/02

E15

**THE CITY OF WINNIPEG**  
WATER AND WASTE DEPARTMENT

FORT ROUGE OUTFALL CHAMBER UPGRADES  
FORT ROUGE  
**ELECTRICAL**  
RTU PANEL - 5606 I/O BOARD  
DISCRETE OUTPUTS

SHEET 1 OF 1  
CITY DRAWING NUMBER  
1-0204A-E0015-001