


NOTE:
 1. POUR PILASTER WITH WALL AND AVOID CONSTRUCTION JOINT. IF CONSTRUCTION JOINT IS CHOOSEN USE DOWEL BAR SPLICERS AT JOINT. DRILL-IN DOWELS WILL NOT BE PERMITTED. ALSO PROVIDE 150mm LONG x 40 DEEP KEY WHERE SHOWN IF CONSTRUCTION JOINT IS CHOOSEN.



NO.	REVISIONS	DATE	DESIGN	CHECK
01	ISSUED FOR ADD. 2 - B.O. 899-2015	02/2016	G.O. J.C.	
00	ISSUED FOR TENDER - B.O. 899-2015	01/2016	G.O. J.C.	

CH2MHILL		KCS	
SNC-LAVALIN		G.R.O.E.C. CONSULTING ENGINEERS	
DESIGNED BY: A THAKKAR	CHECKED BY: R. PARIKH	DATE: 2016/01/29	ISSUED FOR CONSTRUCTION DATE: 2016/01/29
DRAWN BY: G. OMORI	APPROVED BY: H.T. FREIHAMMER	CONSULTANT NO.: 474248	
SCALE: 1:20	BY: T. TURZAK		

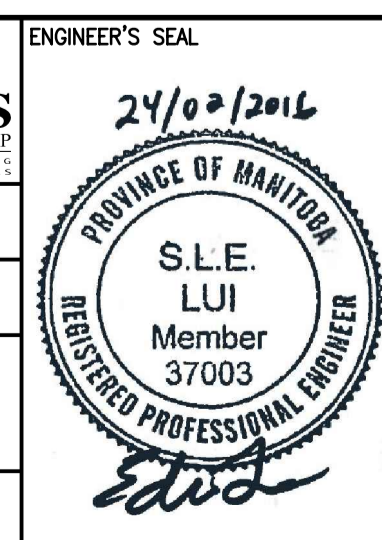

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
 SEWPCC UPGRADING/EXPANSION PROJECT

STRUCTURAL
 SECONDARY CLARIFIERS 4 AND 5
 DETAILS

CITY DRAWING NUMBER: 1-0102-SDTL-S005 | SHEET: 001 | REV: 01 | SIZE: A1