



GENERAL NOTES:

- 1. REFER TO DWG. 1-0102-ECTR-R001 FOR GENERAL NOTES.
- 2. OUTDOOR CABLE TRAYS SHALL BE SUPPORTED FROM PIPING SUPPORT SYSTEM AT SPACING NOT MORE THAN 400mm ON CENTRE FOR HORIZONTAL RUNS AND NOT MORE THAN 1800mm ON CENTRE FOR VERTICAL RUNS.
- 3. ALL CABLE TRAYS TO BE BONDED / TIED TO THE PERIMETER GROUNDING ELECTRODES / GRID.

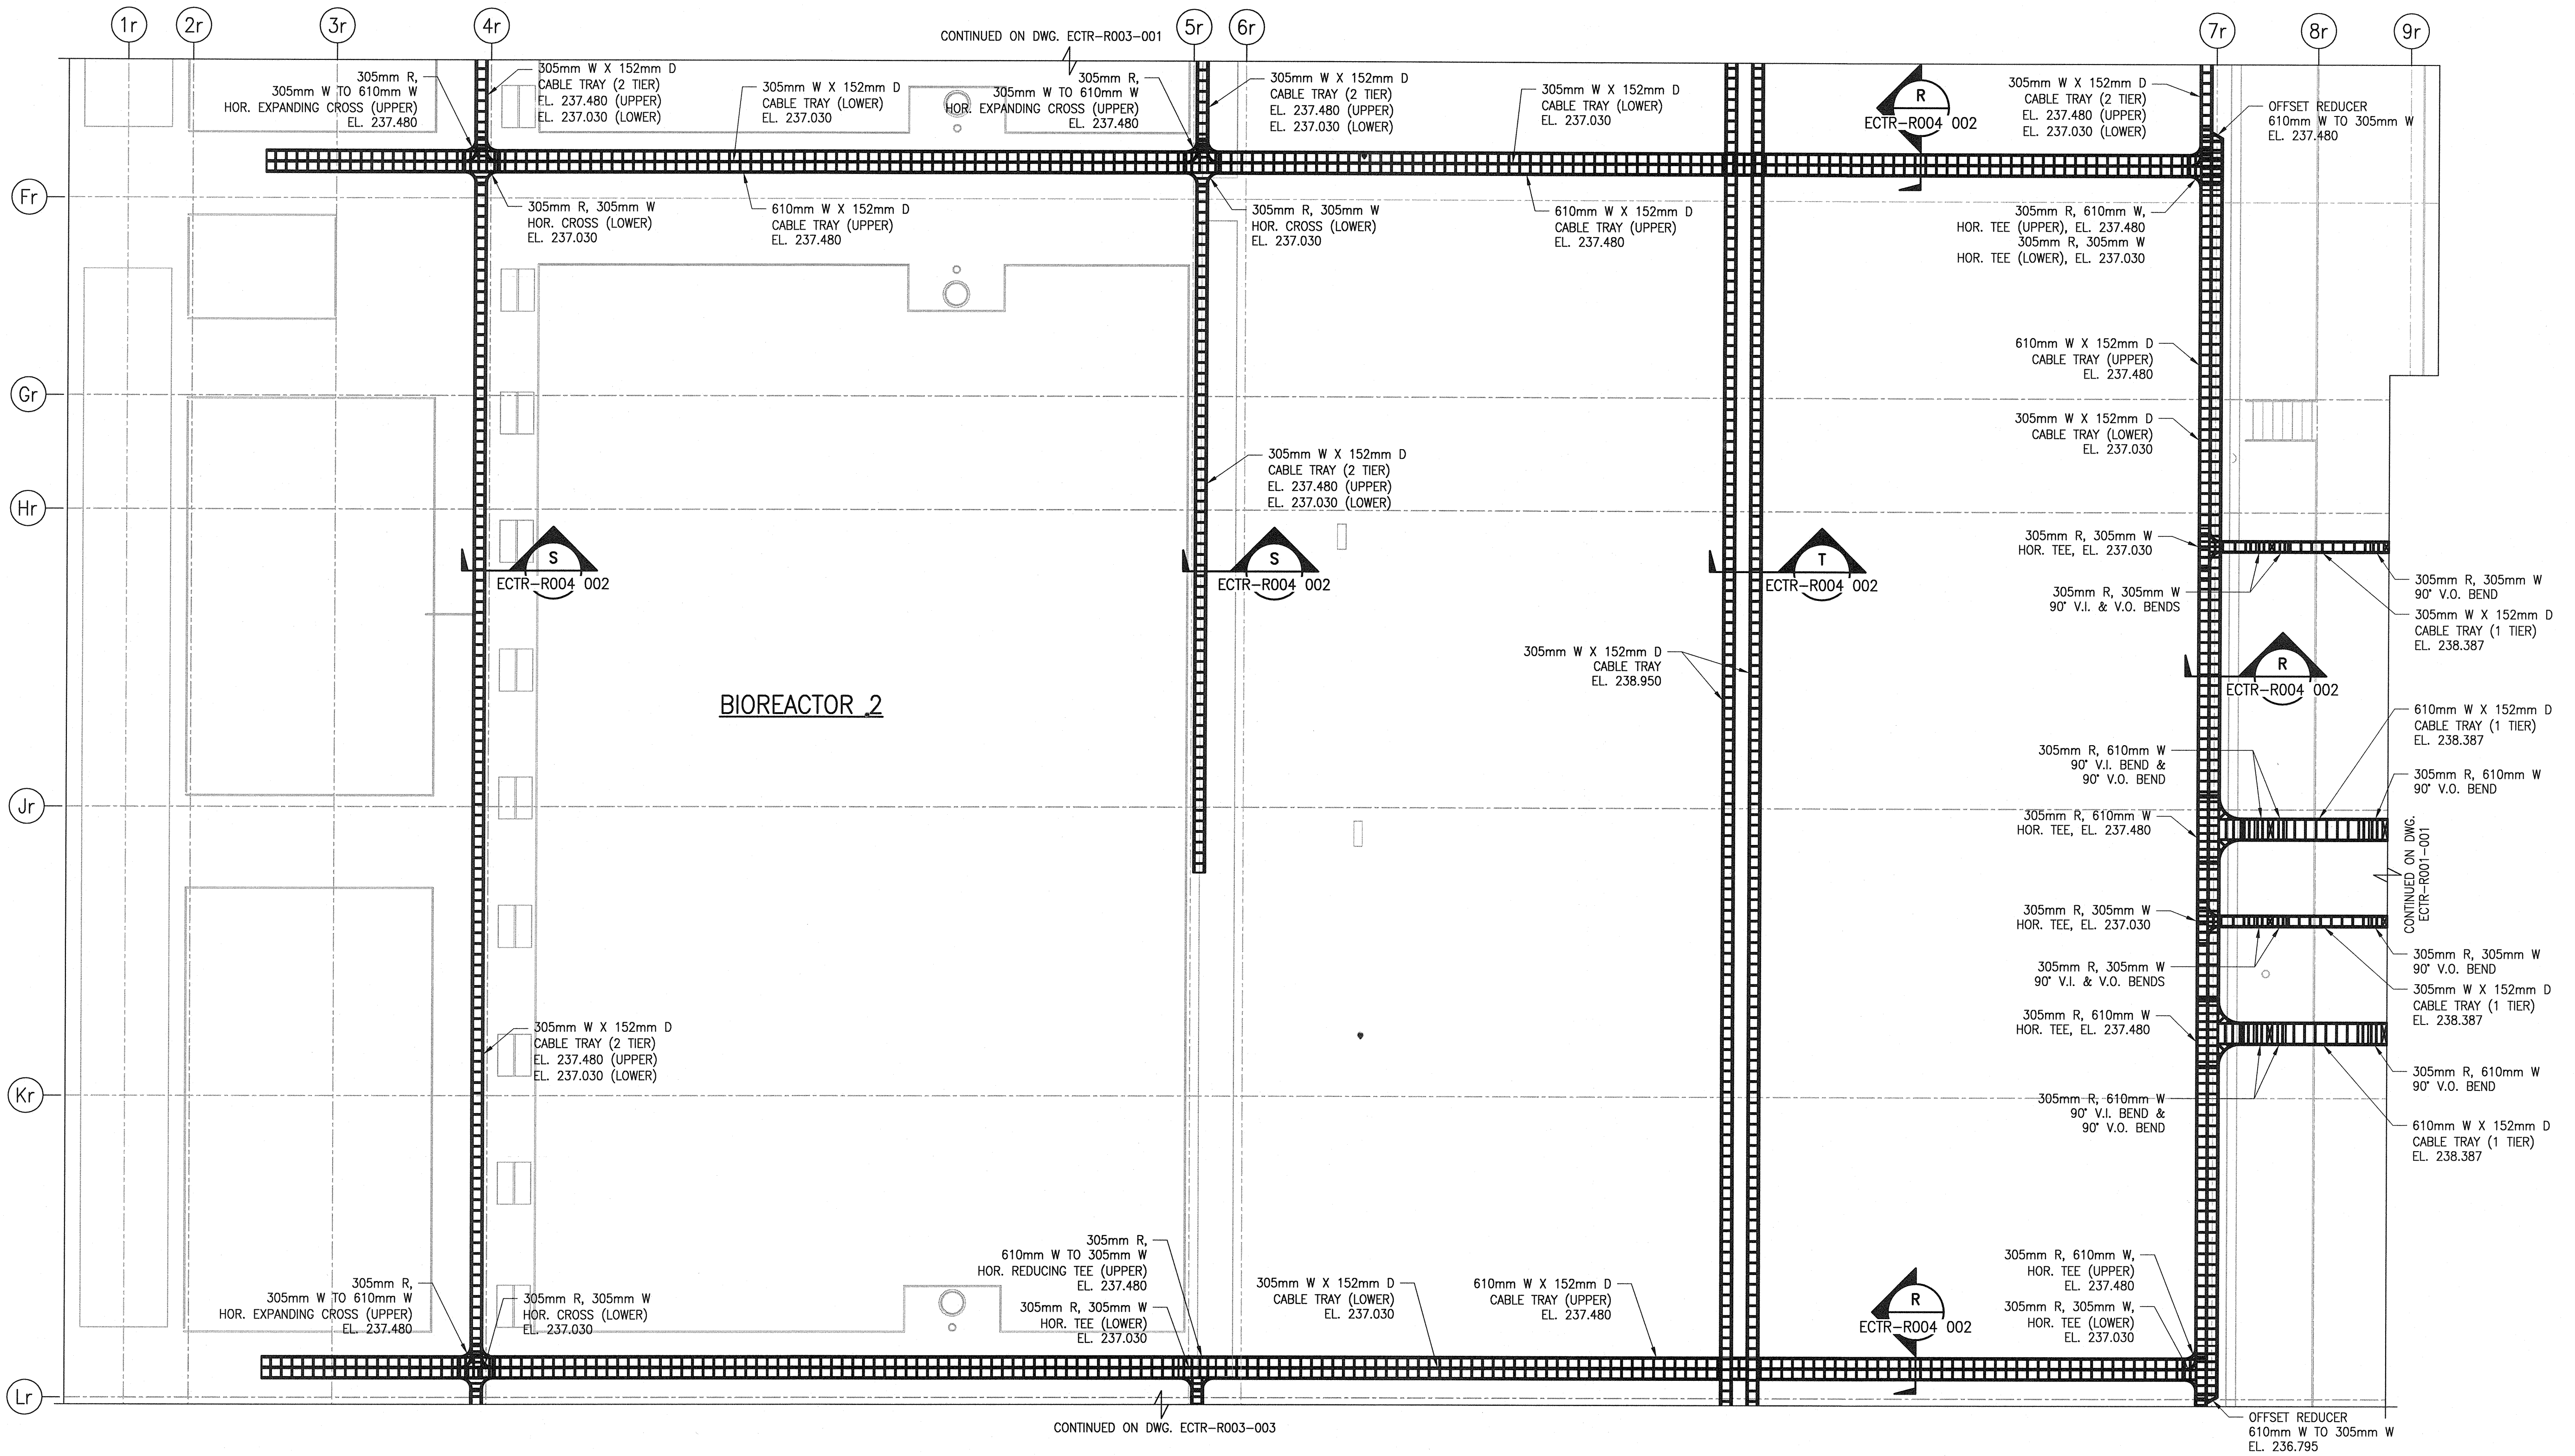

PARTIAL UPPER LEVEL PLAN
SCALE: 1 : 100

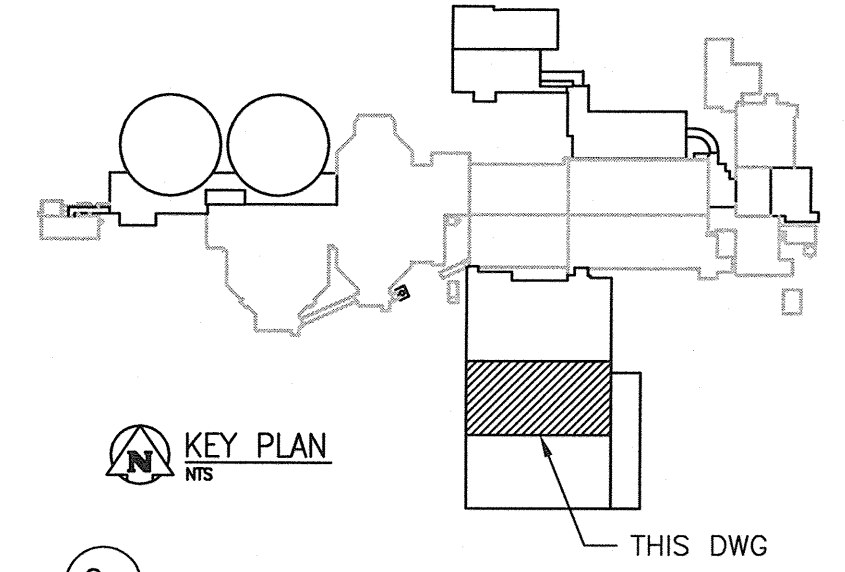


NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER - B.O. 899-2015	01/2016	SLJ	DEB

CH2MHILL
SNC-LAVALIN

DESIGNED BY: S. JUGANAS
DRAWN BY: S. JUGANAS
SCALE: 1:100
DATE: 2015/09/28

CHECKED BY: D. BECKER
APPROVED BY: E. RYCZKOWSKI
BY: T. TURZAK
DATE: 2016/01/29

CONSULTANT NO.: 474248

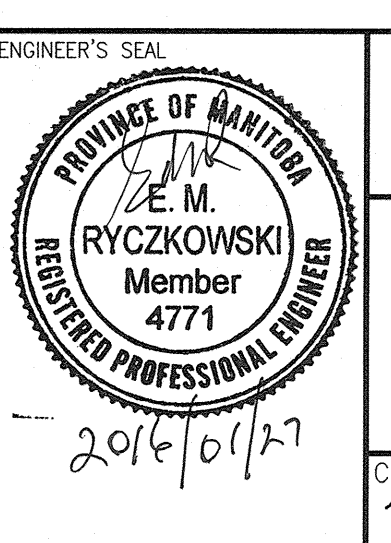

THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

SOUTH END WATER POLLUTION CONTROL CENTRE
SEWPPC UPGRADING/EXPANSION PROJECT
ELECTRICAL - CABLE TRAY LAYOUT
BIOREACTORS/BLOWER BUILDING
BIOREACTOR UPPER LEVEL PLAN

CITY DRAWING NUMBER: 1-0102-ECTR-R003 002
SHEET: 00
REV: 00
A1