


NOTES:

1. THERE IS EXISTING SHORING SYSTEM LOCATED IN THIS AREA.
2. ALL THE COLUMNS ALONG THIS LINE ARE LOCATED ON TOP OF PILES. IF THE COLUMN DO NOT FALL ON TOP OF PILE, CALL THE CONTRACT ADMINISTRATOR AND NOTIFY IMMEDIATELY FOR FURTHER ACTION BEFORE PROCEEDING, TYP FOR ALL COLUMNS.
3. FOR WEeping TILE SYSTEM RUNNING UNDERSIDE THE SLAB, SEE DWG CGAD-001.
4. EXTRA 15-20Mx2200 LONG @ 200 C TO C CENTERED OVER COLUMN C5, TYP. (BOTTOM LAYER)
5. DESIGN SUPERIMPOSED LL=15kPa
6. ONE SIDED FORMWORK WILL BE NECESSARY FOR THIS WALL.

**BASEMENT PLAN - PART B**

1:100

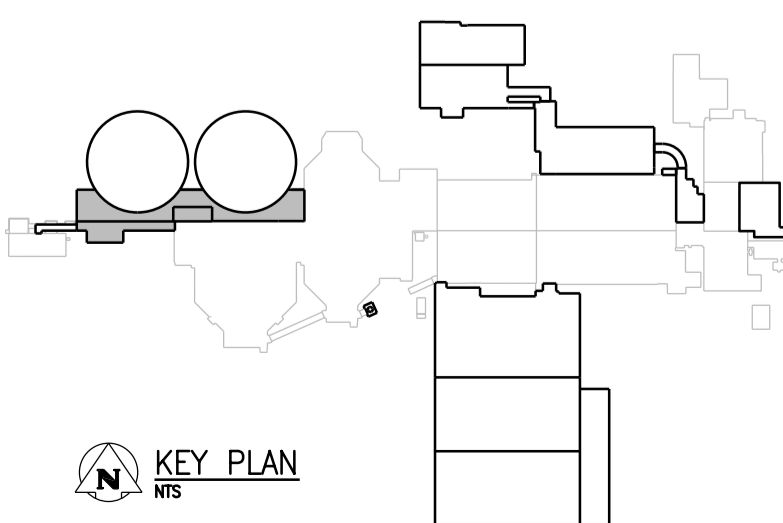

NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER - B.O. 899-2015	01/2016	G.O. J.C.	

<b>CH2MHILL</b>		<b>KCS GROUP</b>	
SNC-LAVALIN		ENGINEER'S SEAL	
DESIGNED BY: A. THAKKAR	CHECKED BY: E. LUI		
DRAWN BY: G. OMORI	APPROVED BY: H.T. FREIHAMMER		
SCALE: 1:100	ISSUED FOR CONSTRUCTION BY: T. TURZAK		
DATE: 2016/01/29	DATE: 2016/01/29	CONSULTANT NO.: 474248	

<p><b>THE CITY OF WINNIPEG</b> WATER AND WASTE DEPARTMENT</p>		
<p>SOUTH END WATER POLLUTION CONTROL CENTRE SEWPPC UPGRADING/EXPANSION PROJECT</p>		
<p>STRUCTURAL SECONDARY CLARIFIERS 4 AND 5 BASEMENT PLAN - PART B</p>		
CITY DRAWING NUMBER 1-0102-SGAD-S005	SHEET 001	REV. SIZE 00 A1