

GENERAL NOTES:

1. FOR CONCRETE FINISHES SEE SPECIFICATIONS
2. SEE DETAILS (0315-803), (0330-004) & (0330-812)
TYPICAL FOR ALL WALLS BELOW GRADE AND ALL LIQUID RETAINING WALLS.
3. 1000mm MIN TYPE 2 CRUSHED STONE COMPACTED TO 98% SPMD IN MAXIMUM LIFTS OF 300mm AGAINST WALL.
4. BACKFILL THE AREA WITH SELECT ONSITE FILL COMPACTED TO 98% SPMD IN MAXIMUM LIFTS OF 300mm.
5. 300mm THICK GEOFOAM ON TOP OF SLAB WITH MAXIMUM 300mm EARTH COVER ON TOP OF GEOFOAM. TYPICAL OVER ENTIRE ROOF SLAB UNLESS NOTED OTHERWISE. PROVIDE 60 MIL PVC SHEET ON TOP OF GEOFOAM OVER ENTIRE FOOTPRINT. TAPE ALL SEAMS. EXTEND UP AND DOWN FROM WALL/SLAB/CURB INTERSECTIONS 1300mm ALL AROUND.
6. PROVIDE WEeping TILE SYSTEM ALL AROUND. SEE DWG CGAD-S001 FOR LAYOUT AND DETAILS.
7. WHERE THE EXCAVATION LINE IS LOCATED BELOW THE UNDERSIDE OF THE VOID FORM, FILL THE AREA WITH CLASS A BACKFILL COMPACTED TO 98% SPMD.


C SECTION - PART C
1:50

SGAD-S001, SGAD-S004,
SGAD-S005, SGAD-S006,
SGAD-S009, SGAD-S010,
SGAD-S011, SGAD-S014,
SGAD-S015, SGAD-S016,
SGAD-S017, SGAD-S018



NO.	REVISIONS	DATE	DESIGN	CHECK
00	ISSUED FOR TENDER - B.O. 899-2015	01/2016	G.O.	J.C.

CH2MHILL		KCS GROUP	
SNC-LAVALIN			
DESIGNED BY: A. THAKKAR	CHECKED BY: E. LUI	ENGINEER'S SEAL	
DRAWN BY: G. OMORI	APPROVED BY: H.T. FREIHAMMER		
SCALE: 1:50	ISSUED FOR CONSTRUCTION BY: T. TURZAK		
DATE: 2016/01/29	DATE: 2016/01/29	CONSULTANT NO.: 474248	

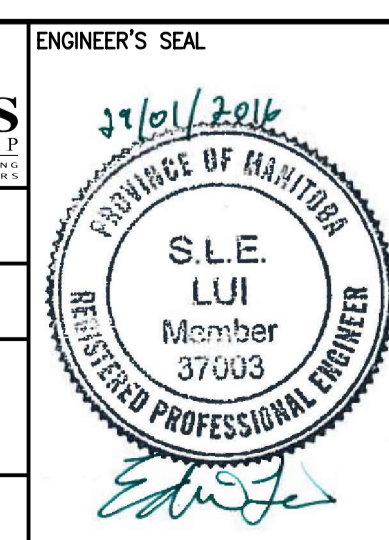

SOUTH END WATER POLLUTION CONTROL CENTRE SEWPCC UPGRADING/EXPANSION PROJECT STRUCTURAL SECONDARY CLARIFIERS 4 AND 5 SECTION C - PART C		
CITY DRAWING NUMBER 1-0102-SGAD-S023	SHEET 001	REV. 00
		SIZE A1