


Issue / rev.

0	2016/12/08	ISSUED FOR CONSTRUCTION
#	date	issue notes

professional seals

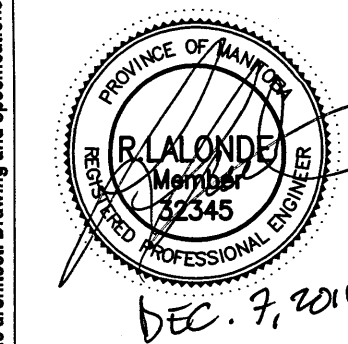

project information

**SEVEN OAKS POOL**

444 Adsum Drive  
Winnipeg, MB  
Canada

client

City of Winnipeg  
4th Floor - 86 King Street  
Winnipeg, MB

drawing information

**ELECTRICAL  
MEZZANINE POWER  
& SYSTEMS - NEW**

drawn by: GCN

approved by:

scale: AS NOTED



date issued: 2016.11.23

proj. #: 14-1736-008

rev. #: R-0

**NOTES:**

1. NEW STROBE TO BE MOUNTED ABOVE EXISTING GLAZING.
2. PROVIDE A SECOND FIRE ALARM CABINET FOR ADDITIONAL POWER FOR NOTIFICATION DEVICES. CONTRACTOR TO CONFIRM FIRE ALARM EQUIPMENT WITH MANUFACTURER.
3. PROVIDE AND INSTALL PLYWOOD BACKING WITHIN THE ELECTRICAL ROOM 200.
4. THIS AREA HAS A NUMBER OF WALLS THAT ARE NOT SHOWN. CONTRACTOR TO COORDINATE ALL STROBE LOCATIONS ON SITE.
5. PROVIDE TELECOM OUTLET COMPLETE WITH THREE (3) CAT 6 CABLES AND TERMINATIONS FOR SECURITY PANEL. INSTALL IN THE MEZZANINE OFFICE ROOM. COORDINATE MOUNTING LOCATION WITH OWNER PRIOR TO INSTALLATION.

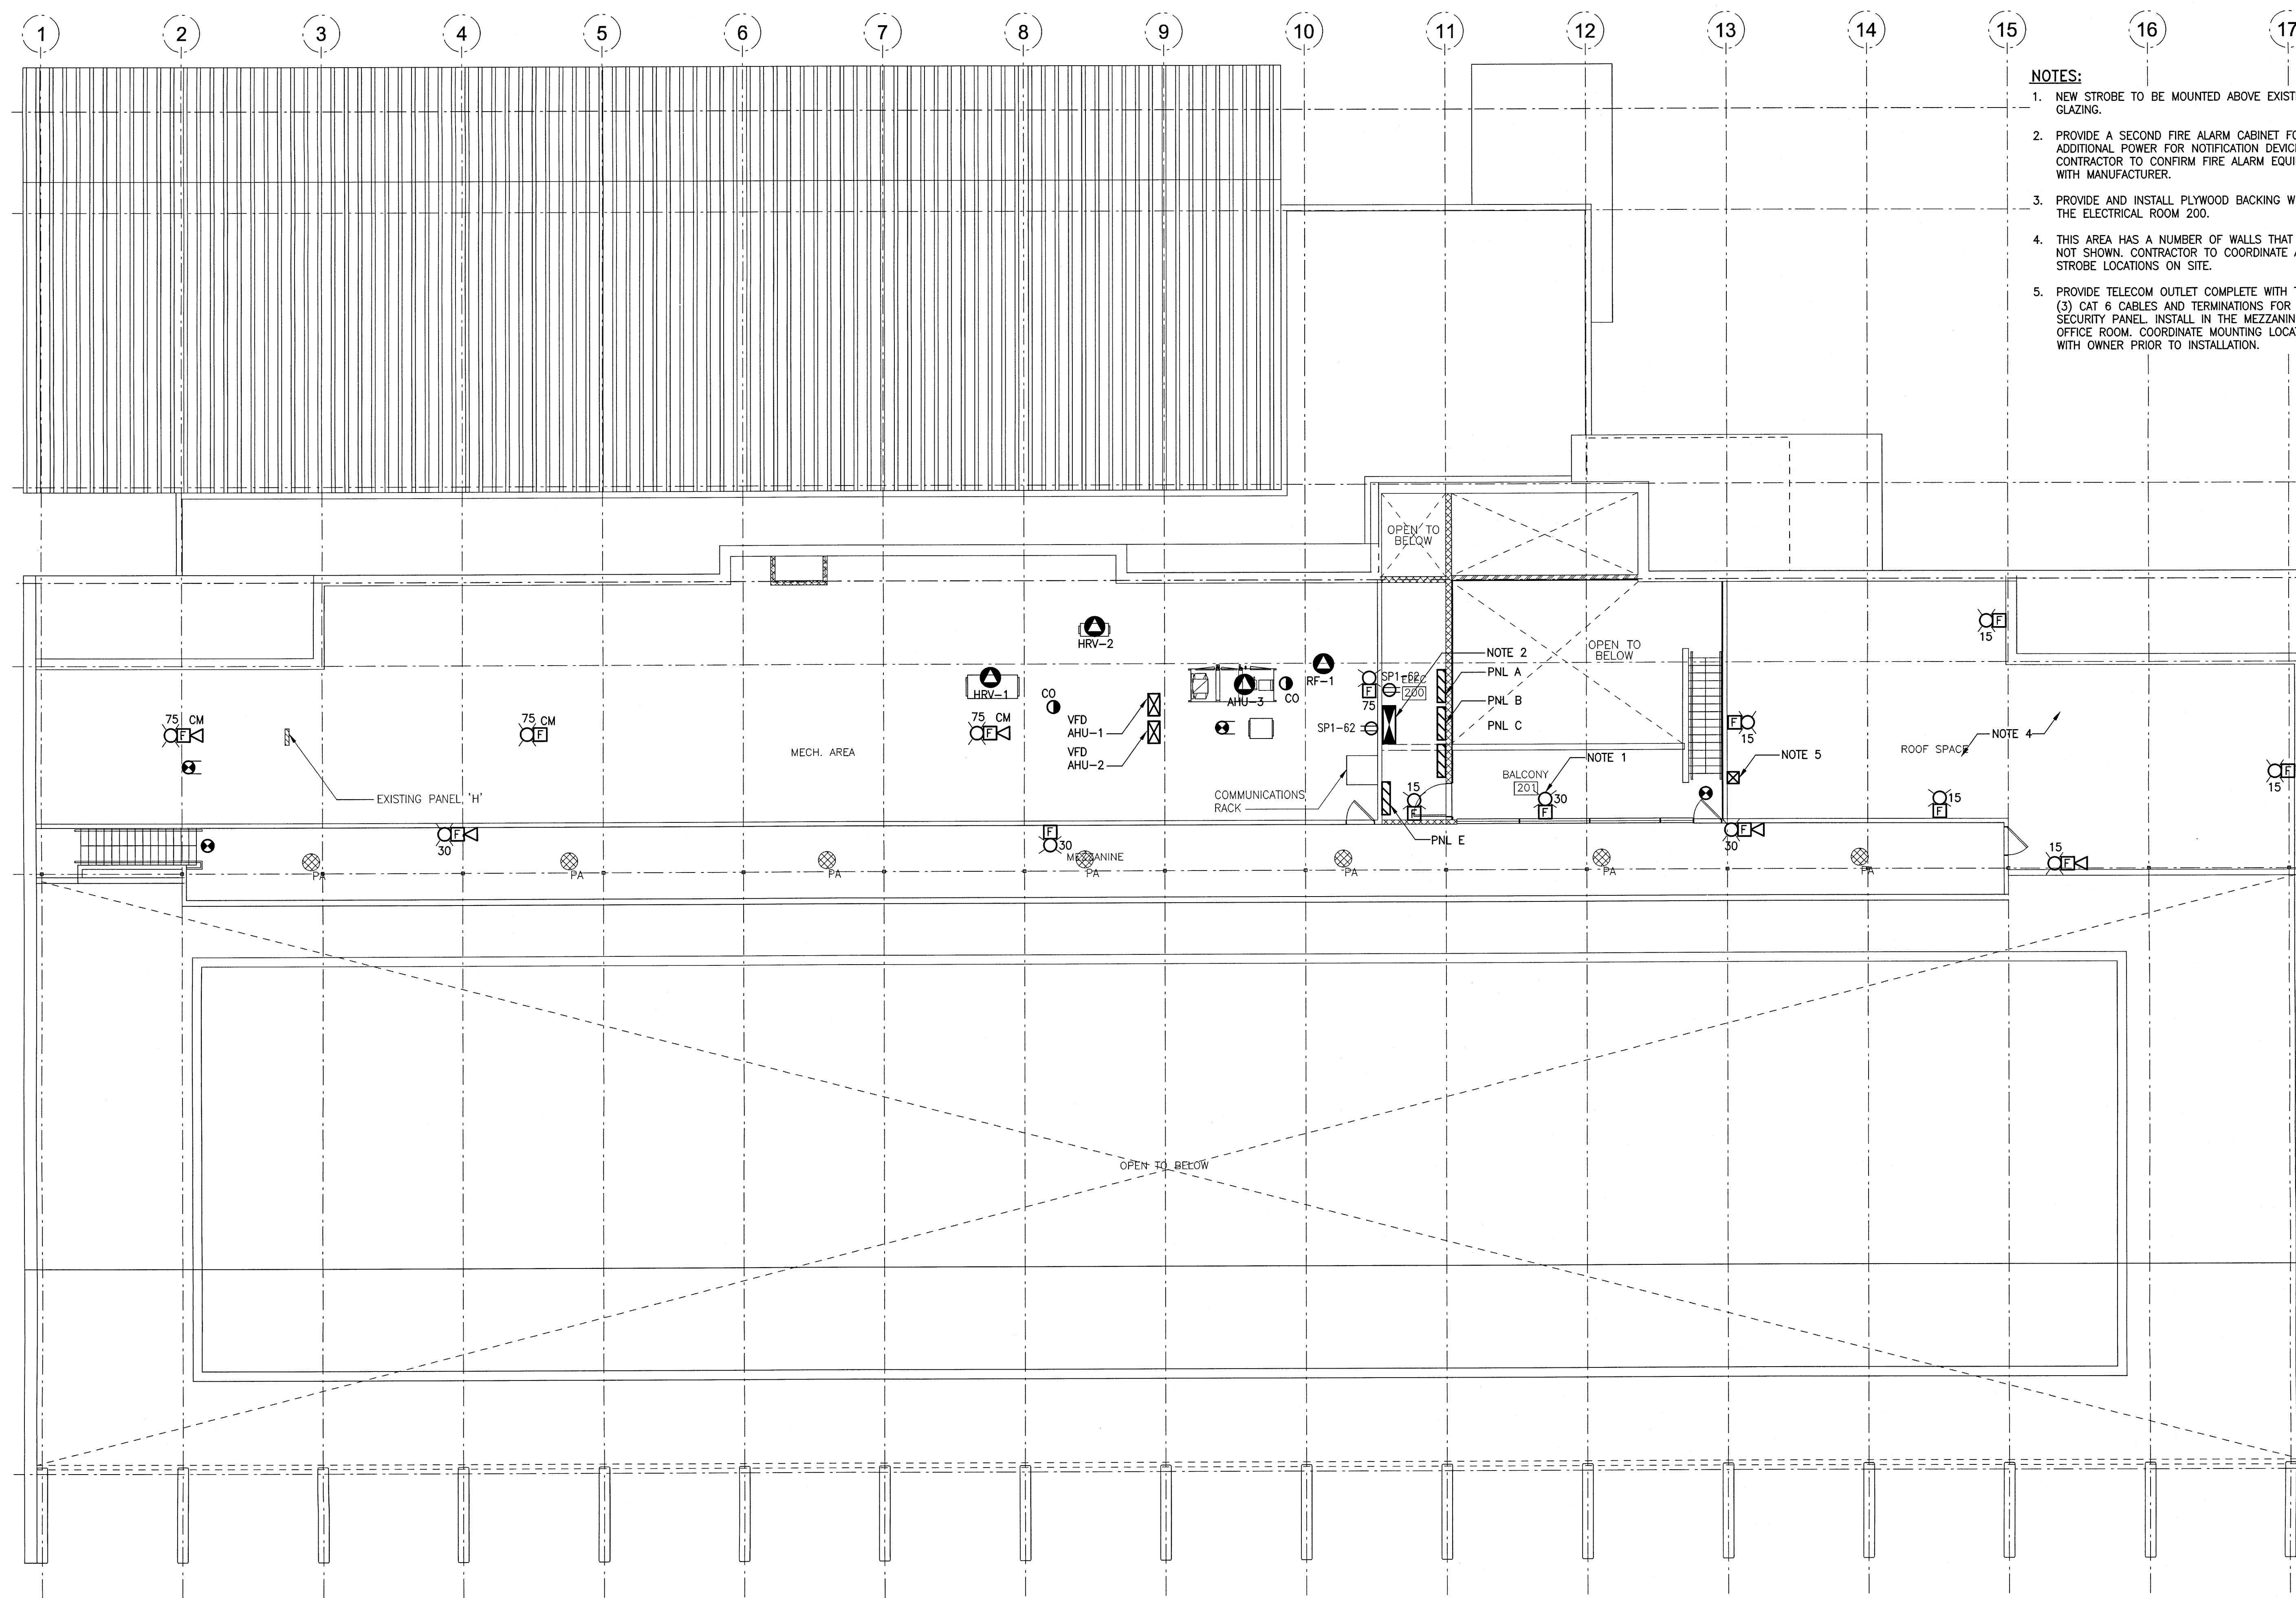

**MEZZANINE POWER/SYSTEMS PLAN - NEW**

2000 0 2000 4000 6000 8000

SCALE: 1:100mm (24"x36")



This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. All discrepancies, errors, and omissions are to be reported to the architect. Drawing and specifications, as instruments of service, are the property of the architect, the copyright in the same being reserved to him. No reproduction may be made without the permission of the architect, and when made, must bear his name. All projects to be returned to the architect on request.