


Issue / rev.

#	date	issue notes
0	2016/12/08	ISSUED FOR CONSTRUCTION

professional seals

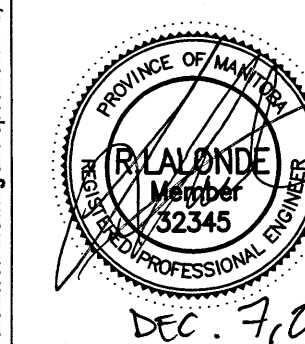

project information

SEVEN OAKS POOL

444 Adsum Drive
Winnipeg, MB
Canada

client

City of Winnipeg
4th Floor - 86 King Street
Winnipeg, MB

drawing information

ELECTRICAL ROOF PLAN NEW



drawn by: GCN
approved by:
scale: AS NOTED
date issued: 2016.11.23
proj. #: 14-1736-008
rev. #: R-0

SEVEN OAKS POOL RENOVATION & ADDITION
BID OPPORTUNITY NO. 1044-2016

**E3
O3**

NOTES:

1. ROOF TOP RECEPTACLES SHALL BE TYPE 5-20R.
2. RELOCATE CU-1. PROVIDE AND INSTALL NEW DISCONNECT SWITCH. PROVIDE AND INSTALL NEW FEEDER TO MATCH EXISTING. USE EXISTING BREAKER #4 OF PANEL '6SD-2'.
3. SUPPLY AND INSTALL DUCT SMOKE DETECTOR IN DUCT INSIDE BUILDING.
4. MOUNT DISCONNECT SWITCH ON RECEPTACLE SUPPORT. PROVIDE ADDITIONAL SUPPORT POST FOR DISCONNECT SWITCH AND MOUNT TO THE SAME PITCH POCKET.

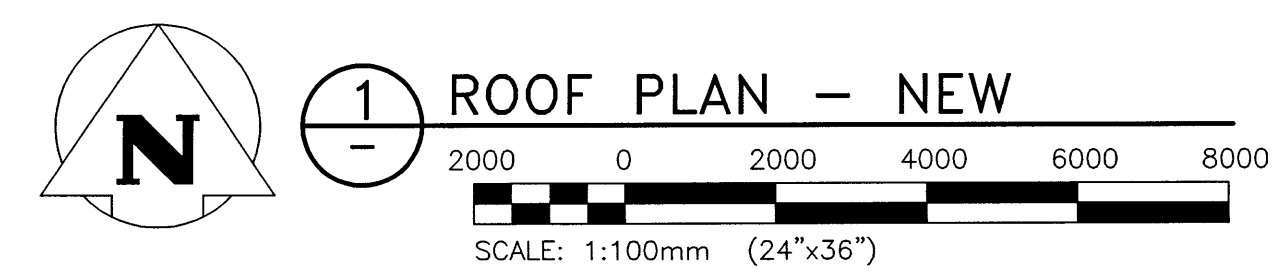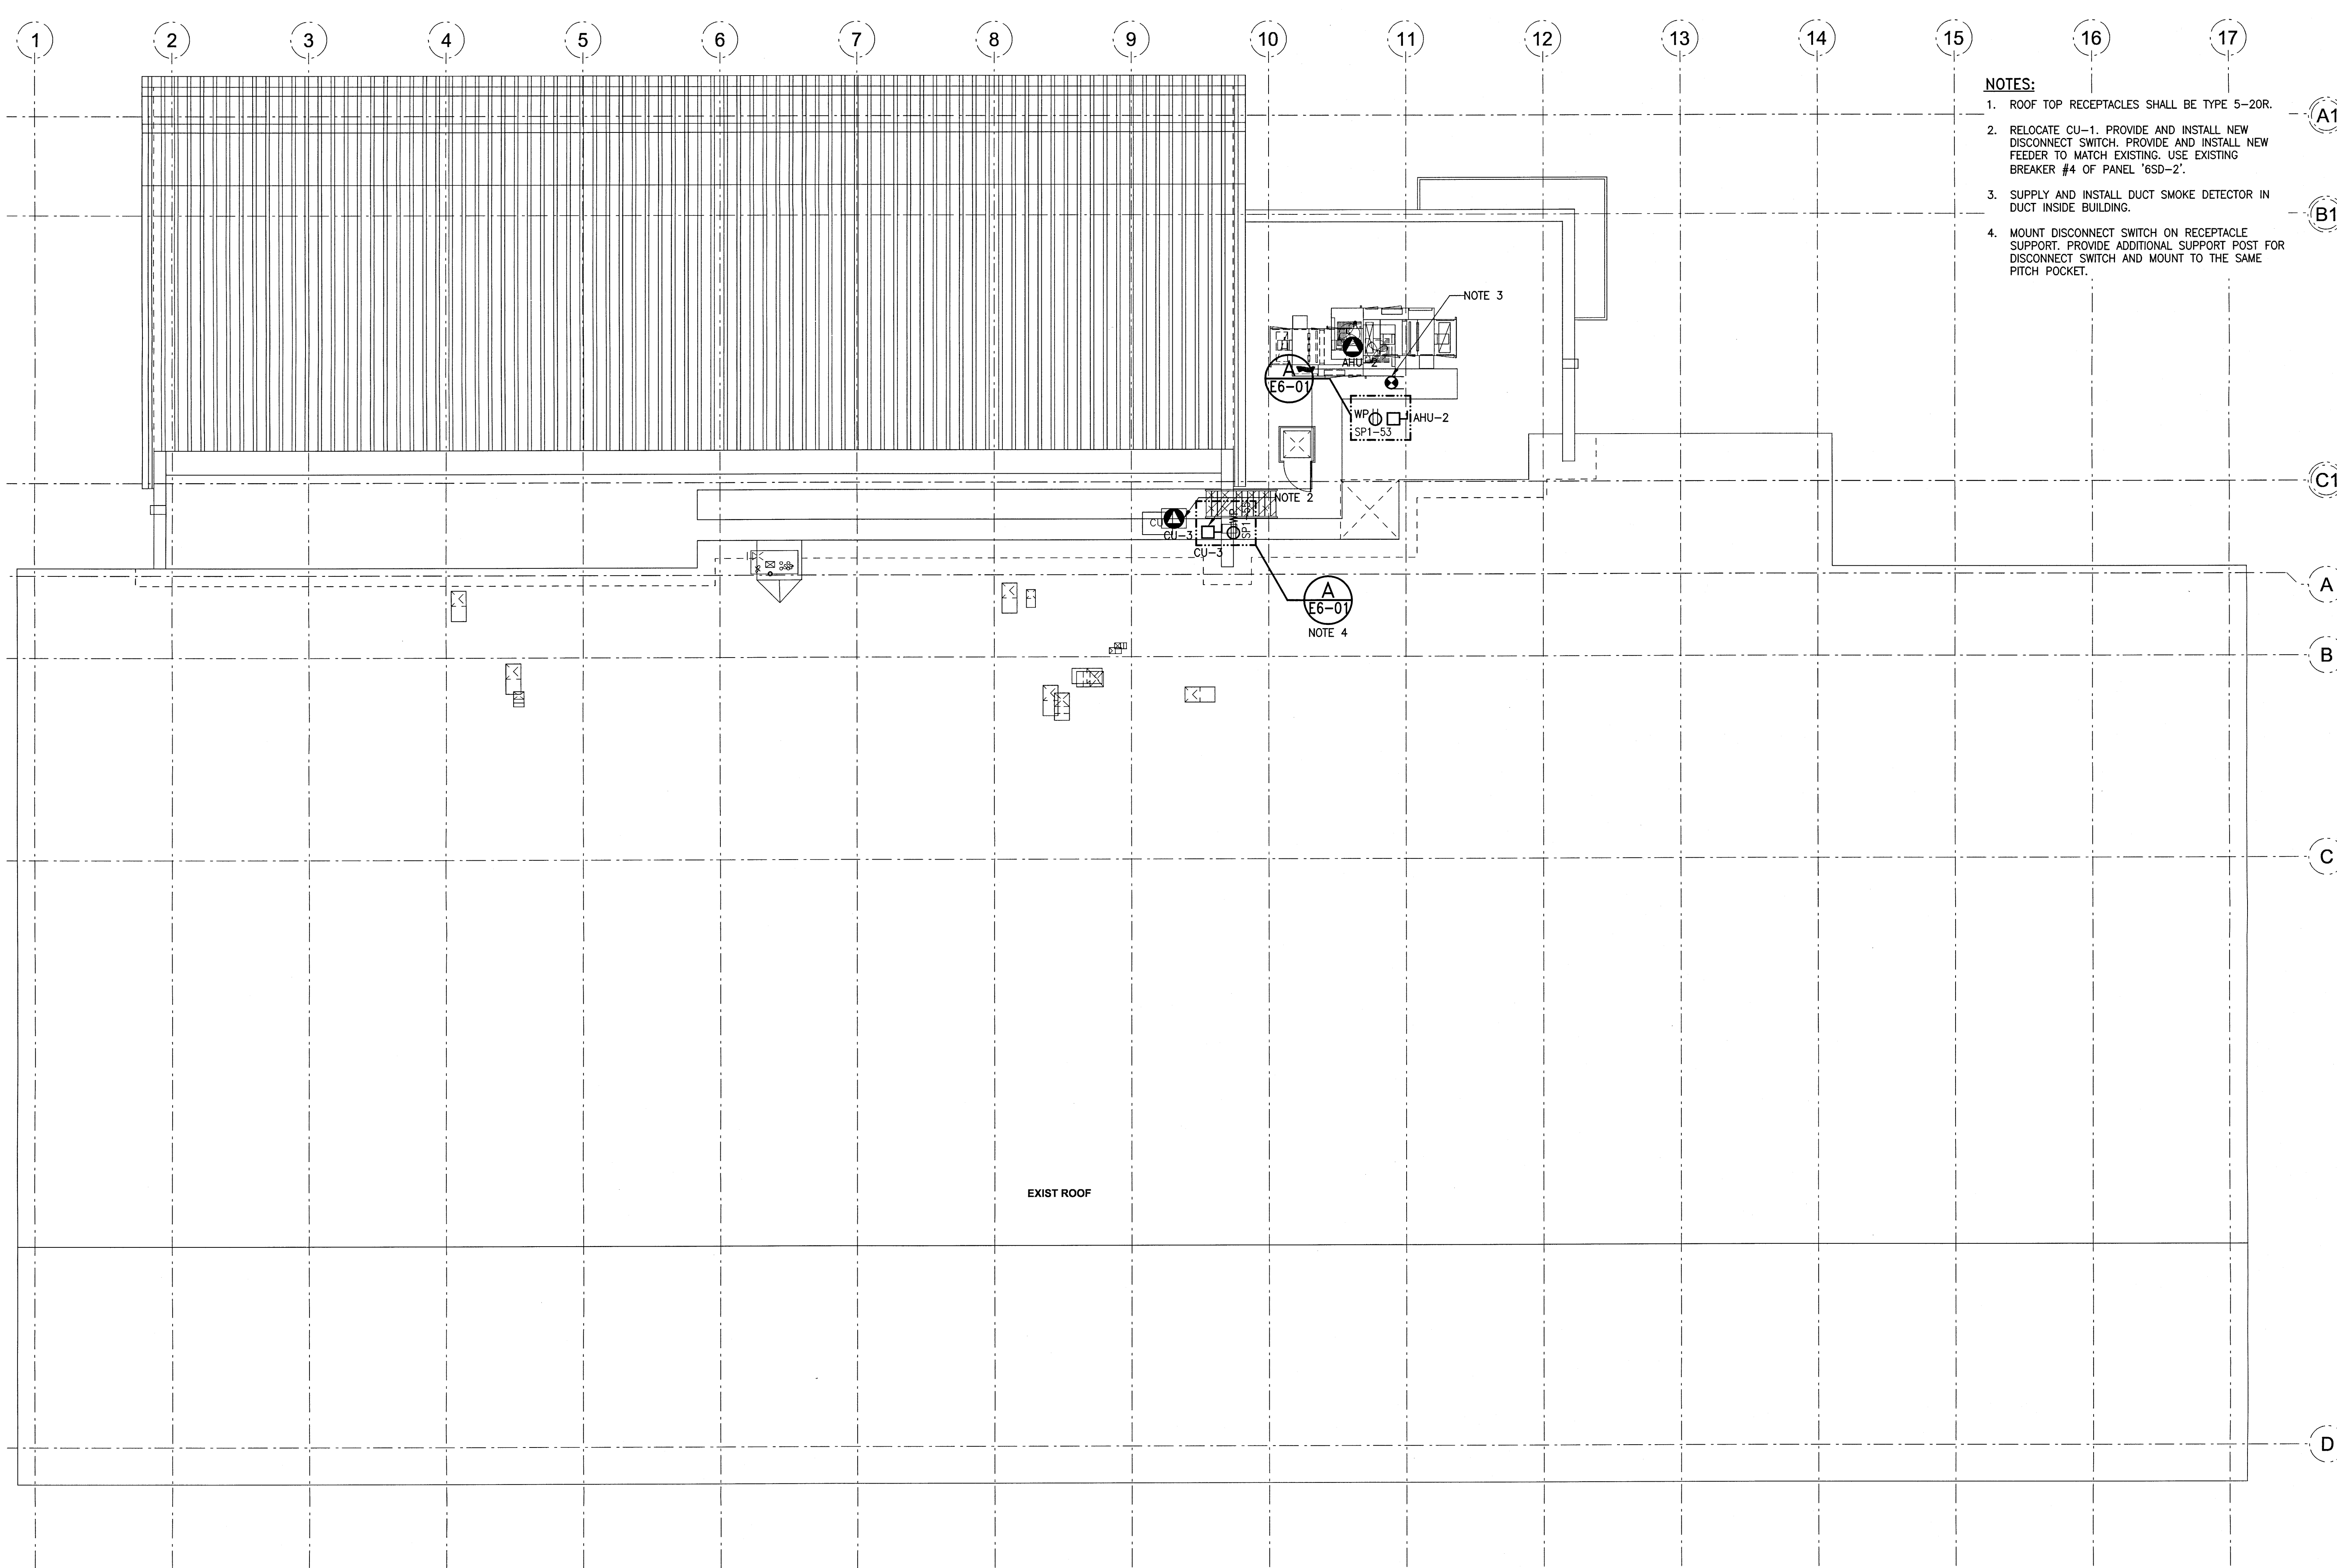

This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. All discrepancies, errors, and omissions are to be reported to the architect. Drawing and specifications, as instruments of service, are the property of the architect, the copyright in the same being reserved to him. No reproduction may be made without the permission of the architect, and when made, must bear his name. All rights to be returned to the architect on request.