



NOTES:

- LUMINAIRE SHALL DIM TO 10% LIGHT OUTPUT WHEN SPACE IS UNOCCUPIED.
- OCCUPANCY SWITCHES AS SHOWN DIAGRAMMATICALLY ONLY. CONTRACTOR SHALL COORDINATE WITH SITE CONDITIONS AND MANUFACTURERS REQUIREMENTS PRIOR TO INSTALLATION.
- RELOCATED STAIRWELL FIXTURE.



1 CRAWLSPACE LIGHTING PLAN - NEW

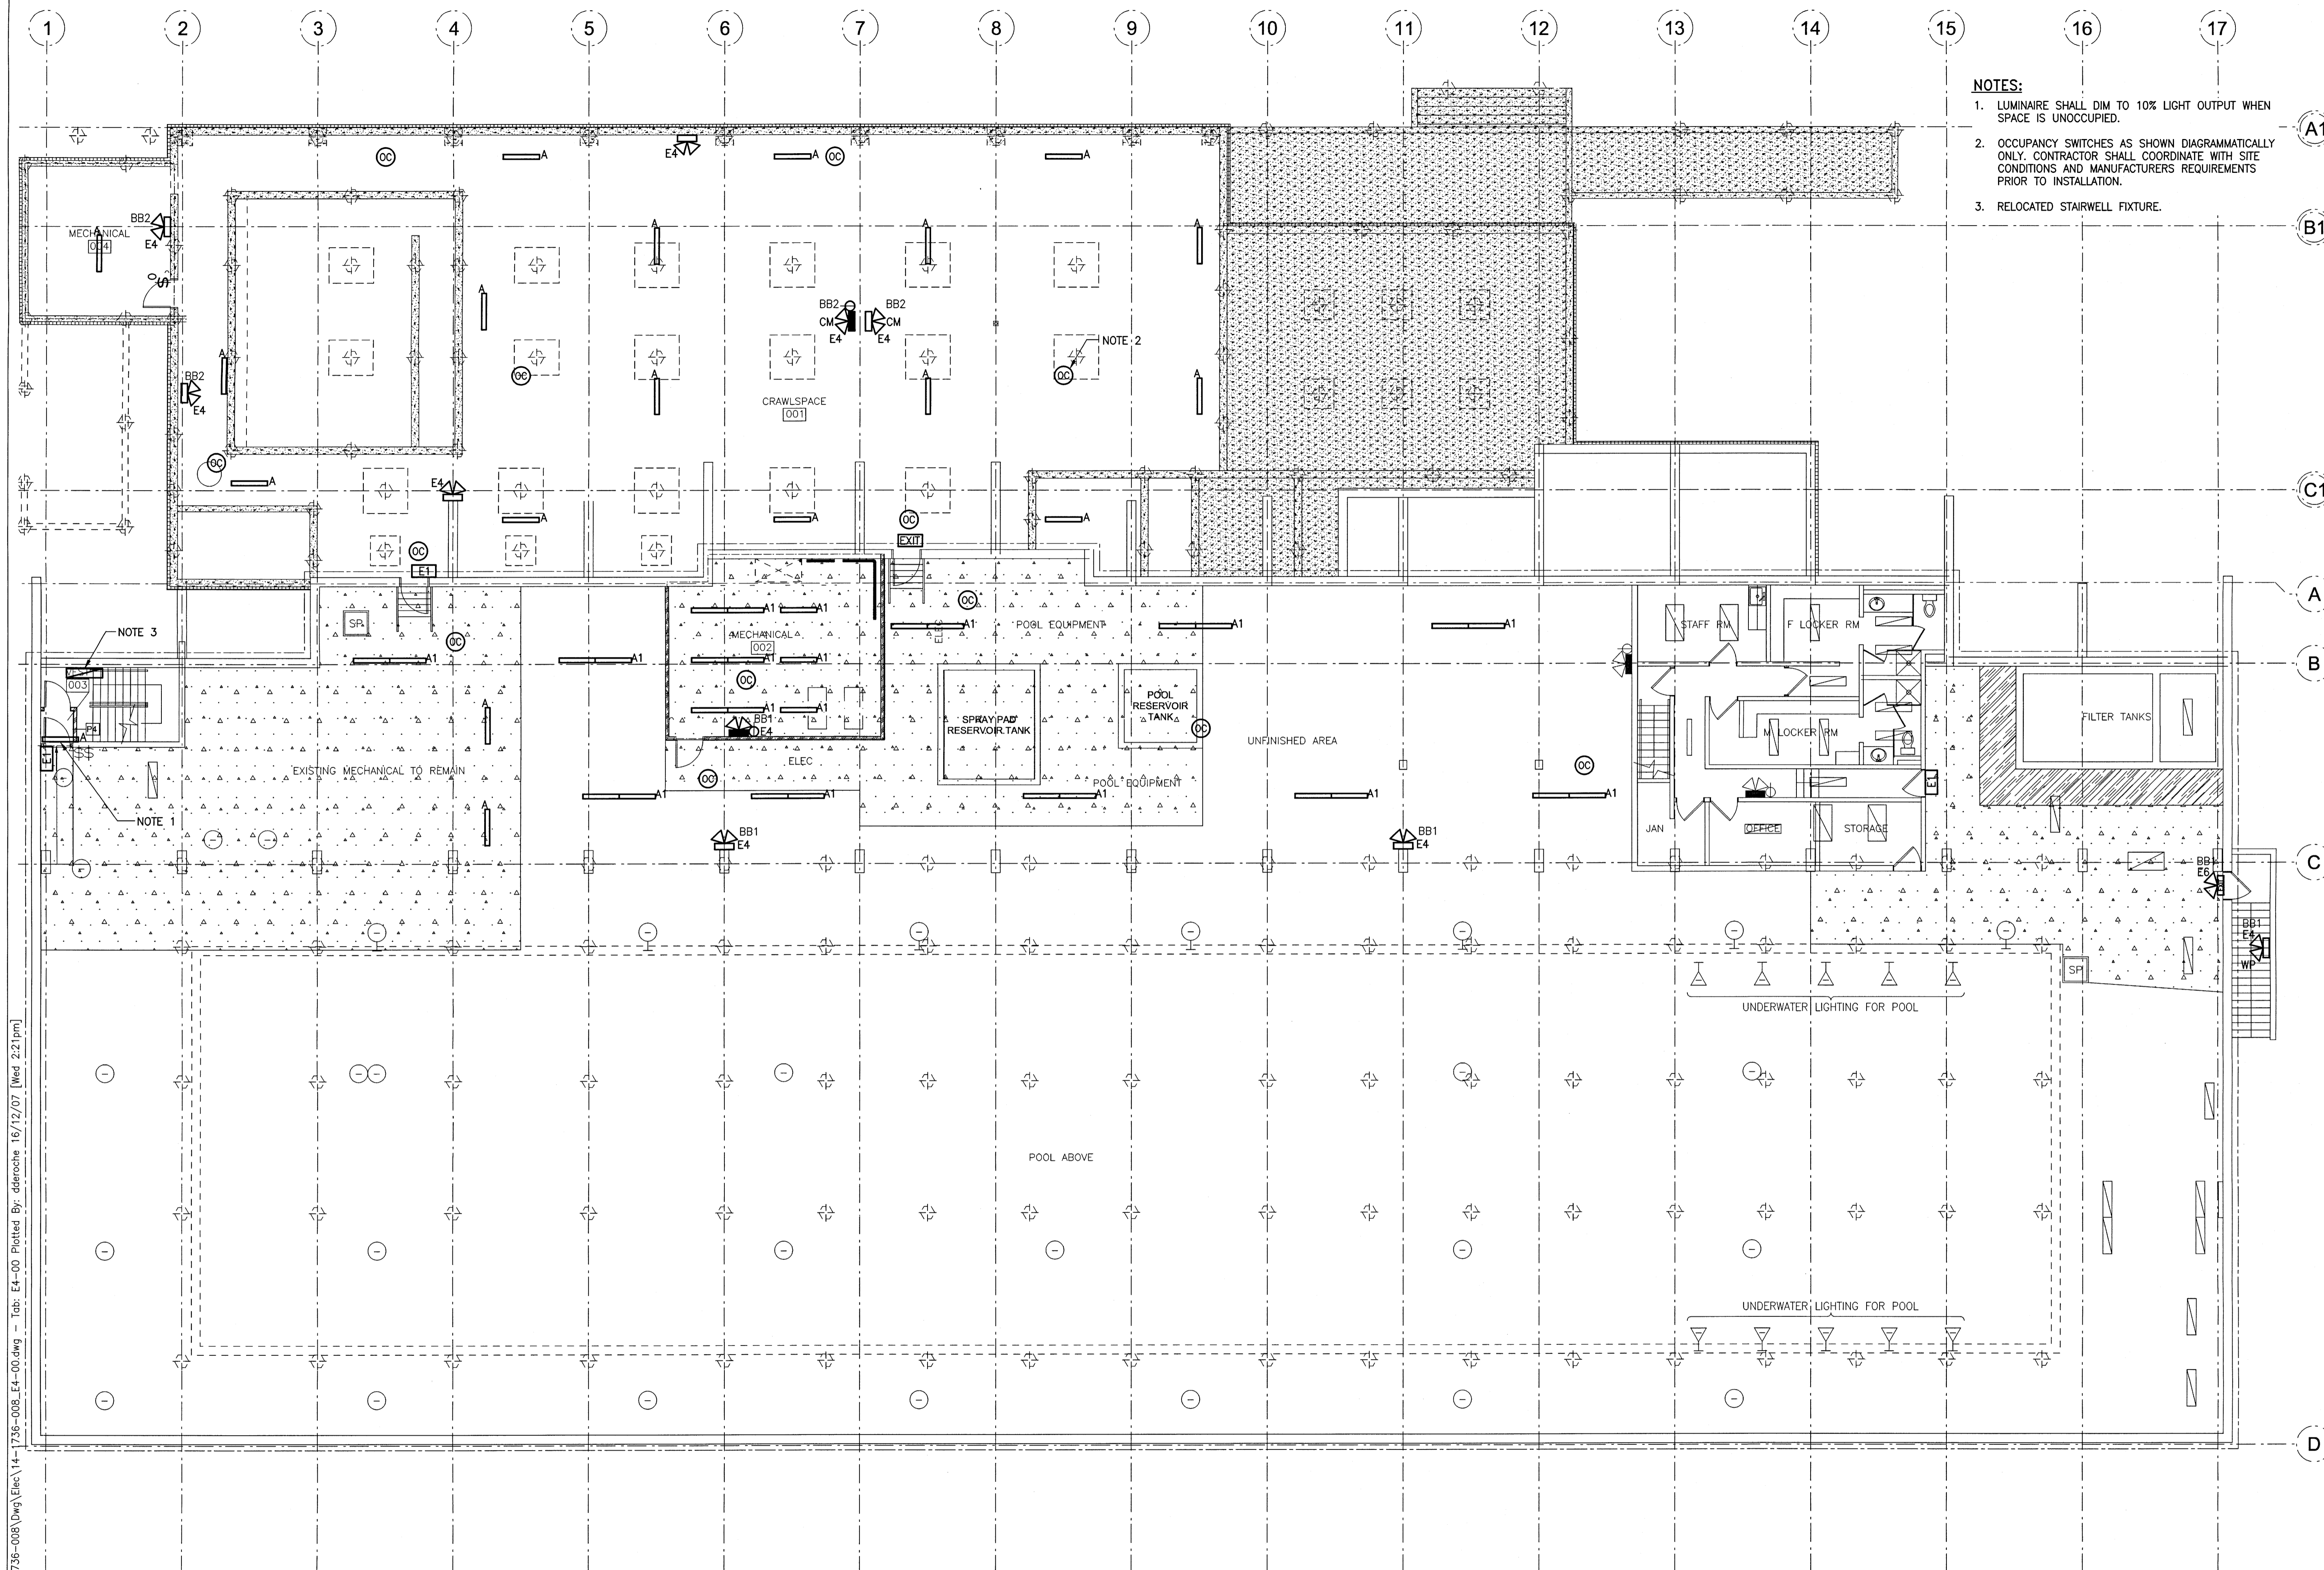