
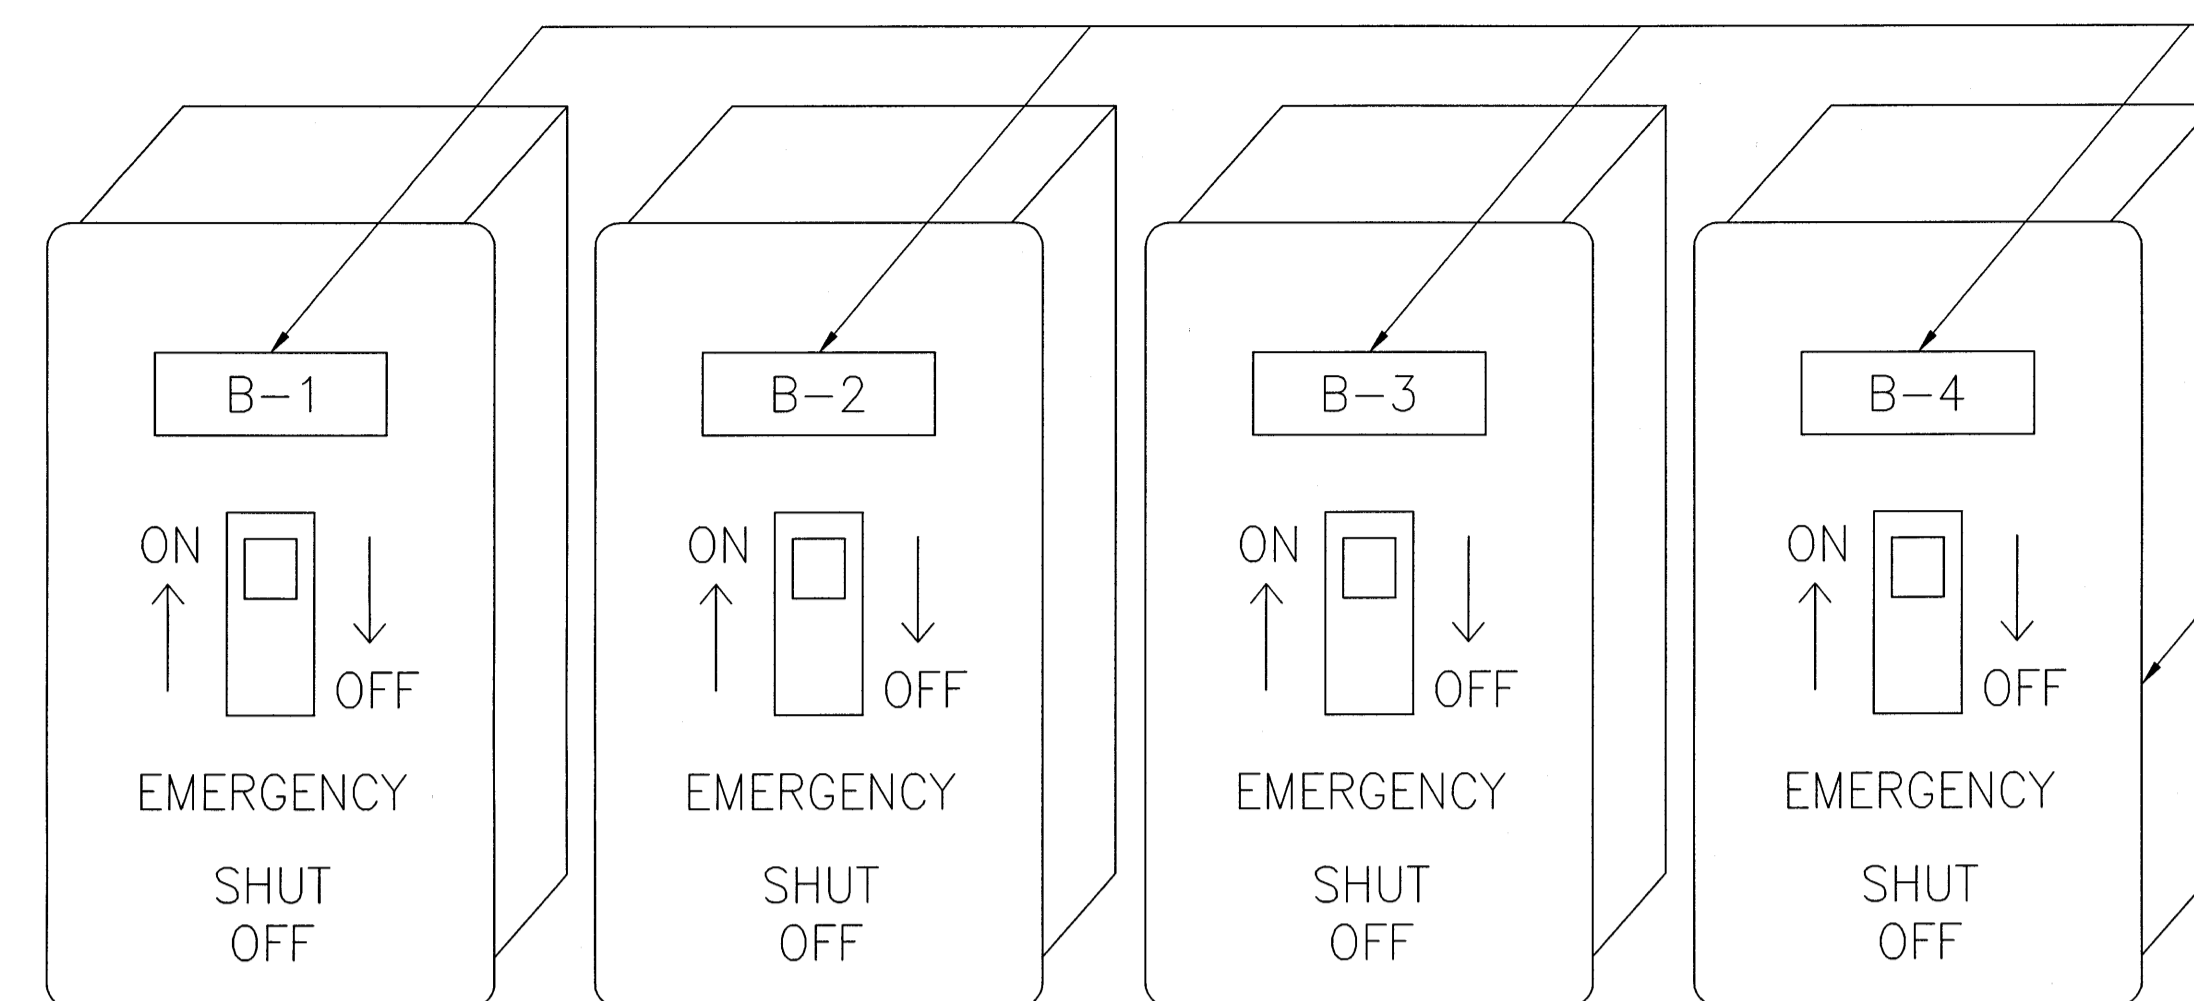


NOTE: REFER TO ARCHITECTURAL DRAWINGS FOR PITCH POCKET DETAILS.

**A** MECHANICAL ROOF TOP EQUIPMENT RECEPTACLE

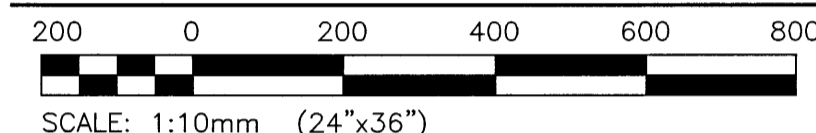


PROVIDE LAMACOID LABELING FOR EMERGENCY SHUT OFF SWITCH AS SHOWN.

RED COVERPLATE (TYP.) INSTALL EMERGENCY SHUT-OFF SWITCHES AT THE ENTRANCE TO THE BOILER ROOM. THE EMERGENCY SWITCHES SHALL BE RED C/W LAMACOID LABELING.


**B** BOILER GAS EMERGENCY SHUT OFF SWITCH

N.T.S.

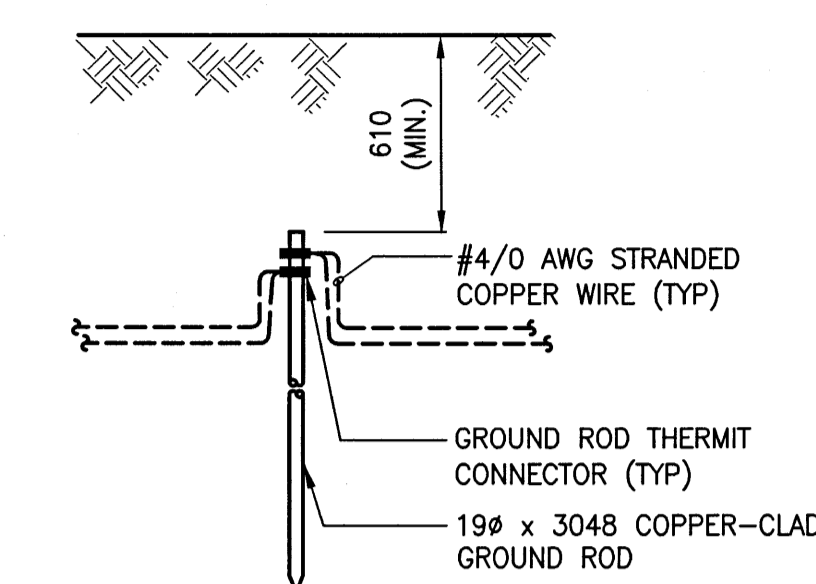

**E** GROUND ROD DETAIL

SCALE: N.T.S.

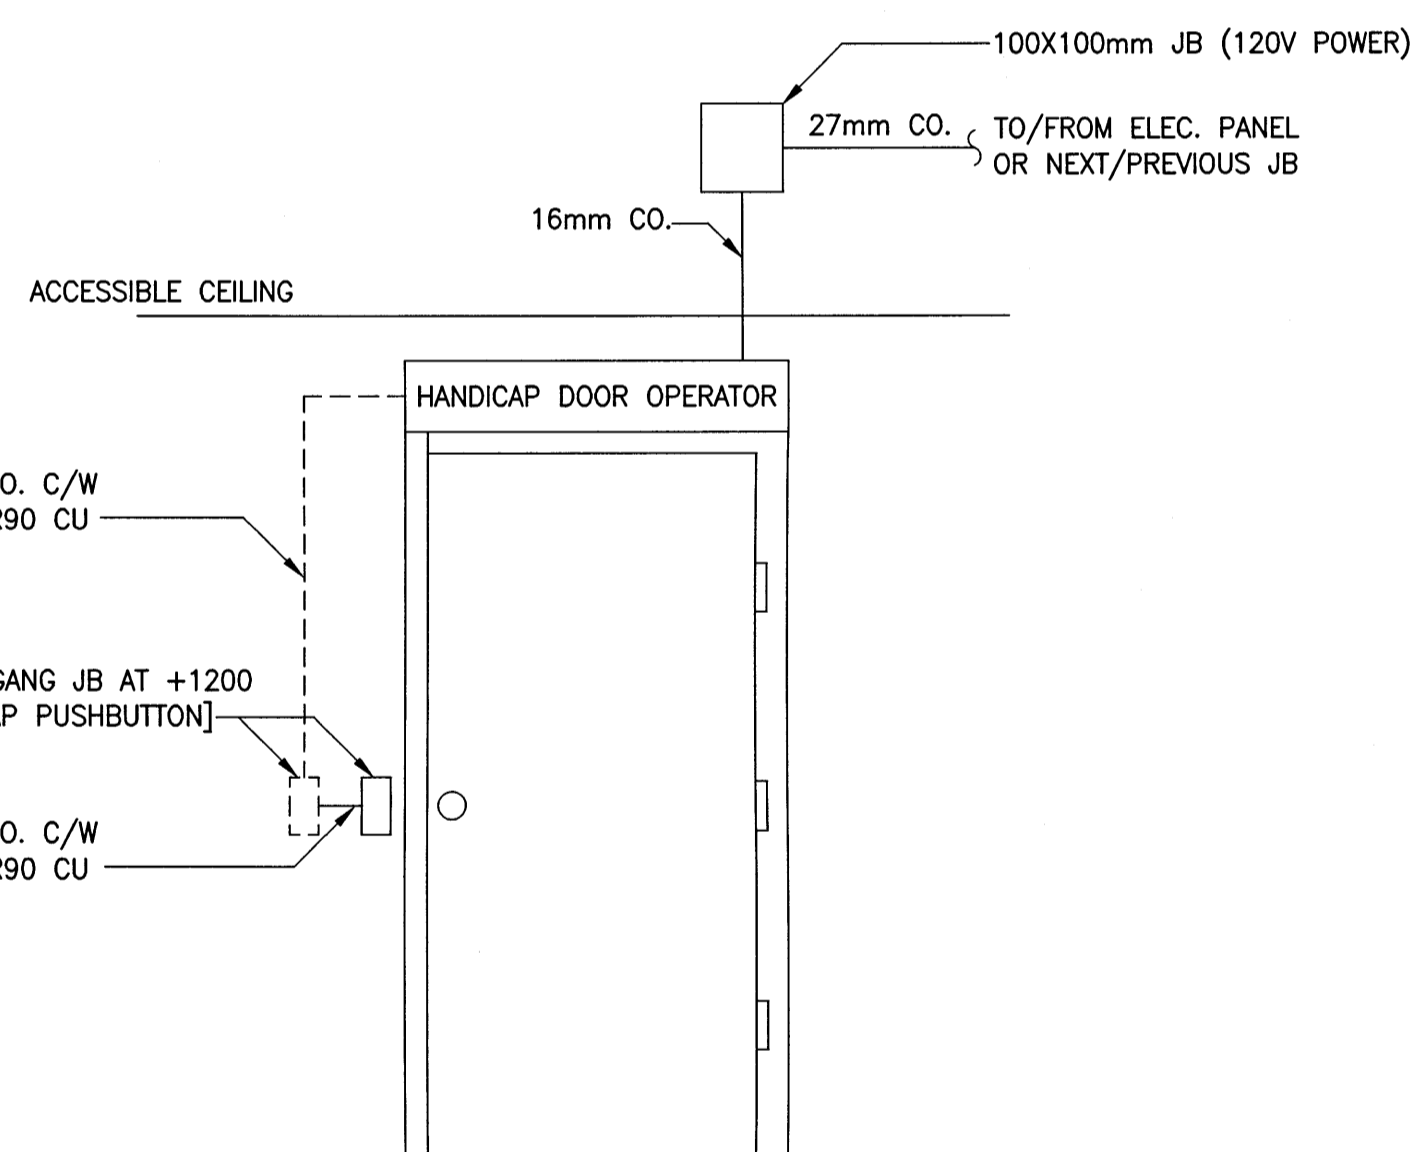


**NOTES:**

- EC TO MAKE ALL CONNECTIONS AND INSTALL ALL DEVICES AS SUPPLIED BY THE HARDWARE CONTRACTOR. PROVIDE ALL LOW VOLTAGE WIRING AND REQUIRED POWER SUPPLIES. (INCLUDE WIRING AND POWER FOR ELECTRIC STRIKE AND LATCH BOLT MONITOR DEVICES WHERE APPLICABLE).

**C** HANDICAP DOOR DETAIL

SCALE: N.T.S.

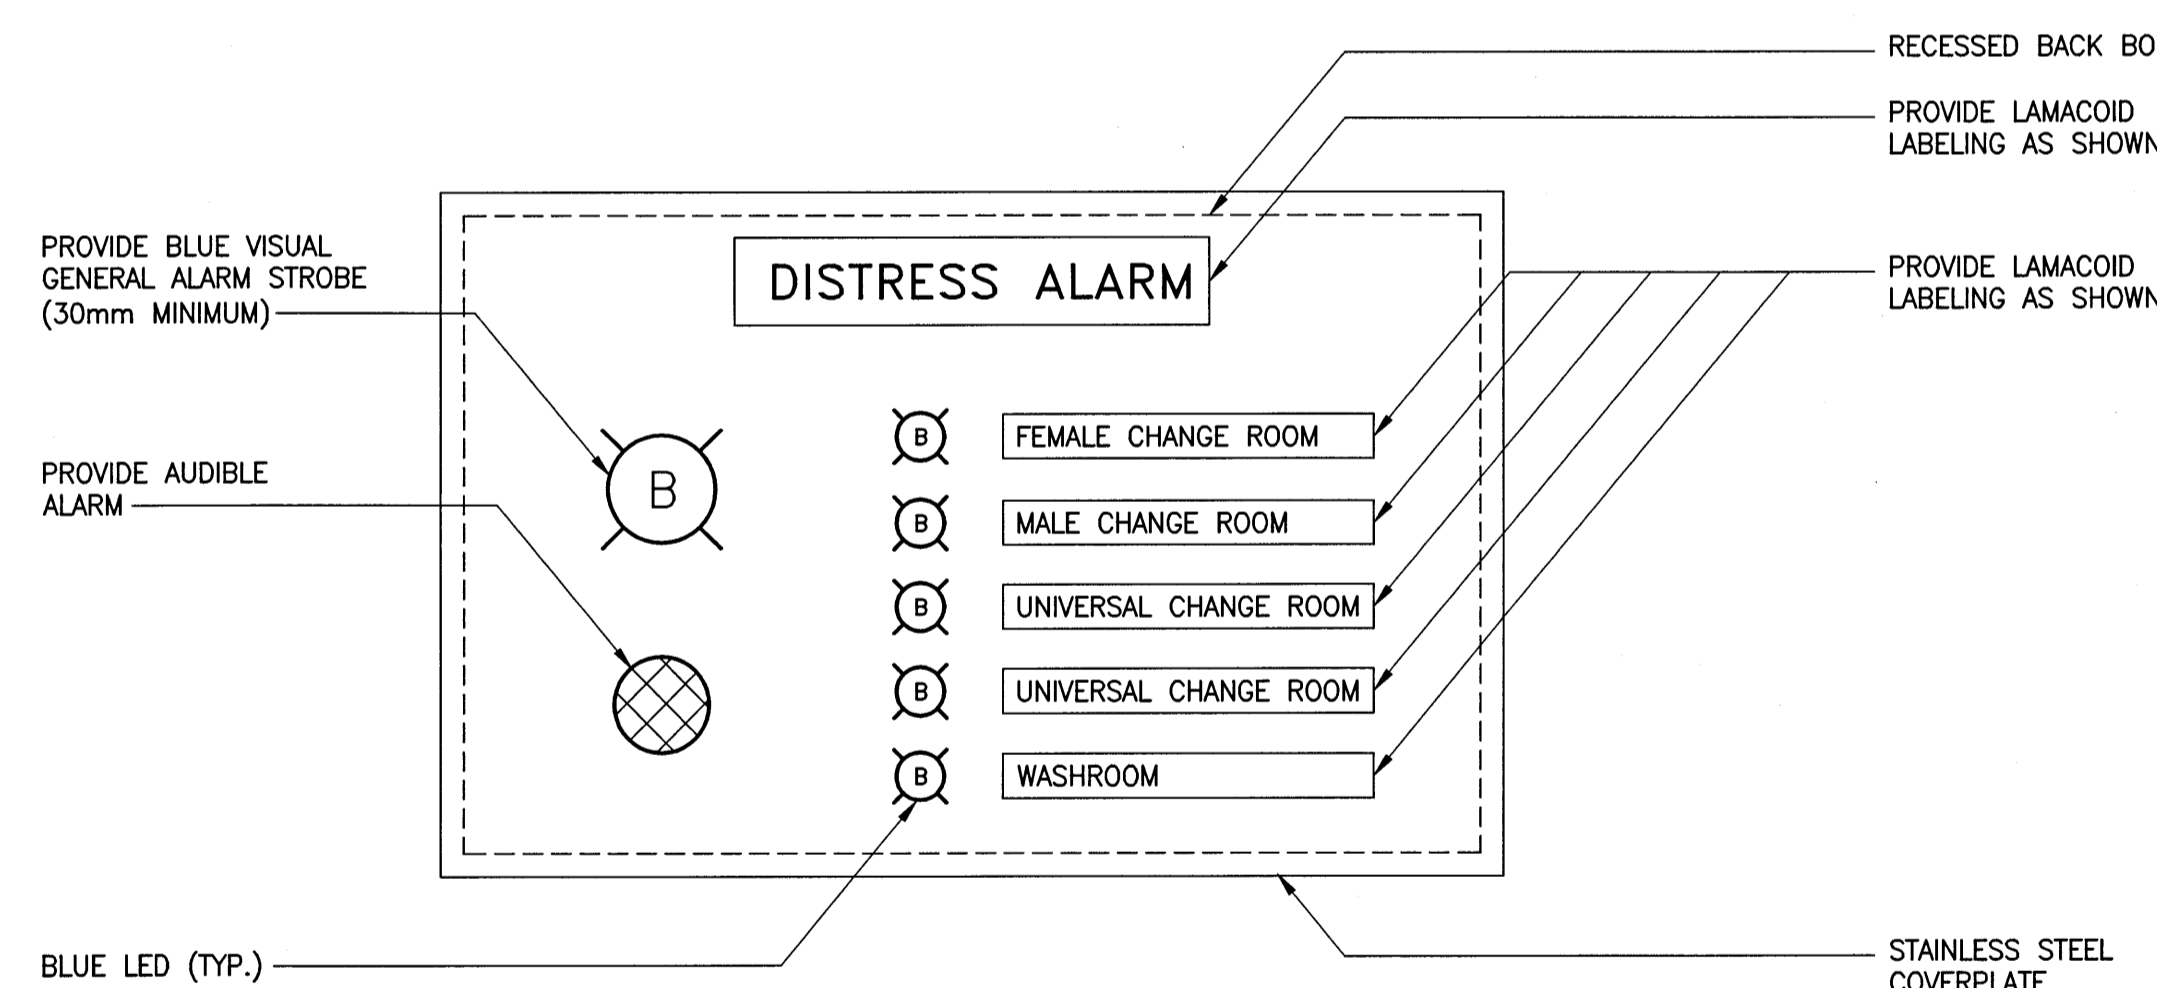


**NOTES:**

- CONTRACTOR SHALL SUBMIT SHOP DRAWINGS INCLUDING WIRING DIAGRAM TO ENGINEER FOR REVIEW.
- PUSH BUTTONS IN WASHROOMS/CHANGE ROOMS SHALL TRIGGER THE GENERAL ALARM STROBE, THE AUDIBLE ALARM AND THE LED INDICATING THAT ROOM ON THE CONTROL PANEL.
- RESET OF ALARM IS ONLY BY THE SAME PUSHBUTTON IN THE WASHROOM/CHANGE ROOM.
- CONTRACTOR TO ENSURE CONTROL PANEL IS FULLY RECESSED AND FLUSH WITH NEW WALL FINISH. BACK BOX SHALL BE COORDINATED AT TIME OF SHOP DRAWING STAGE WITH CONTRACTOR PRIOR TO WALL CONSTRUCTION.

**D** DISTRESS ALARM PANEL

SCALE: N.T.S.

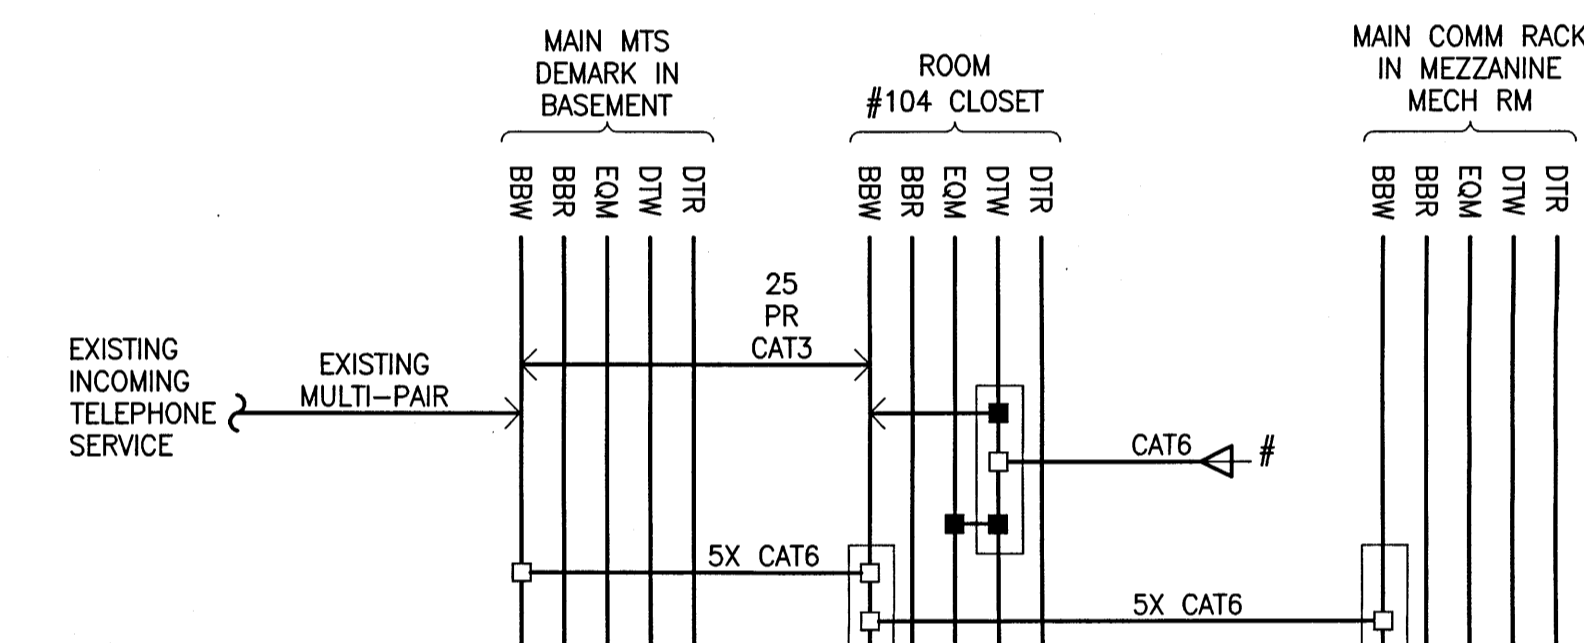


**LEGEND:**

- IDC/BIX TERMINATION
- IDC/BIX CROSS-CONNECT WIRES
- PATCH CORD IDC/BIX PIGTAIL TO RJ45 PLUG
- PATCH CORD RJ-45 PLUG
- PATCH PANEL RJ-45 JACK
- DATA OUTLET (TYP.)
- BBW BACKBONE TERMINATION - WALL MOUNTED
- BBR BACKBONE TERMINATION - RACK MOUNTED
- DTW DISTRIBUTION TERMINATION - WALL MOUNTED
- DTR DISTRIBUTION TERMINATION - RACK MOUNTED
- EQM EQUIPMENT

**F** STRUCTURED CABLING SCHEMATIC

SCALE: N.T.S.

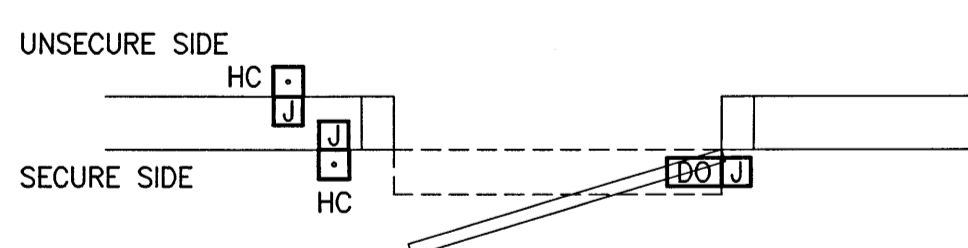

**G** PROPOSED TELECOM RACK LAYOUT

SCALE: N.T.S.

