


KEYNOTES:

- 1 RETAIN EXISTING EXHAUST DUCT TO TIE INTO NEW EXHAUST SYSTEM.
- 2 REMOVE EXISTING DUCT. RETAIN PENETRATIONS FOR NEW DUCTWORK AND GRILLES.
- 3 RETAIN EXISTING DUCT SERVING MEZZANINE OFFICE. MODIFY DUCT TO SUIT NEW DESIGN.
- 4 RETAIN WASHROOM AND CHLORINE EXHAUST SYSTEM.
- 5 RETAIN EXISTING POOL EXHAUST SYSTEM.
- 6 REMOVE EXHAUST FAN F-4 AND ASSOCIATED DUCTWORK TO EXTENT SHOWN.
- 7 REMOVE SUPPLY DUCT TO EXTENT SHOWN AND CAP SUPPLY DUCT AT FLOOR LEVEL.
- 8 REMOVE EXISTING AIR HANDLER AND ASSOCIATED DUCTWORK, CONTROLS, AND EQUIPMENT.
- 9 REMOVE EXISTING WALL A/C UNIT AND DISPOSE OF OFF SITE. PATCH HOLE IN WALL.
- 10 RETAIN EXISTING WATER HEATER AND MOP SINK (NOT SHOWN FOR CLARITY).
- 11 REMOVE EXISTING ELECTRIC HEATING COIL AND DISPOSE OF OFF SITE. REMOVE ALL RELATED POWER AND CONTROLS.

Issue / rev.

0	2016/12/08	ISSUED FOR CONSTRUCTION
#	date	issue notes

professional seals

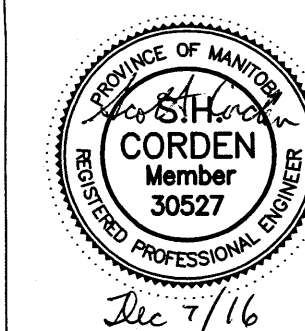

project information

SEVEN OAKS POOL

444 Adsum Drive
Winnipeg, MB
Canada

client

City of Winnipeg
4th Floor - 86 King Street
Winnipeg, MB

drawing information

**MECHANICAL
MEZZANINE FLOOR PLAN
HVAC - DEMO**

drawn by: RLR

approved by:

scale: AS NOTED


date issued: 2016.12.08

proj. #: 14-1736-008

rev. #: R-0

**SEVEN OAKS POOL
RENOVATION & ADDITION**

BID OPPORTUNITY NO. 1044-2016

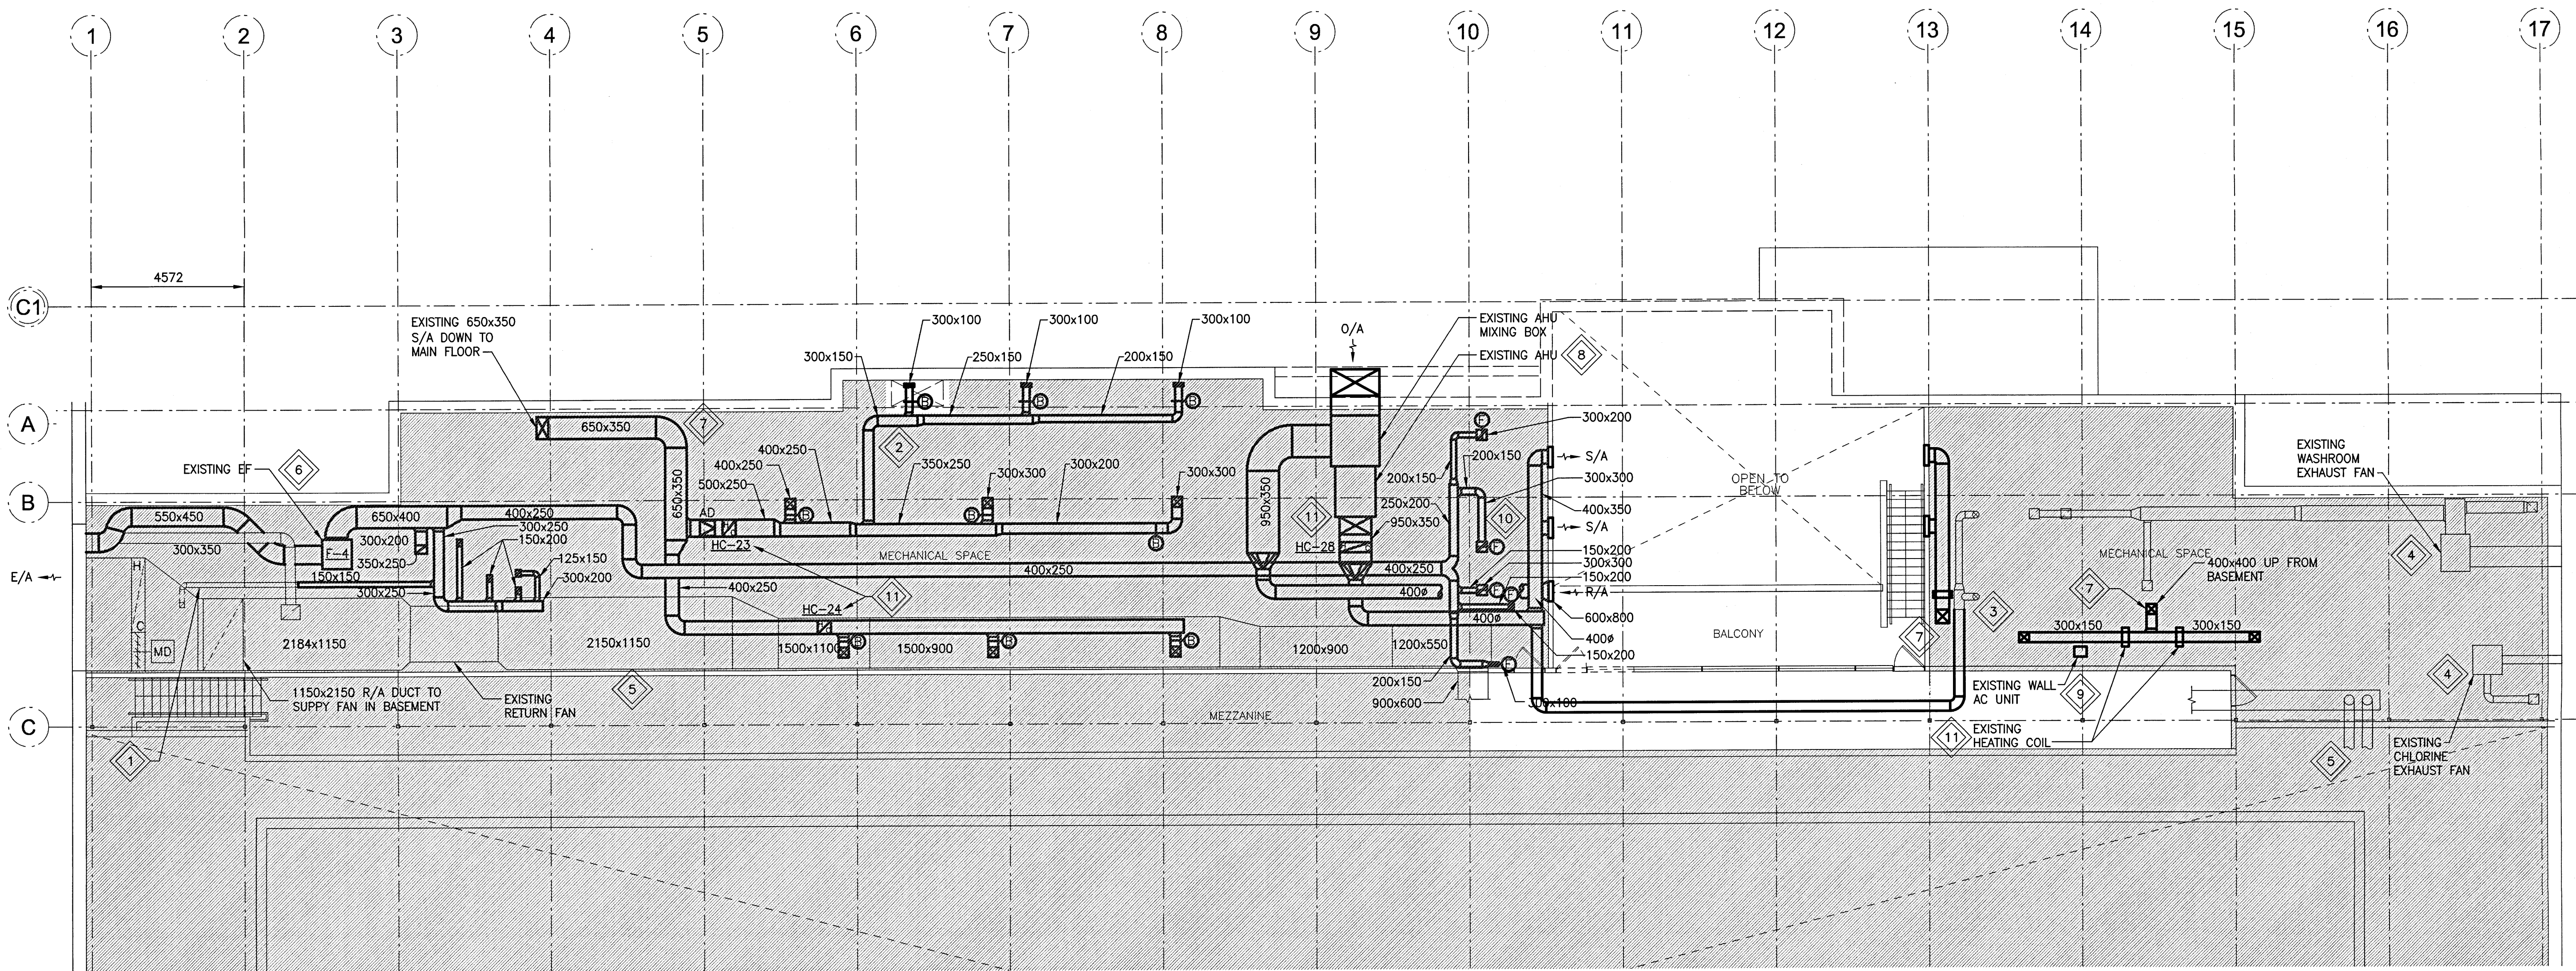

1 MEZZANINE PLAN - HVAC DEMO
SCALE: 1:100

SCALE VERIFIED BY:

