


KEYNOTES:

- 1 NOT USED.
- 2 PROVIDE NEW DUCT IN CRAWLSPACE TO SERVE EXISTING GRILLES AND DIFFUSERS. PROVIDE NEW DUCTWORK CONNECTIONS TO SUIT EXISTING CONDITIONS.
- 3 REMOVE EXISTING DUCT HEATERS AND PROVIDE DUCT CONNECTION TO NEW SUPPLY AIR DUCT. RETAIN EXISTING GRILLES AND 300x300 PLENUMS. PROVIDE AIR BALANCE.
- 4 SUPPLY AND INSTALL NEW HRV-3, RHC-12 AND ASSOCIATED DUCTWORK. HANG FROM CEILING WITH VIBRATION ISOLATORS AND FLEXIBLE DUCT CONNECTIONS. RUN CONDENSATE PIPING TO NEAREST DRAIN. REFER TO DRAWING M3-01 FOR GRILLE SCHEDULE.
- 5 INSTALL NEW ELECTRIC HEATER HUNG FROM CEILING. HEATER SHALL HAVE INTEGRAL THERMOSTAT.

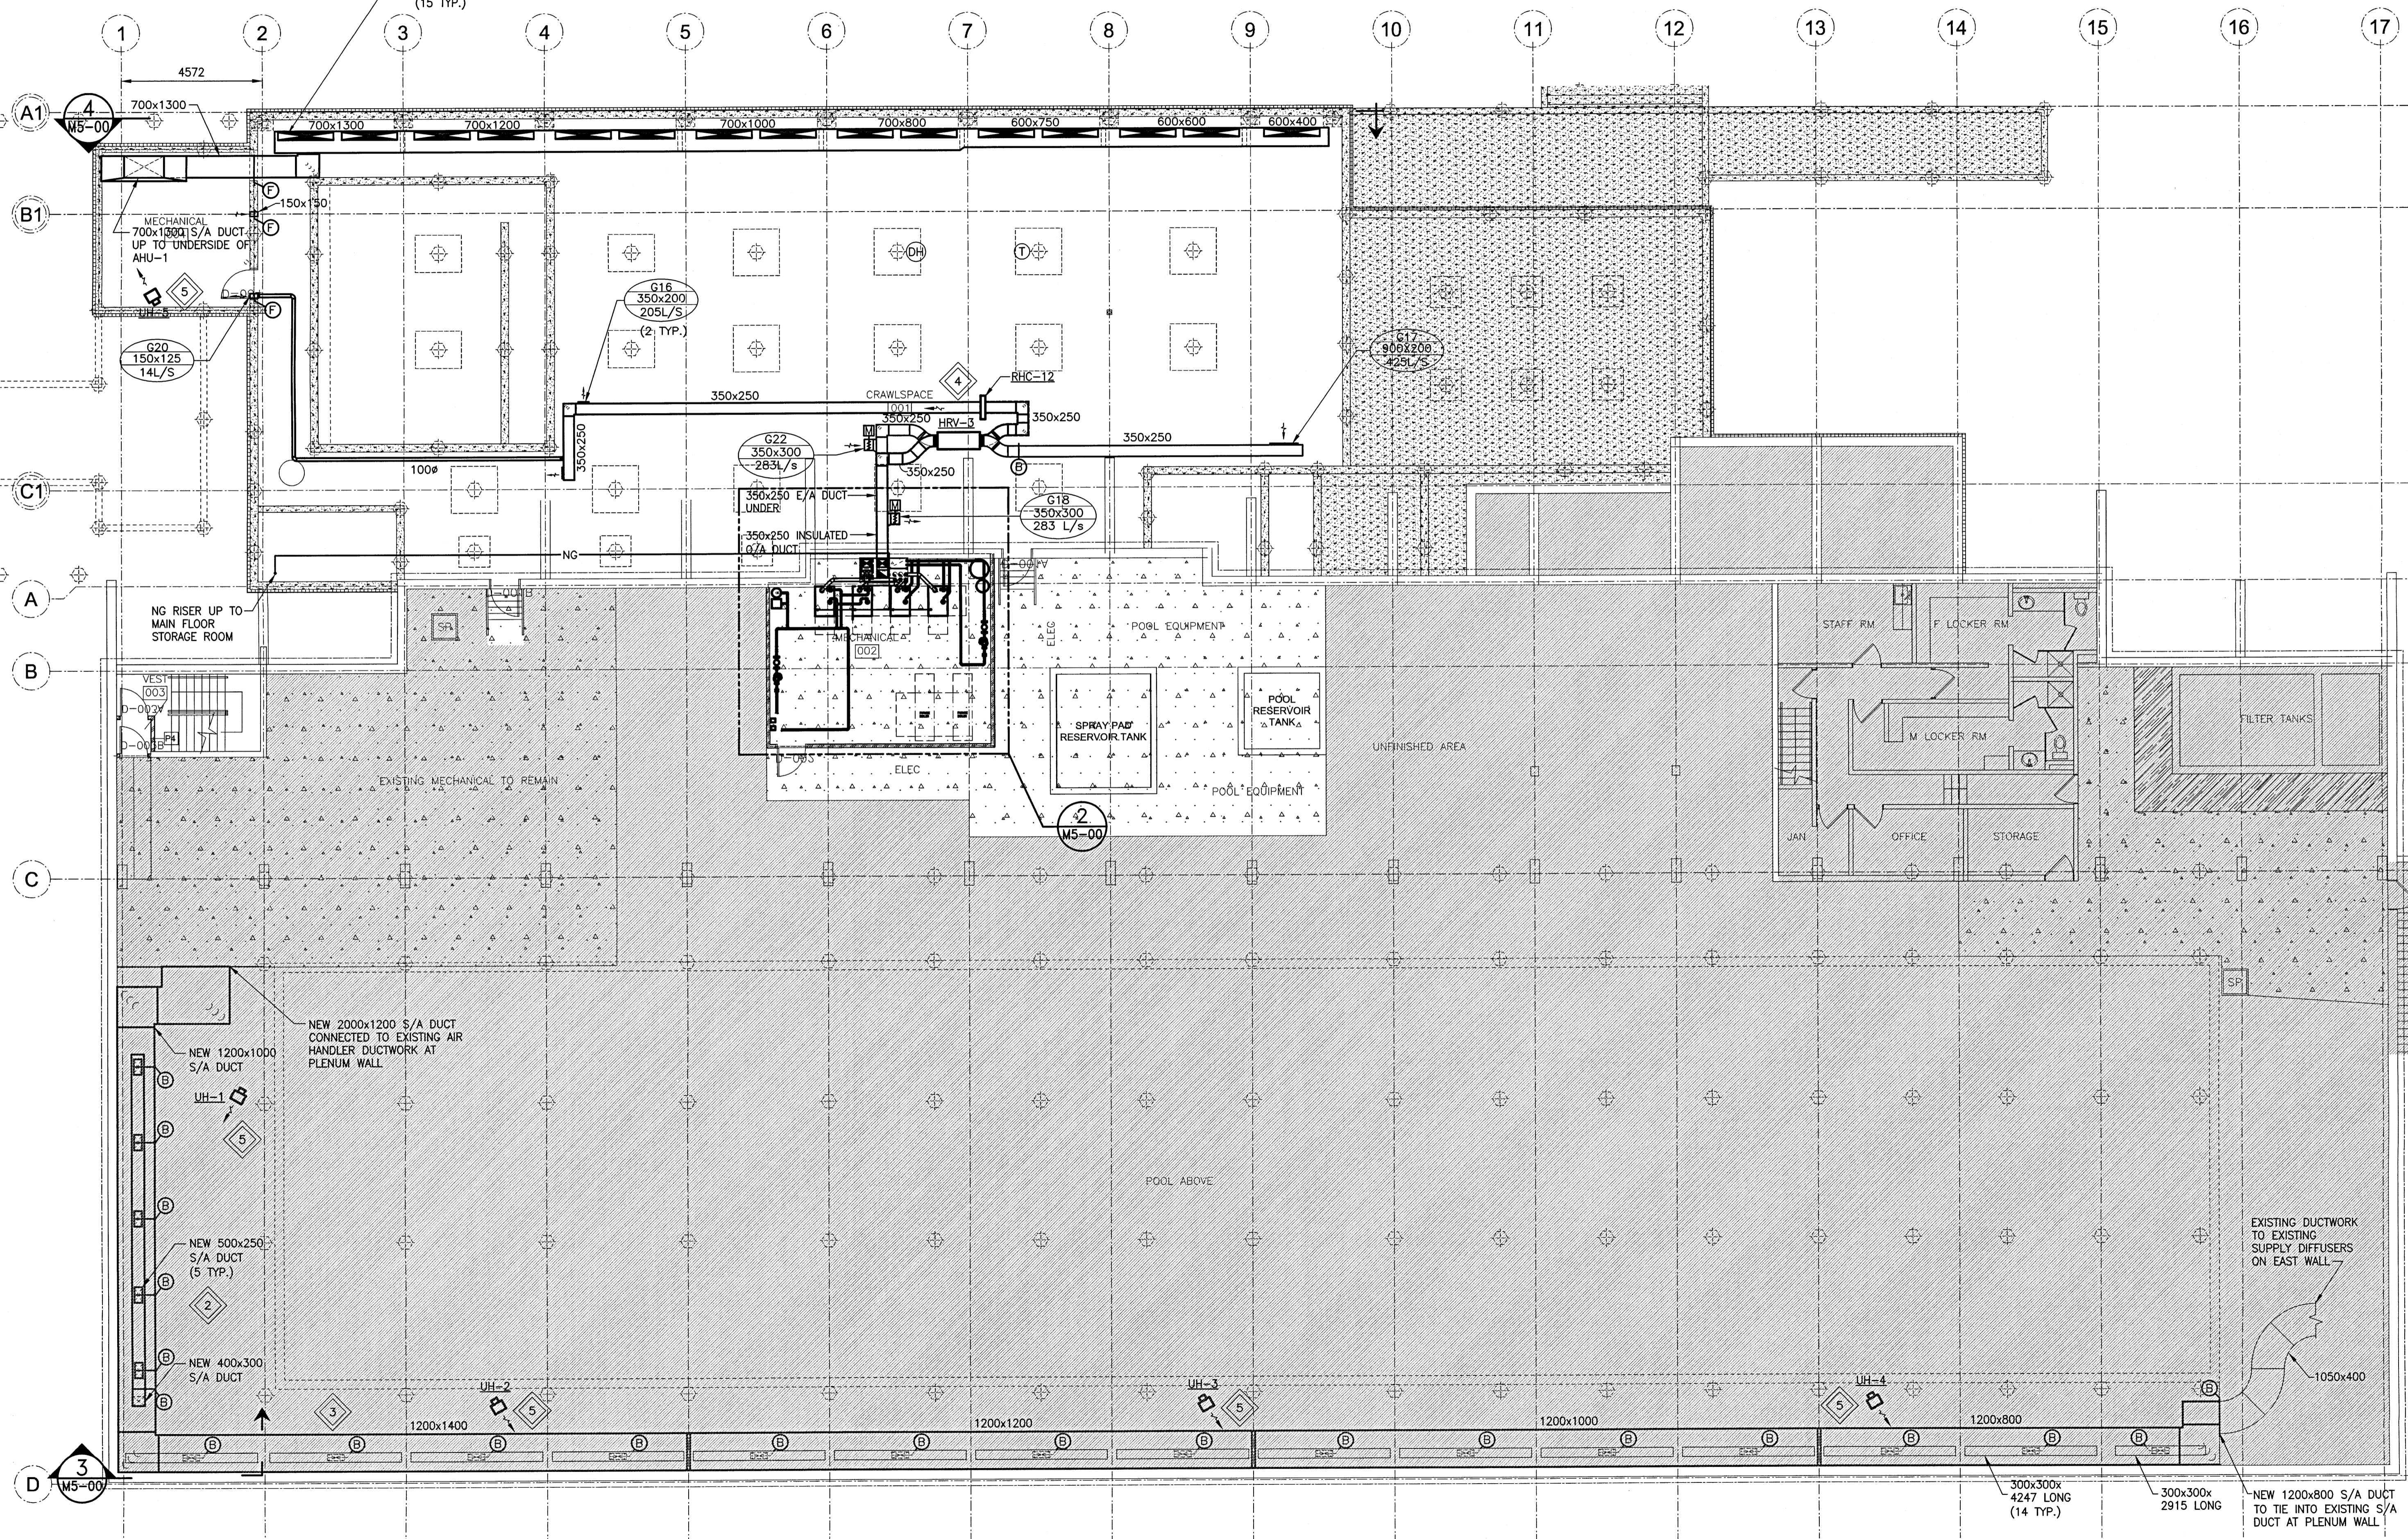


1 BASEMENT PLAN - NEW HVAC
SCALE: 1:100

Issue / rev.

Issue / rev.	date	issue notes
0	2016/12/08	ISSUED FOR CONSTRUCTION
#		

professional seals

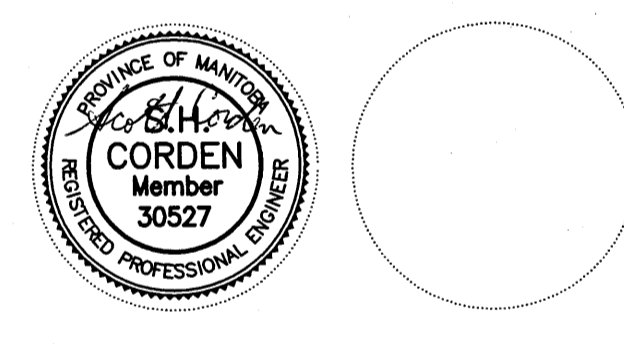

project information

SEVEN OAKS POOL
 444 Adsum Drive
 Winnipeg, MB
 Canada

client

City of Winnipeg
 4th Floor - 86 King Street
 Winnipeg, MB

drawing information

MECHANICAL BASEMENT FLOOR PLAN NEW - HVAC
 drawn by: RLR
 approved by: [Signature]
 scale: AS NOTED
 date issued: 2016.12.08
 proj. #: 14-1736-008
 rev. #: R-0

SEVEN OAKS POOL RENOVATION & ADDITION
 BID OPPORTUNITY NO. 1044-2016

This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. All discrepancies, errors, and omissions are to be reported to the architect. Drawing and specifications, as instruments of service, are the property of the architect. No reproduction may be made without the permission of the architect, and when made, must bear his name. All prints to be returned to the architect on request.

File name: P:\Projects\2014\14-1736-008 [Dwg] Mech\14-1736-008_M3-00.dwg - Tab: M3-00 Plotted By: dderoché 16/12/07 [Wed 3:06pm]

SCALE VERIFIED BY: [Signature]

