

FLOOR BOX SCHEDULE				
TYPE	DESCRIPTION	MANUFACTURER	MODEL	NOTES
FB1	SURFACE MOUNTED PEDESTAL ON FIRE RATED POKE-THROUGH DEVICE. DEVICES SHALL BE VERTICALLY MOUNTED IN HORIZONTAL ORIENTATION. PROVIDE SINGLE (200-H/BTC) OR DOUBLE (241-H/BTC) SERVICE HEAD TO ACCOMMODATE DEVICES AS INDICATED ON DRAWINGS. PROVIDE ALL FITTING AND FACEPLATES FOR A COMPLETE INSTALLATION.	WIREMOLD/WALKER OR APPROVED EQUAL.	FIT SERIES	

CABLE TRAY SCHEDULE				
TYPE	DESCRIPTION	WIDTH	HEIGHT	MANUFACTURER
CT-1	BASKET TRAY SUSPENDED IN CRAWLSPACE.	12"	4"	CABLORIL OR APPROVED EQUAL

SCHEDULE NOTES:

- NA

ELECTRICAL HEATER SCHEDULE									
MARK	DESCRIPTION	WATTAGE	VOLTAGE	LENGTH	MANUFACTURER	MODEL SERIES	CONTROL DEVICE		NOTES
							COMPONENT	FURN. INST.	
FAB.04A	ARCHITECTURAL FORCED-AIR WALL HEATER	4,000 W	208 V		OUELLET	OAWH	IT	DIV 26 DIV 26	

CONTROL DEVICES:

LN-IT	LINE VOLTAGE INTERNAL TAMPERPROOF BI-METAL THERMOSTAT T-STAT	LW-IT	LOW VOLTAGE INTERNAL TAMPERPROOF BI-METAL THERMOSTAT	IT	INTERNAL TAMPERPROOF THERMOSTAT
LN-ID	LINE VOLTAGE INTERNAL DIAL BI-METAL THERMOSTAT	LW-ID	LOW VOLTAGE INTERNAL DIAL THERMOSTAT	ID	INTERNAL DIAL THERMOSTAT
LN-R	LINE VOLTAGE REMOTE BI-METAL THERMOSTAT	LW-R	LOW VOLTAGE REMOTE BI-METAL THERMOSTAT		

GENERAL NOTES:

- HEATER OUTPUT SHALL BE AS INDICATED AT SPECIFIED VOLTAGE.
- BASEBOARD HEATERS AND FORCE FLOW HEATERS SHALL BE WHITE IN COLOUR. CONFIRM FINISH WITH ARCHITECT.
- OUELLET, CHROMALOX, STELPRO, AND Q-MARK MEETING ABOVE SPECIFICATIONS ARE APPROVED EQUAL MANUFACTURERS.
- WHERE BASEBOARD HEATERS ARE SPECIFIED, LINEAR CONNECTORS ARE NOT APPROVED EQUAL.
- ALL DRAFT BARRIER HEATERS SHALL BE COMPLETE WITH FINISHED BACK AND PEDESTAL MOUNTS.
- ALL LOW-VOLTAGE CONTROLLED HEATERS SHALL BE COMPLETE WITH LOW VOLTAGE RELAY AND TRANSFORMER KIT FOR LOW VOLTAGE THERMOSTAT CONNECTION.

NOTES:

- XXX

LIGHTING CONTROL DEVICE SCHEDULE				
TYPE	DESCRIPTION	MANUFACTURER	CATALOG No.	NOTES
D1	NETWORKED CEILING MOUNTED AUTOMATIC DIMMING CONTROL PHOTOCCELL	SENSOR SWITCH	nCM-ADCX	
OS1	LINE VOLTAGE DUAL TECHNOLOGY WALL SWITCH VACANCY SENSOR	SENSOR SWITCH	WSX-PDT	
OS2	LINE VOLTAGE PIR WALL SWITCH VACANCY SENSOR	SENSOR SWITCH	WSX	
OS3	DUAL TECHNOLOGY CEILING MOUNTED OCCUPANCY SENSOR, 360° COVERAGE	SENSOR SWITCH	CMR-PDT-9	

SCHEDULE NOTES:

- PROVIDE DEVICE TO MATCH OPERATING VOLTAGE OF LOADS CONTROLLED.
- PROVIDE 24 VDC POWER PACK WITH INPUT TO MATCH LIGHTING FIXTURE VOLTAGE, SWITCHING CONTACT RATED FOR 20A BALLAST.

HAND DRYER SCHEDULE					
MARK	VOLTAGE	WATTAGE	MANUFACTURER	MODEL	NOTES
HD-3	120 V	1400 W	AIRBLADE V	DYSON	POLYCARBONATE-ABS, 12 SECOND DRY, AUTOMATIC OPERATION, NICKEL FINISH



epp siepman engineering inc.


mechanical & electrical engineers
 303-100 Osborne St. South
 Winnipeg, MB
 R3L 1Y5
 p 204-453-1080
 ese@eppsiepman.com

O 16-03-31 Issued for Construction
 revision

THIS DRAWING IS THE EXCLUSIVE PROPERTY OF HIS ARCHITECTURE AND DAVID PENNER ARCHITECT AND MAY NOT BE REPRODUCED AND/OR USED IN ANY MANNER WITHOUT THEIR EXPRESSED WRITTEN PERMISSION. THE GENERAL CONTRACTOR AND MATERIALS SUPPLIERS SHALL CHECK ALL DIMENSIONS AND INFORMATION ON THIS DRAWING AND REPORT ANY DISCREPANCIES PRIOR TO COMMENCEMENT OF WORK. DO NOT SCALE THIS DRAWING.

OWNER

 CITY OF WINNIPEG - PLANNING, PROPERTY & DEVELOPMENT DEPARTMENT
 MUNICIPAL ACCOMMODATIONS DIVISION
 3rd FLOOR - 65 GARRY ST., WPG, R3C 4K4

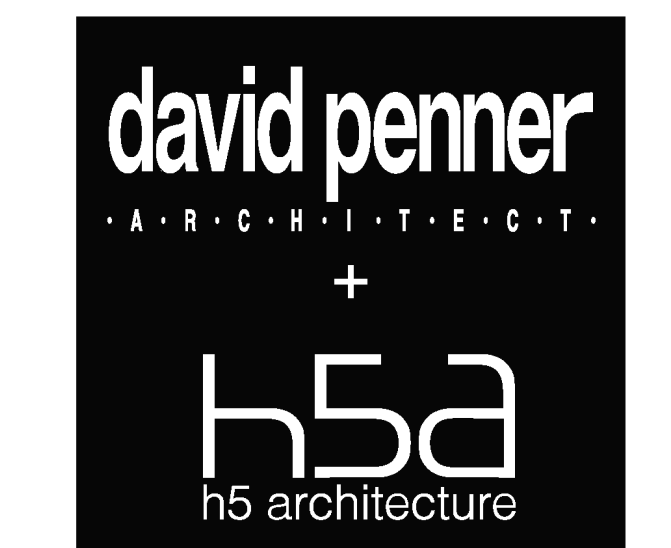

David Penner, 204.475.8978
 Hello Rodrigues, 204.774.0012
 120 Yale Avenue, Winnipeg, MB, R3M 0L7

PROJECT
 Windsor Park Library
ADDRESS
 1201 Archibald Street

DATE
 February 28, 2016

SCALE
 1/8" = 1'-0"