

F:\Projects\2016\16-0109-003\Elec\16-0109-003\_E2-00.dwg - Tab: E2-00 Plotted By: deroche 16/06/24 [Fri 8:17am]  
 24 x 36 / PLOT SCALE





**GENERAL NOTES**

1. ELECTRICAL CONTRACTOR SHALL COORDINATE THE REQUIRED FEEDER TRENCH WITH THE GENERAL CONTRACTOR.

**KEYNOTES:**

- 1 ALL LIGHTING FEEDERS SHALL BE INSTALLED IN CONDUIT. MINIMUM SIZE FOR ALL LIGHTING FEEDERS IS #10 AWG RWU90 COPPER.
- 2 CONTRACTOR TO APPLY FOR AND COORDINATE THE NEW HYDRO SERVICE.
- 3 PROVIDE NEW DISTRIBUTION AS REQUIRED FOR NEW LIGHTING SERVICE COMPLETE WITH CSTE, DISTRIBUTION PANEL (MINIMUM 100A WITH 5x 15A CIRCUITS), PHOTOCELL AND LIGHTING CONTACTOR. ALL ENCLOSURES SHALL BE MINIMUM NEMA 3R RATED AND LOCKABLE. NO EXTERNAL SWITCH REQUIRED FOR LIGHTING CONTROL ENCLOSURE. CSTE AND DISTRIBUTION PANEL TO BE SERVICE ENTRANCE RATED WITH A MINIMUM KA RATING OF 22KA. CONFIRM ALL EQUIPMENT REQUIREMENTS WITH MANITOBA HYDRO PRIOR TO PURCHASE.

RALEIGH ST

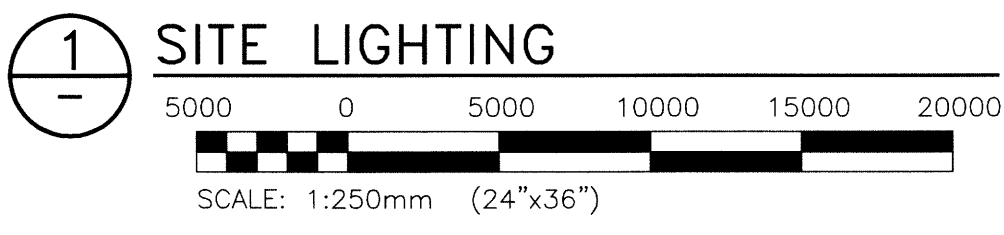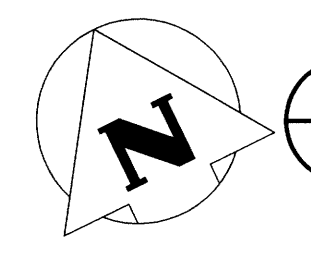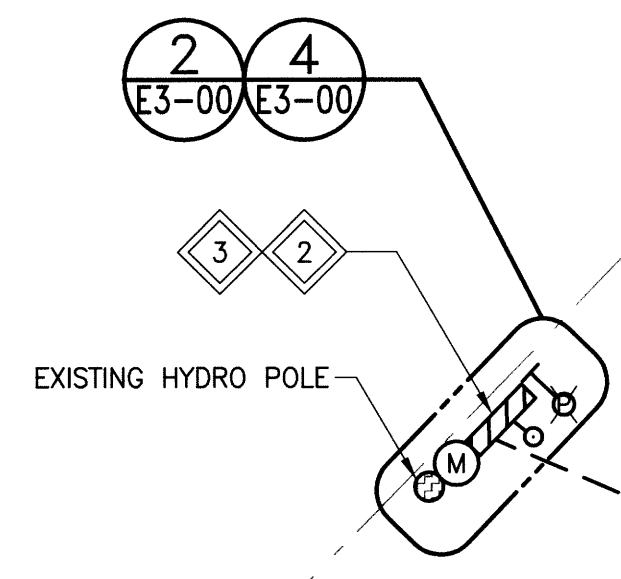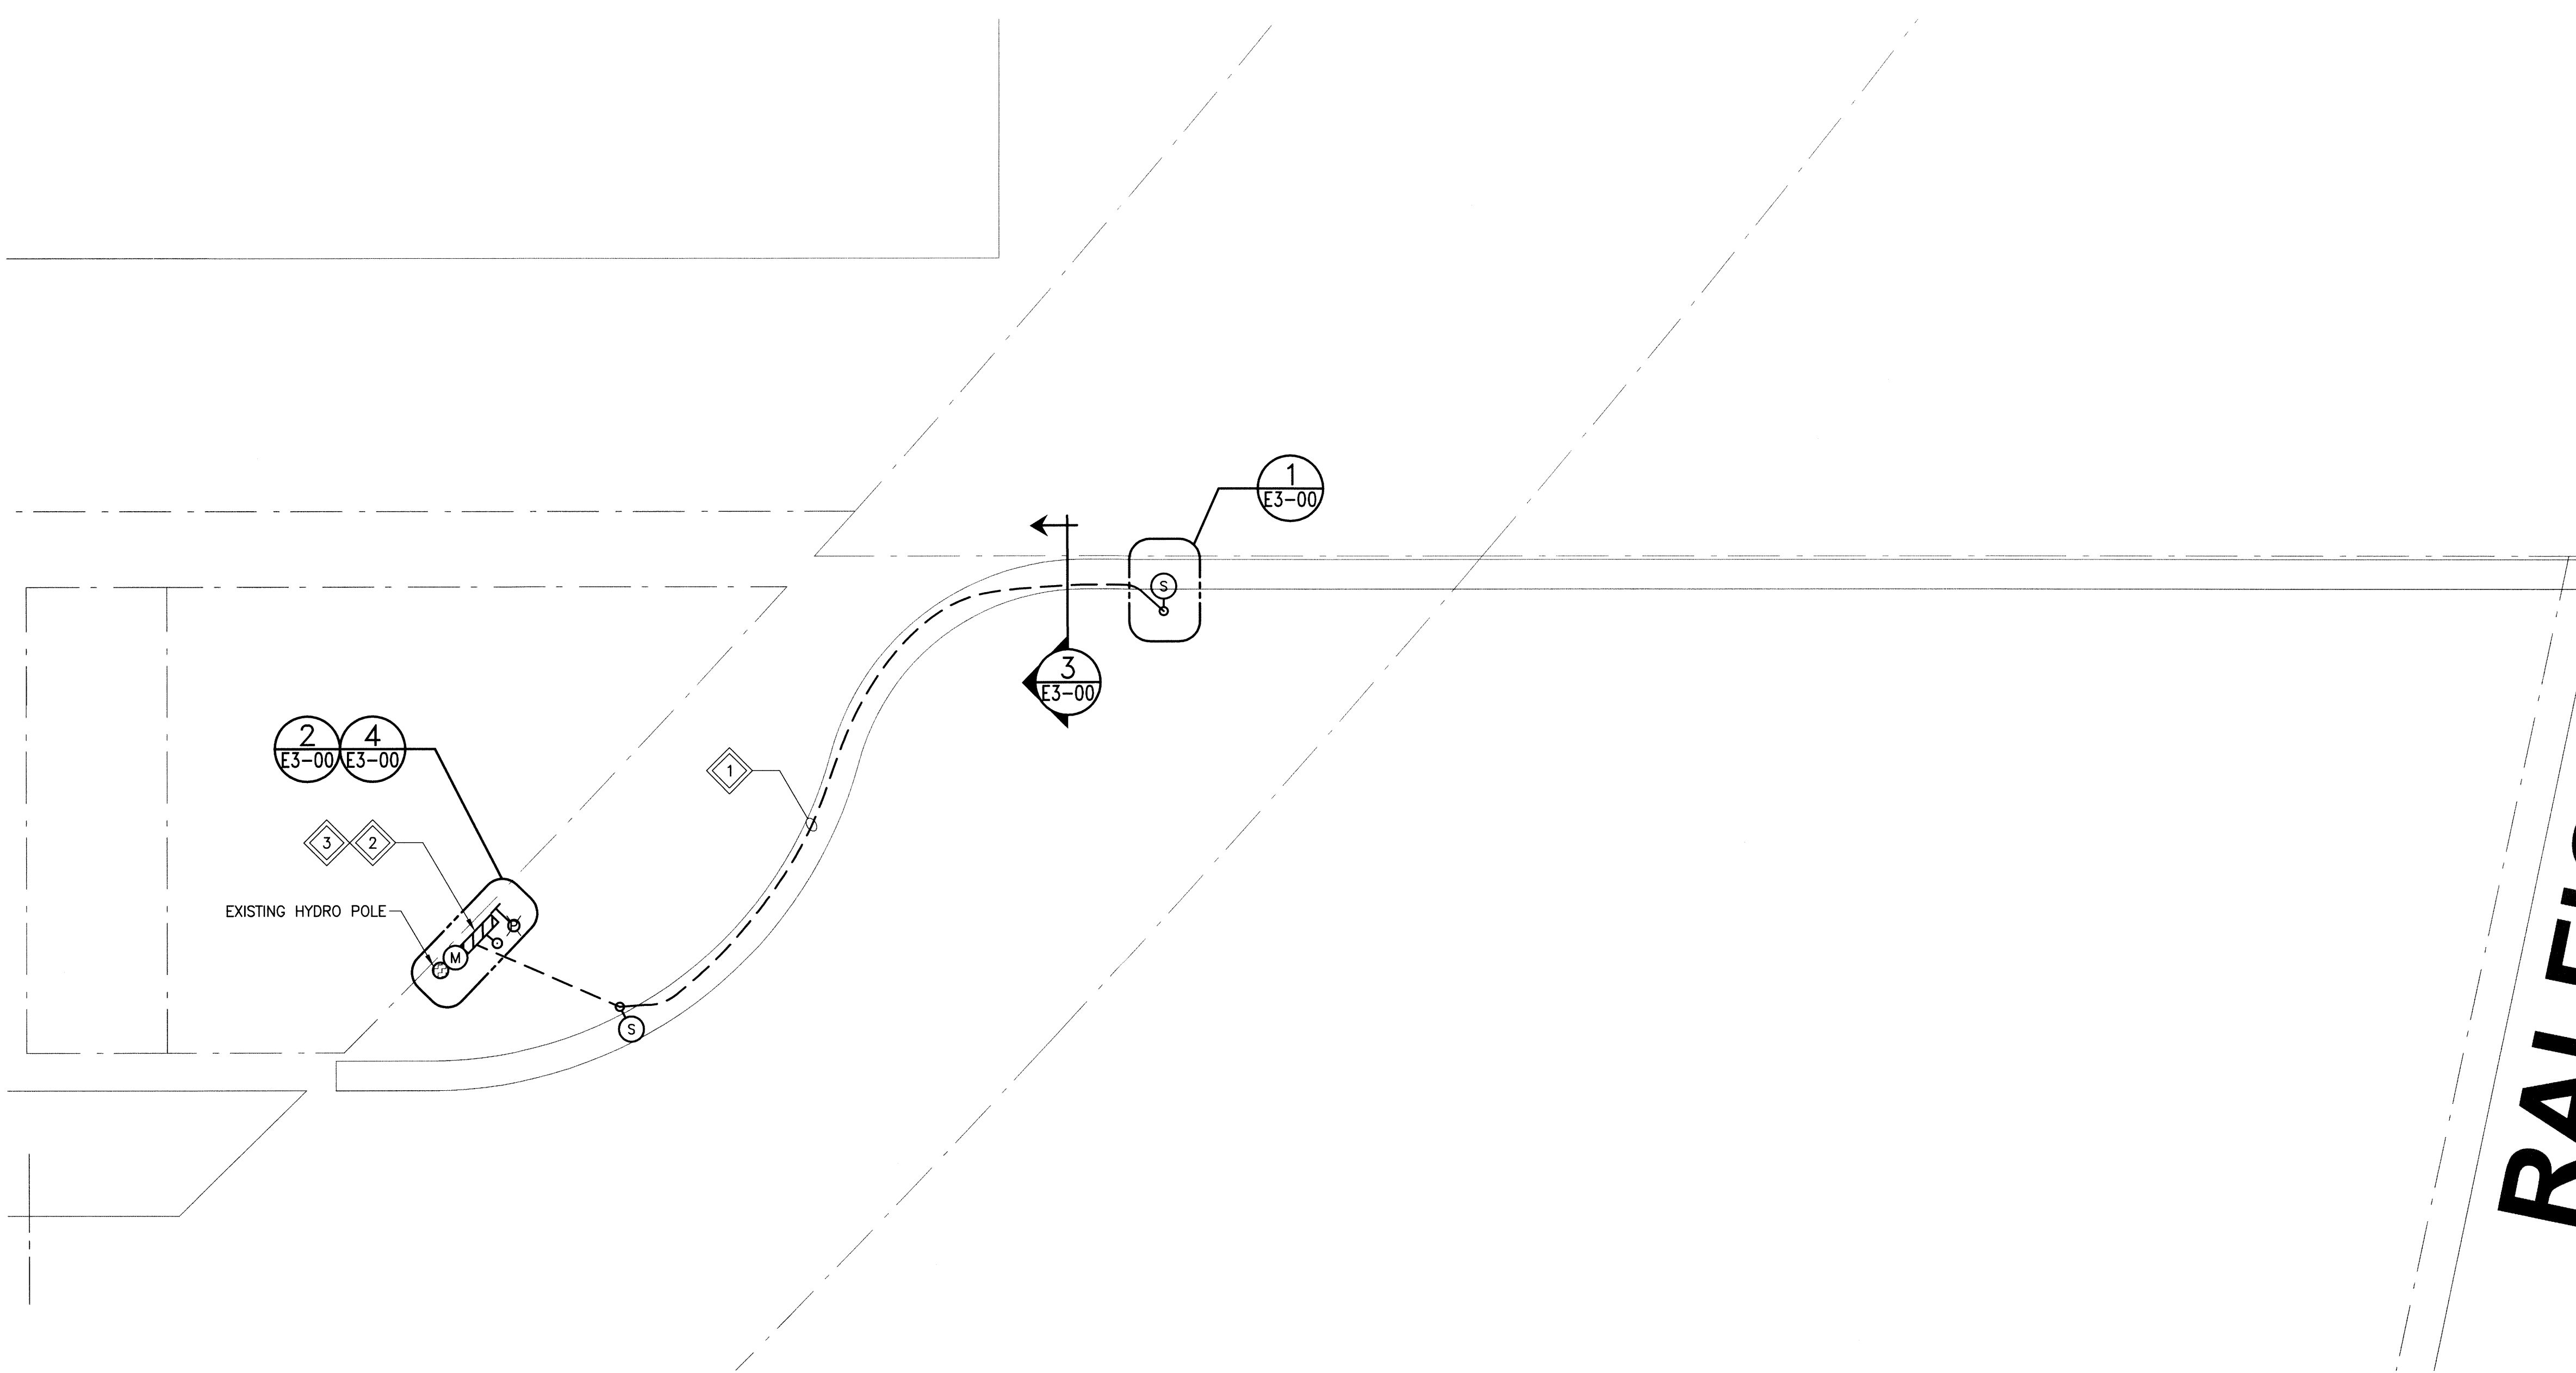

NO.	YY/MM/DD	DESCRIPTION	DESIGN BY	DESIGN CHECK
0	16/06/24	ISSUED FOR CONSTRUCTION	JLL	CB

CLIENT:  
**SCATLIFF + MILLER + MURRAY**  
visionary urban design + landscapes

PROJECT:  
EAST END CULTURAL AND LEISURE CENTRE

DWG. DESCRIPTION:  
ELECTRICAL SITE LIGHTING SHEET 2

AUTHENTICATION FOR CURRENT REVISION  
ENG. STAMP  
R. LALONDE  
Member  
32345  
PROFESSIONAL ENGINEER  
MANITOBA  
16/06/24

DESIGN BY	DATE (YY/MM/DD)
JLL	16/06/20
DESIGN CHECK: CB	DATE: 16/06/23
DRAWN BY: RAH	DATE: 16/06/20
DWG CHECK: JLL	DATE: 16/06/23

**CHECK BEFORE YOU DIG**  
CONTACT LOCAL GAS, HYDRO & RELEVANT AUTHORITIES PRIOR TO ANY EXCAVATION WORK ON SITE.  
DAMAGING GAS PIPES IS DANGEROUS AND COSTLY.

**APEGM**  
Certificate of Authorization  
KGS Group  
No. 245

DWG. NO. 16-0109-003 E2-00 REV. 0