


No.	Date	Revision Notes
0	2016/02/29	Issued for Construction

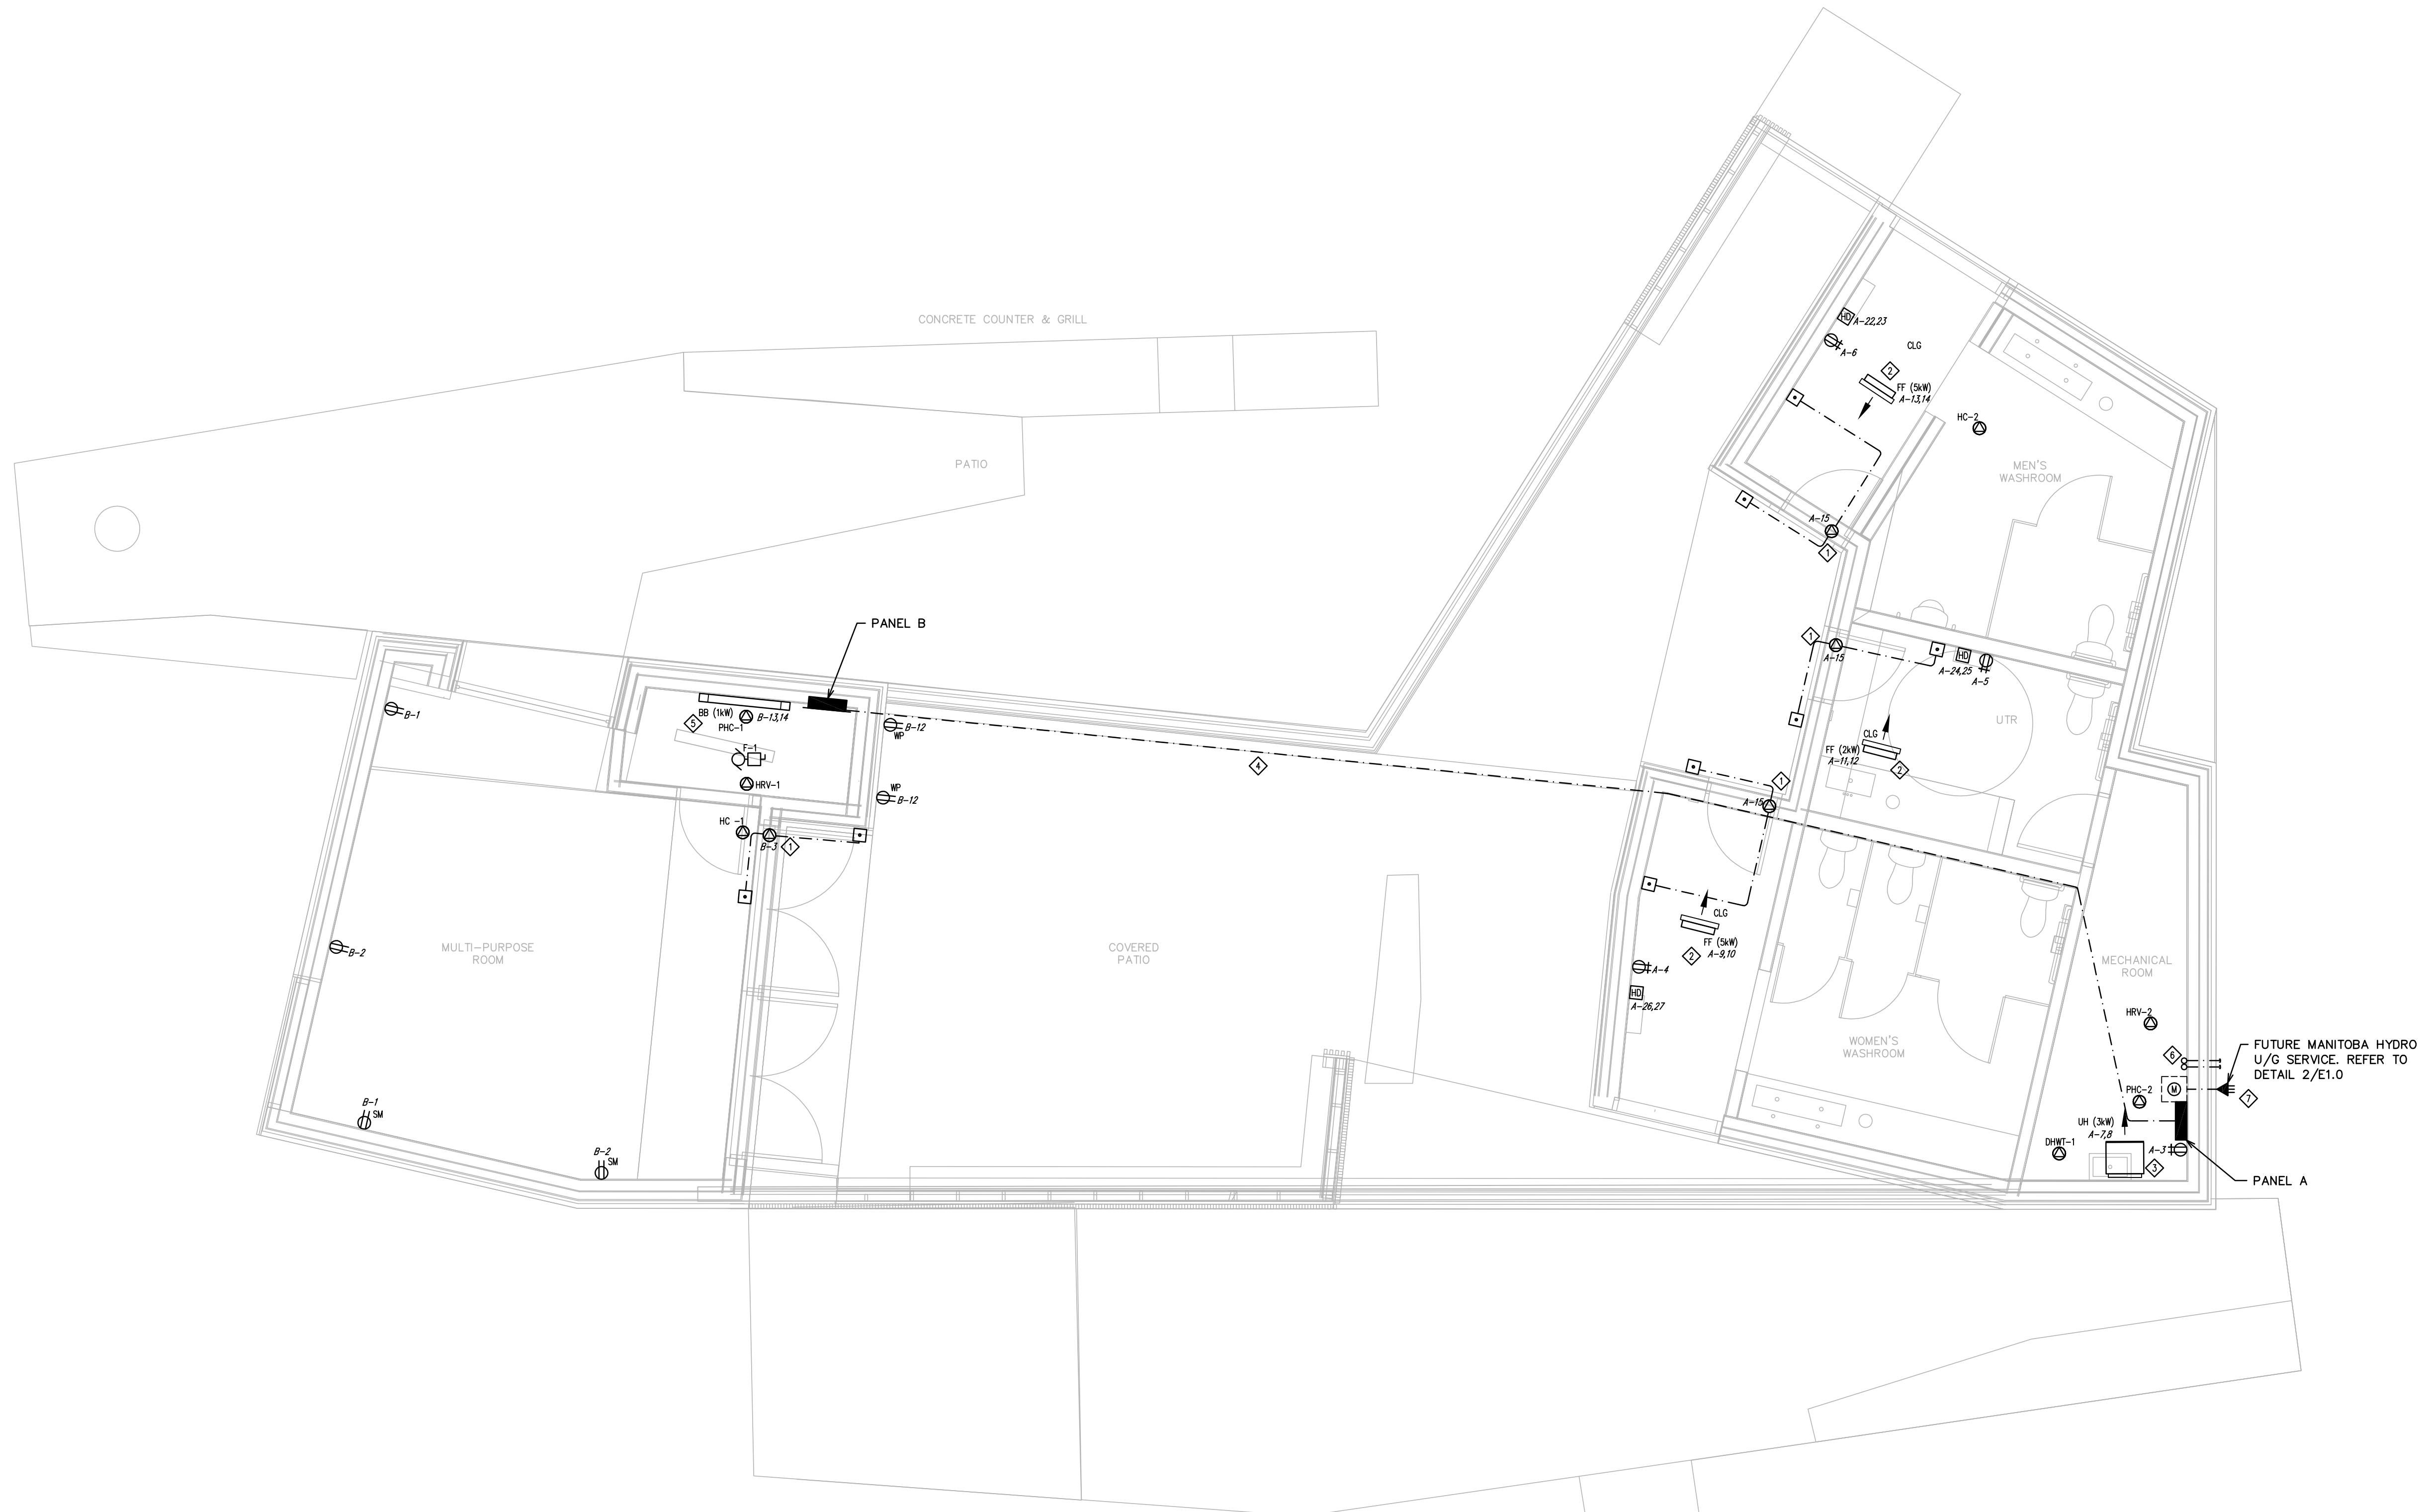

GENERAL NOTES:

1. ELECTRICAL DEVICES SHALL BE SUPPLIED FROM ABOVE. RUN CONDUIT/WIRING DOWN WALLS TO REQUIRED HEIGHT.

NOTES:

1. WIRE AND CONNECT AUTOMATED DOOR ACTUATORS C/W ASSOCIATED CONTROLS.
2. PROVIDE 240V/1 ϕ OUELLET ODS SERIES RECESSED CEILING MOUNTED FORCE FLOW HEATER, SIZE AS SPECIFIED C/W BUILT-IN TAMPERPROOF THERMOSTAT.
3. PROVIDE 240V/1 ϕ OUELLET OAE SERIES WALL MOUNTED UNIT HEATER, SIZE AS SPECIFIED C/W BUILT-IN THERMOSTAT AND WALL MOUNTING BRACKET. HEATER SHALL BE MOUNTED AT HIGH LEVEL WITHIN ROOM.
4. CONDUIT SHALL BE RUN ALONG UNDERSIDE OF JOISTS, AS CLOSE TO WALL CORNER AS POSSIBLE.
5. PROVIDE 240V/1 ϕ OUELLET OFM SERIES BASEBOARD HEATER, SIZE AS SPECIFIED C/W BUILT-IN, TAMPERPROOF THERMOSTAT.
6. PROVIDE TWO (2) SPARE 78mm (3") CONDUITS FROM EXTERIOR OF BUILDING STUBBED UP 600mm (2') AFF FOR FUTURE TELECOMMUNICATION DEMARCATION POINT. REFER TO DETAIL 3/E1.0.
7. PROVIDE TWO (2) 78mm (3") SLEEVES FROM EXTERIOR OF BUILDING STUBBED UP INTO METERING CABINET FOR FUTURE HYDRO SERVICE ENTRY.



1 MAIN FLOOR - POWER & SYSTEMS LAYOUT
EP2.0 SCALE: 1:50

This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. Discrepancies, errors, and omissions are to be reported to the Architect prior to proceeding with the Work.

Drawings and specifications as instruments of service are the property of the Architect; the copyright in the same being reserved to him.

No reproduction or revision to these drawings may be made without the permission of the Architect, and when made, must bear his name. All prints to be returned to the Architect upon request.

Project
Crescent Drive Park Pavilion

Drawing
Main Floor -
Power & Systems Layout

Drawn By
MJB
Scale
1:50

Reviewed By
MJB
Drawing No.
EP2.0

Date
February 2016

Project No.
Revision No.