


#	date	issue notes
1	2016/08/18	RE-ISSUED FOR CONSTRUCTION
0	2016/07/15	ISSUED FOR CONSTRUCTION

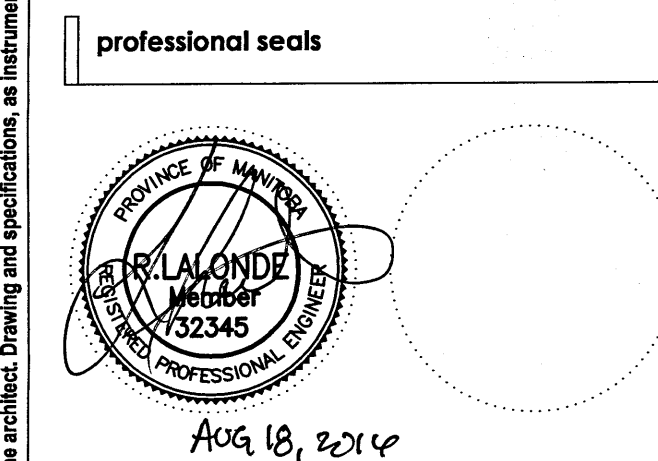

**project information**

**SEVEN OAKS POOL**

444 Adsum Drive  
Winnipeg, MB  
Canada

**client**


City of Winnipeg  
4th Floor - 88 King Street  
Winnipeg, MB

**drawing information**

**ELECTRICAL SINGLE LINE DIAGRAM DEMOLITION**

drawn by: GCN  
approved by: [Signature]  
scale: AS NOTED  
date issued: 2016.08.03  
proj. #: 14-1736-008  
rev. #: R-1

- NOTES:**
1. INDICATED PANELS SHALL BE DEMOLISHED. MAINTAIN ALL EXISTING BRANCH FEEDERS TO BE REINSTALLED TO NEW GEAR.
  2. REMOVE ALL BUS WORK INTEGRAL TO THE GEAR.
  3. RETAIN ALL BRANCH FEEDERS WITH THE MAXIMUM POSSIBLE LENGTH.
  4. RETAIN CONCRETE PAD.
  5. COORDINATE ALL SHUTDOWNS WITH OWNER AND GENERAL CONTRACTOR.
  6. CONTRACTOR SHALL CONFIRM IF CSTE FEEDS ANY OTHER BUILDING OR LOAD BESIDES THE POOL FACILITY. IF THIS CSTE ONLY FEEDS THE POOL, DISCONNECT AND REMOVE THE CSTE. OTHERWISE MAINTAIN THE CSTE.

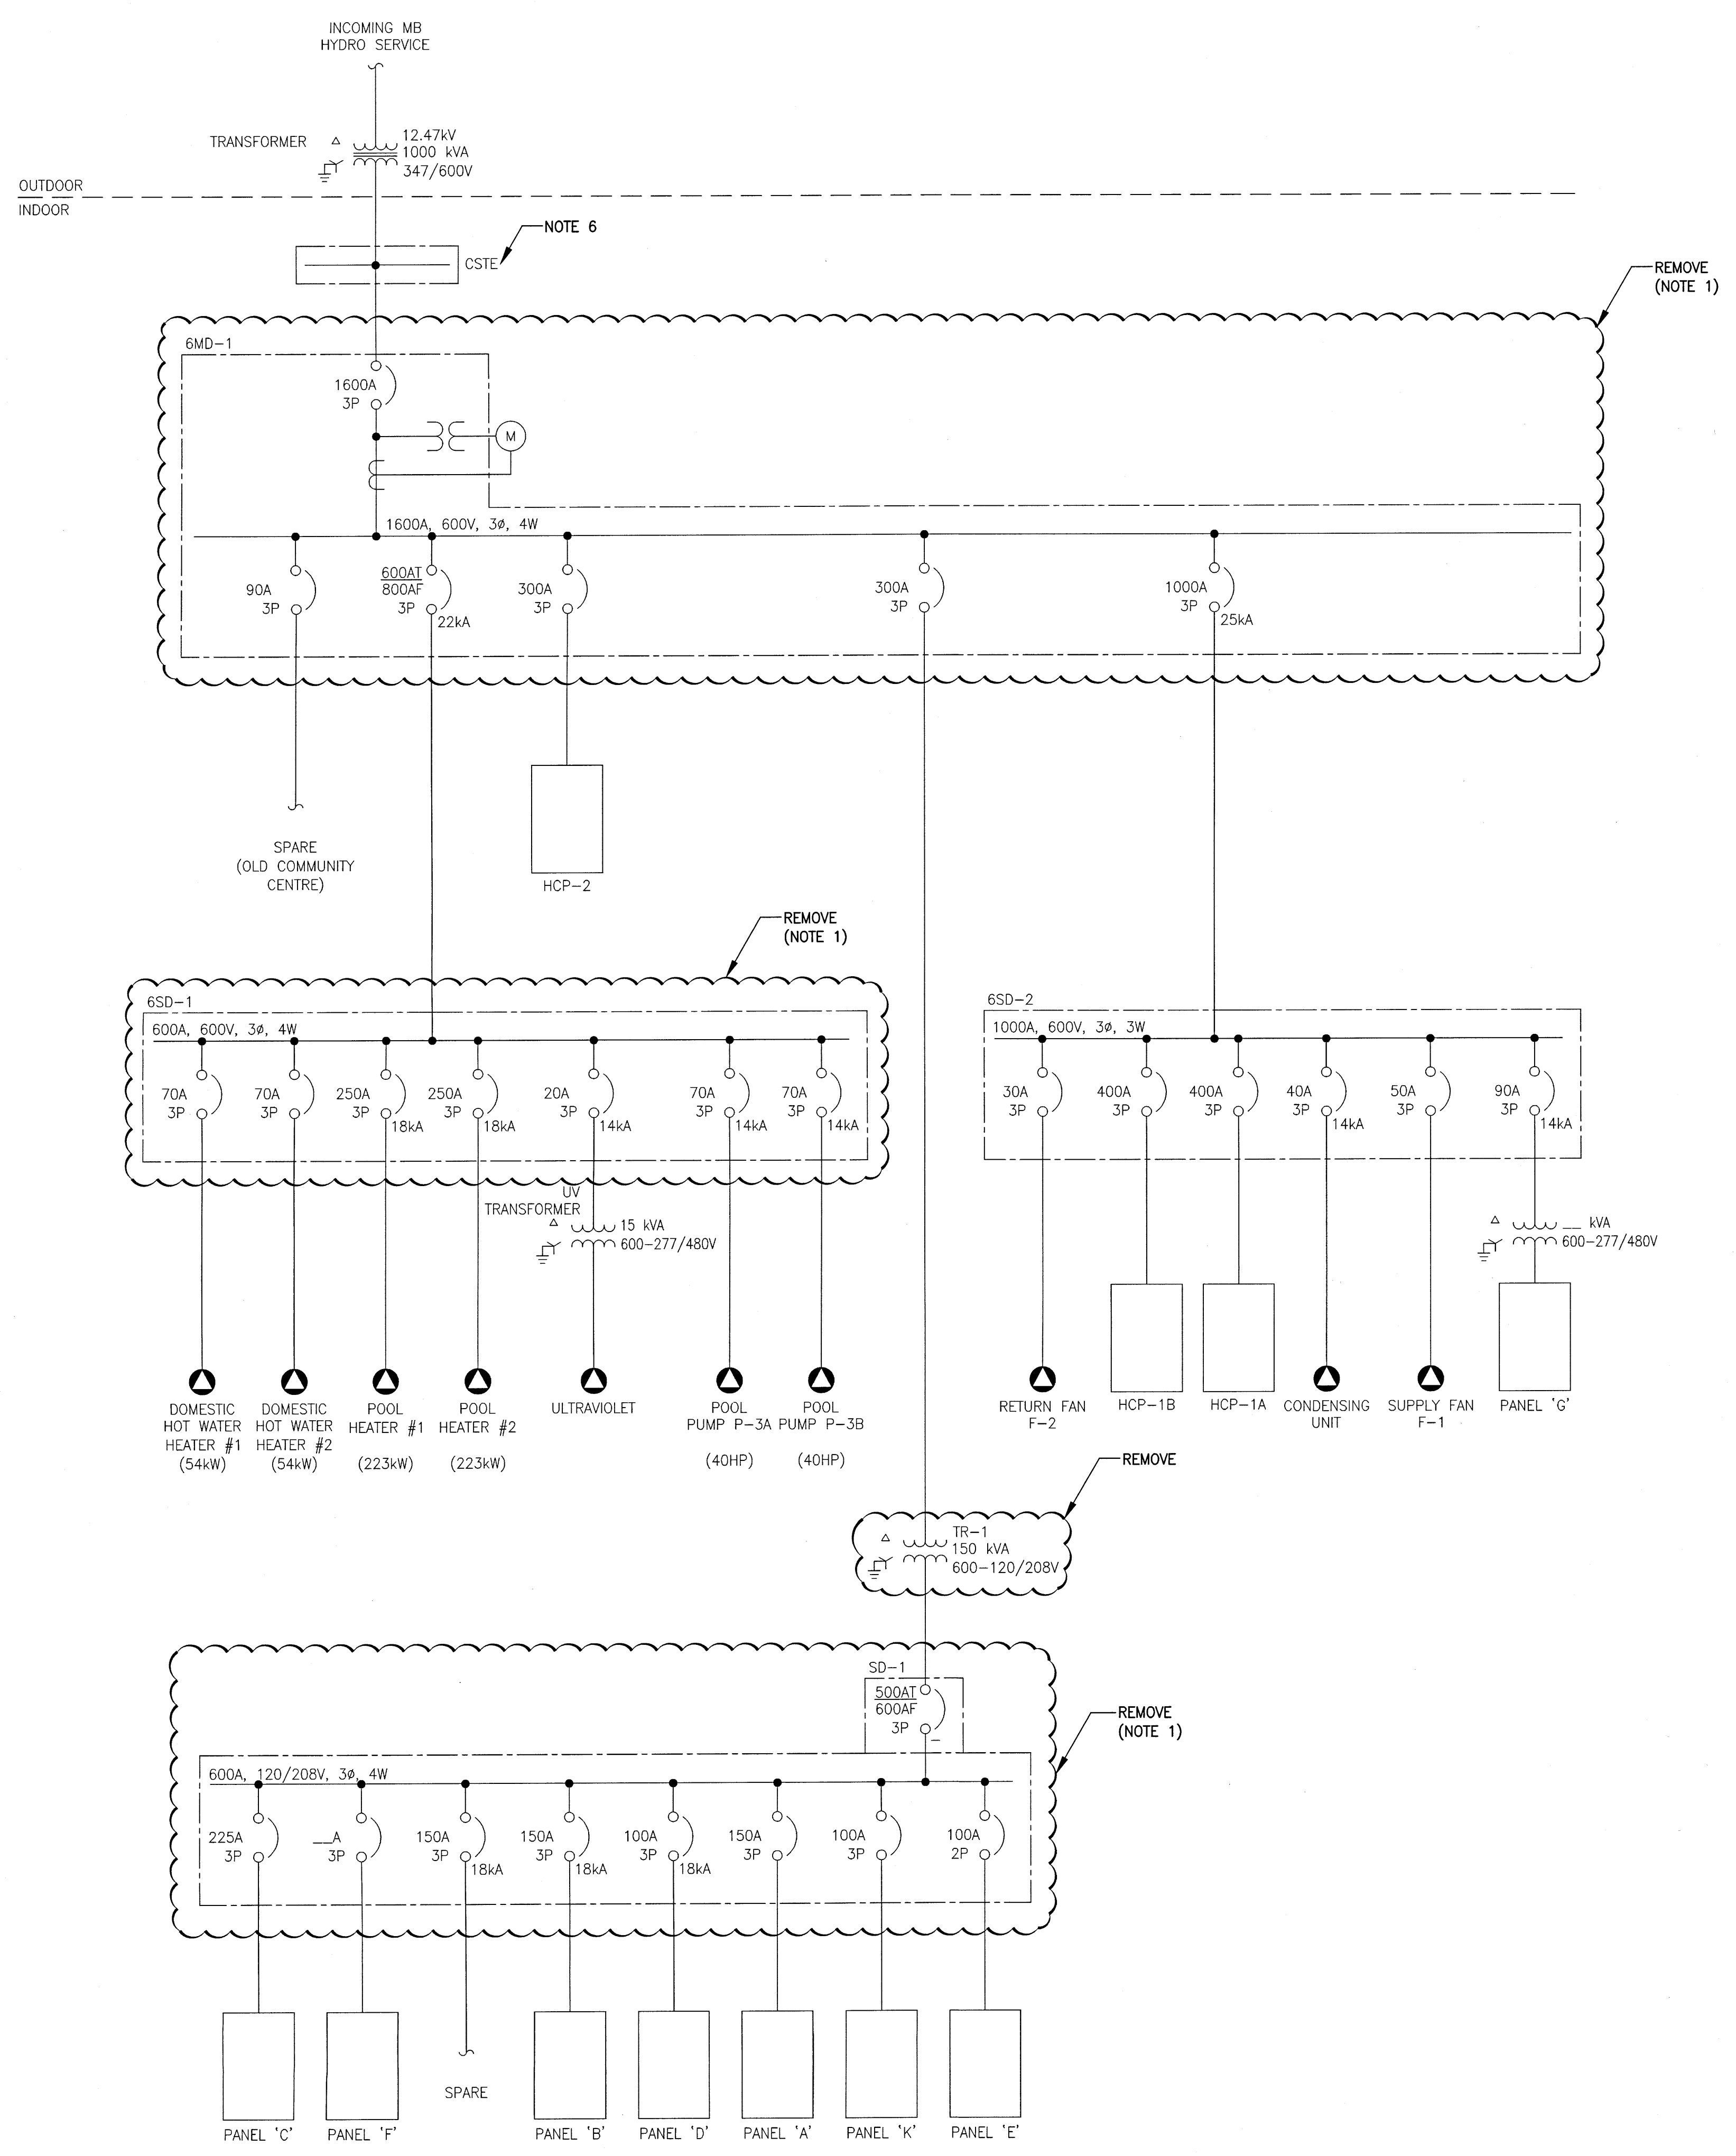

**1 SINGLE LINE DIAGRAM - DEMOLITION**  
SCALE: N.T.S.

File Name: P:\Projects\2014\14-1736-008\Elec\14-1736-008\_EO-01.dwg - Tab: EO-01 Plotted By: dderoché 16/08/18 [Thu 11:38am]

This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. All discrepancies, errors, and omissions are to be reported to the architect. Drawing and specifications, as instruments of service, are the property of the architect. The copyright in this drawing is reserved to him. No reproduction may be made without the permission of the architect, and when made, must bear his name. All prints to be returned to the architect on request.

**SEVEN OAKS POOL RENOVATION & ADDITION**  
BID OPPORTUNITY NO. 645-2016