


KEYNOTES:


- 1 REFER TO BID DOCUMENTS FOR SEPARATE PRICE FORMS.
- 2 REMOVE ELECTRIC DUCT HEATERS AND ASSOCIATED DUCT. RETAIN EXISTING 300x300 DUCT.
- 3 REMOVE DRAINAGE PIPING AND DISPOSE OF OFF SITE. CAP REMAINING PIPING AND PATCH HOLES IN FLOOR.
- 4 EXISTING WATER SERVICE TO BE MODIFIED. REFER TO DRAWING M2-00 FOR DETAILS.
- 5 REMOVE AND RELOCATE TRAPS & VENTS SUCH THAT NEW VENT PIPING IS ROUTED UP THROUGH THE ROOF THROUGH NEW PARTITION WALLS.

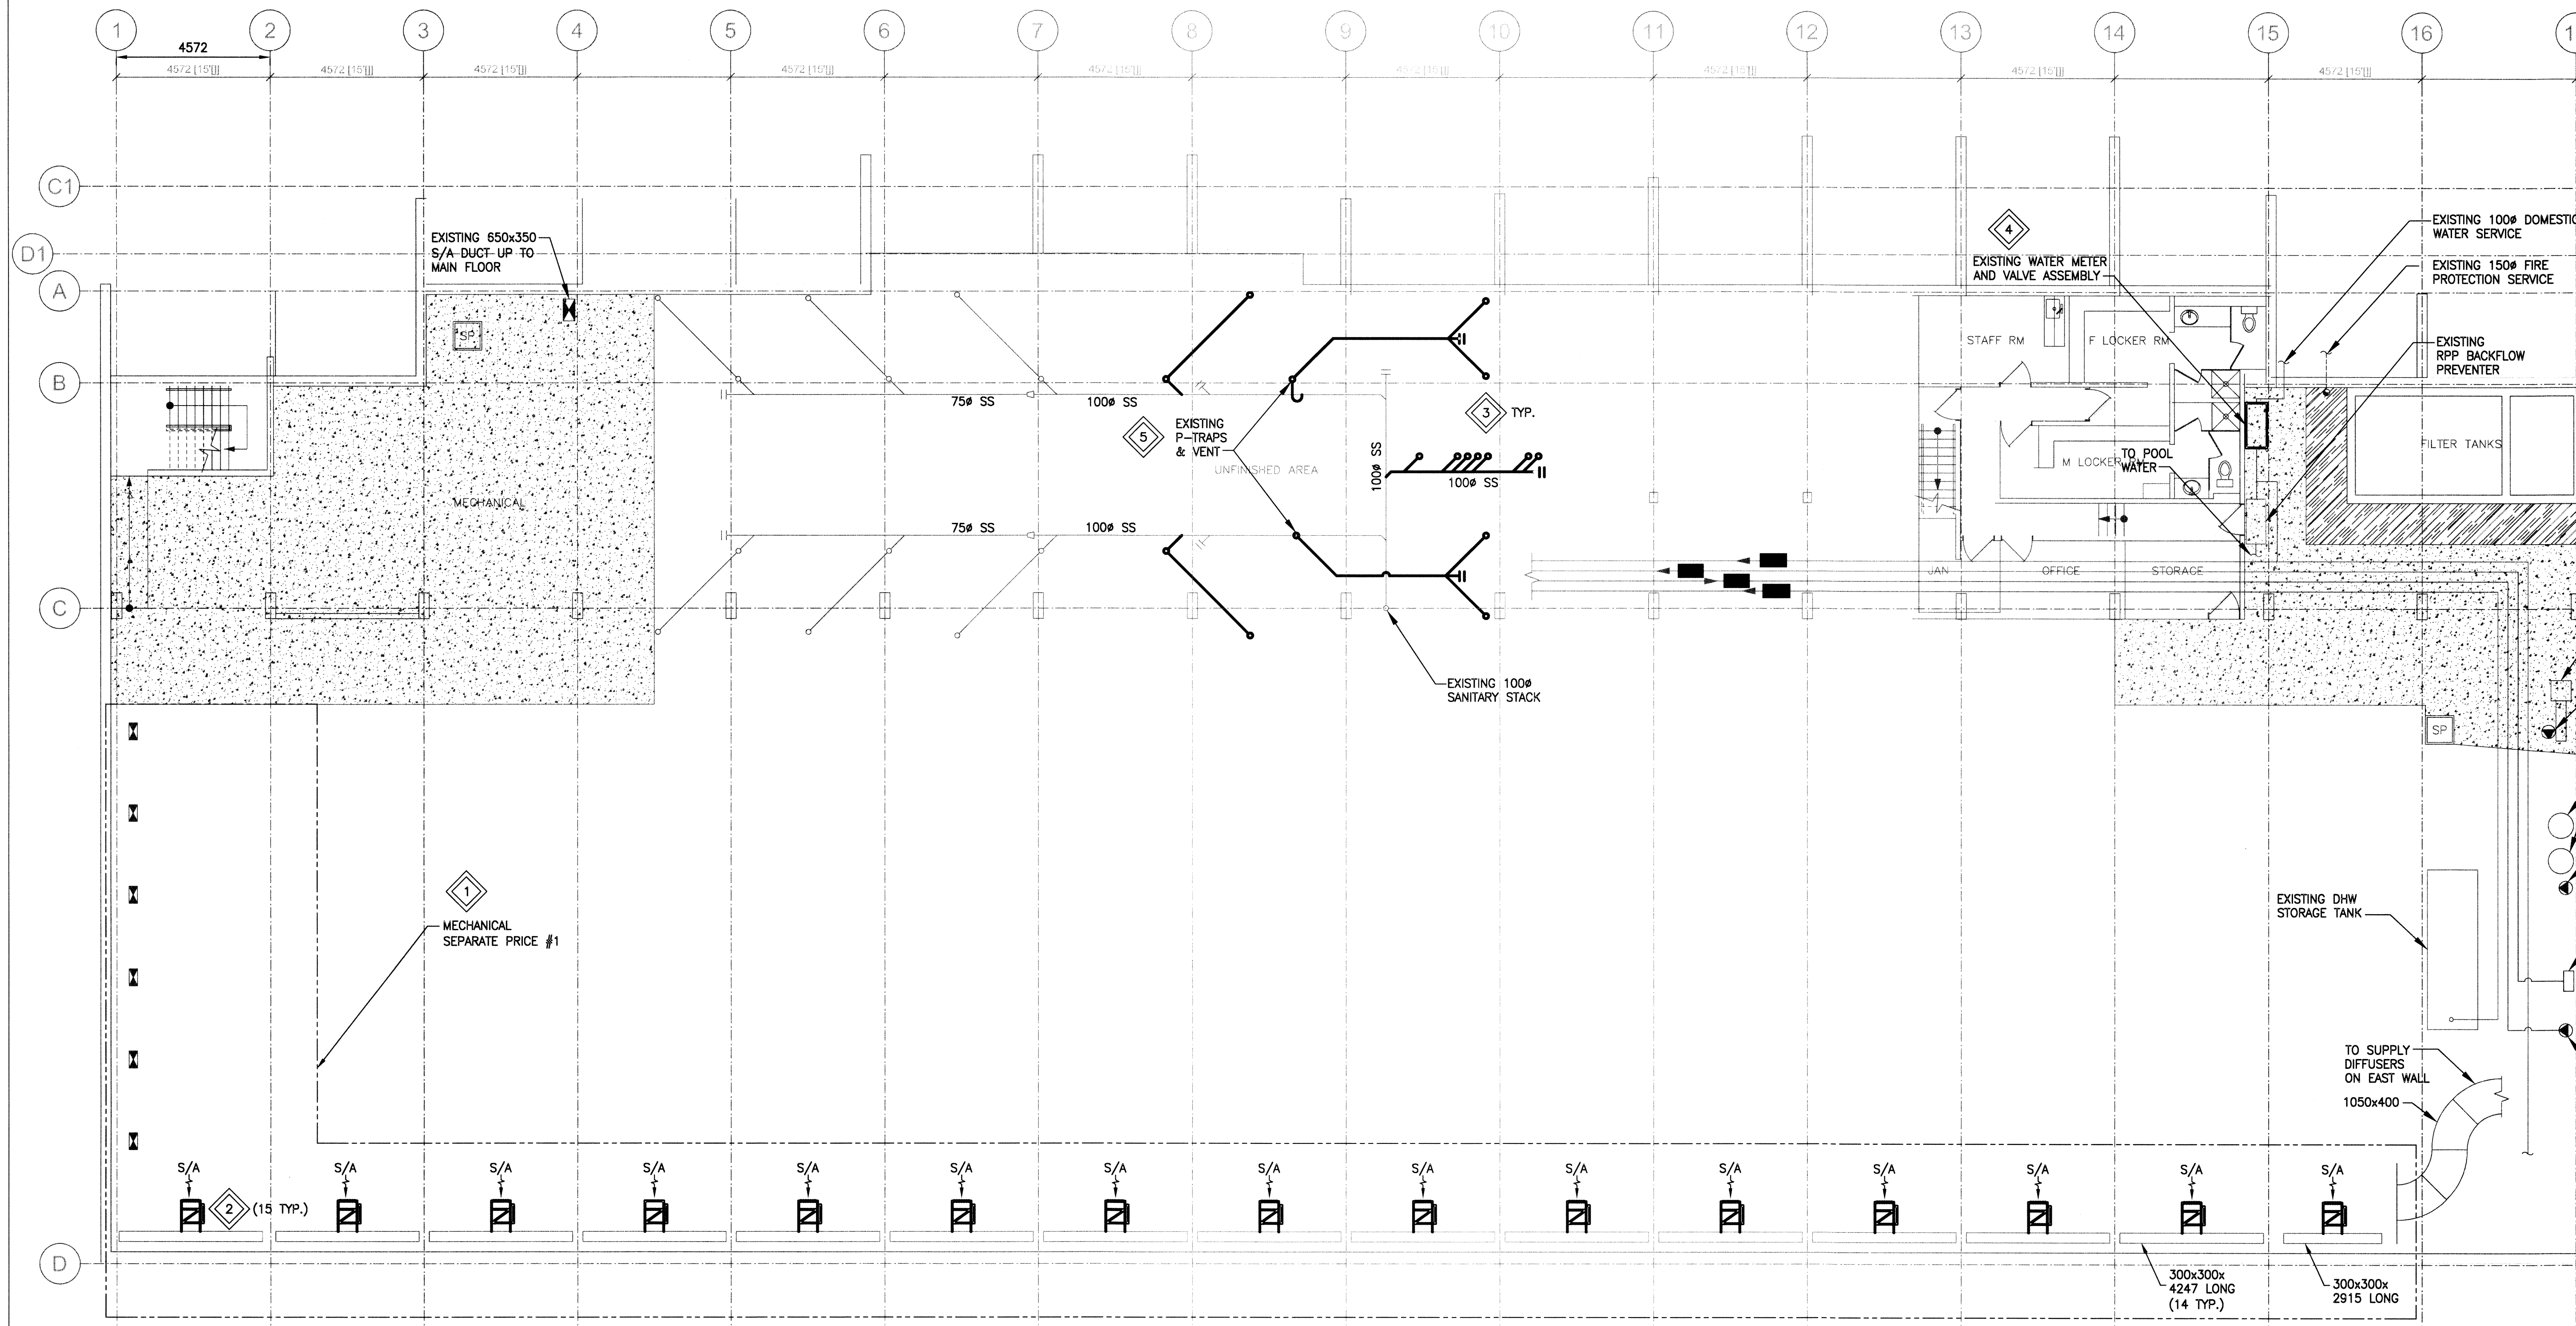

issue / rev.

0	2016.07.15	ISSUED FOR CONSTRUCTION
#	date	issue notes

professional seals

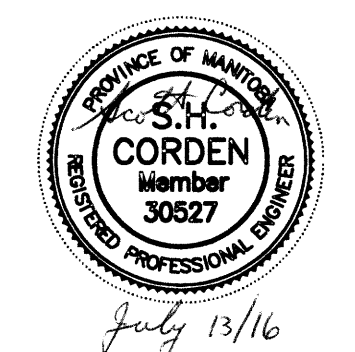

project information

SEVEN OAKS POOL
444 Adsum Drive
Winnipeg, MB
Canada

client

City of Winnipeg
4th Floor - 86 King Street
Winnipeg, MB

drawing information

MECHANICAL BASEMENT PLAN PLUMBING AND HVAC - DEMO

drawn by: RLR
approved by: *[Signature]*
scale: AS NOTED
date issued: 2016.07.15
proj. #: 14-1736-008
rev. #: R-0

SEVEN OAKS POOL RENOVATION & ADDITION
BID OPPORTUNITY NO. 645-2016

1 BASEMENT PLAN - PLUMBING AND HVAC DEMO
SCALE: 1:100

SCALE VERIFIED BY: *[Signature]*

