


KEYNOTES:


- 1 CONNECT NEW DUCTWORK TO EXISTING DUCT SERVING STORAGE ROOM.
- 2 PROVIDE NEW DUCTWORK AND NEW GRILLES SERVING CHANGE BOOTHS.
- 3 PROVIDE AND INSTALL HRV-1, HRV-2 AND ASSOCIATED DUCTWORK. SUPPORT FROM FLOOR C/W VIBRATION ISOLATORS AND FLEXIBLE DUCT CONNECTIONS. PROVIDE ROOF TOP GOOSENECKS FOR OUTSIDE AIR AND EXHAUST LOCATED 15FT AWAY FROM EACH OTHER. INSULATE DUCTWORK CONNECTED TO OUTDOORS.
- 4 PROVIDE AND INSTALL AHU-3 ON NEW HOUSEKEEPING PAD C/W RETURN FAN RF-1, ASSOCIATED DUCTWORK AND SUPPLY AND EXHAUST FAN GOOSENECKS. LOCATE SUPPLY AND EXHAUST GOOSENECKS 15FT AWAY FROM EACH OTHER.
- 5 CONNECT NEW DUCTWORK, VAV-9, HC-9 TO SERVE MEZZANINE LEVEL.
- 6 SUPPLY AND INSTALL VAV-6 IN THE MEZZANINE AT HIGH LEVEL C/W VIBRATION ISOLATION, FLEXIBLE DUCT CONNECTIONS, AND RHC-6. PROVIDE ACCESS DOOR FOR RE-HEAT COIL MAINTENANCE.
- 7 PROVIDE NEW RETURN DUCT LOCATED IN MEZZANINE BULKHEAD. RETURN GRILLES LOCATED AT HIGH LEVEL ABOVE BALCONY.
- 8 INSTALL EXISTING GROUND MOUNTED CONDENSING UNIT ON ROOF TO SERVE AHU-3. INSTALL INSULATED REFRIGERANT LINES BETWEEN CU-3 AND AHU-3.
- 9 PROVIDE NEW SIDEWALL GRILLES SERVING LOBBY IN EXISTING GRILLE PENETRATION LOCATION. MODIFY PENETRATION TO SUIT.
- 10 INSULATE EXHAUST DUCT UP TO NEW MOTORIZED DAMPER AND INSULATE OUTDOOR AIR DUCT UP TO NEW HRV-3 IN BASEMENT.
- 11 SUPPLY AND INSTALL VAV-4, VAV-5, VAV-7 AND VAV-8 IN THE MEZZANINE. SUPPORT FROM FLOOR AND PROVIDE ASSOCIATED RE-HEAT COILS. PROVIDE ACCESS DOOR FOR RE-HEAT COIL MAINTENANCE.
- 12 SUPPORT ALL NEW EQUIPMENT AND DUCTWORK IN MEZZANINE AREAS FROM FLOOR.

NOTE: ALL INDOOR SUPPLY AIR DUCT IS THERMALLY INSULATED. REFER TO SPECIFICATIONS.

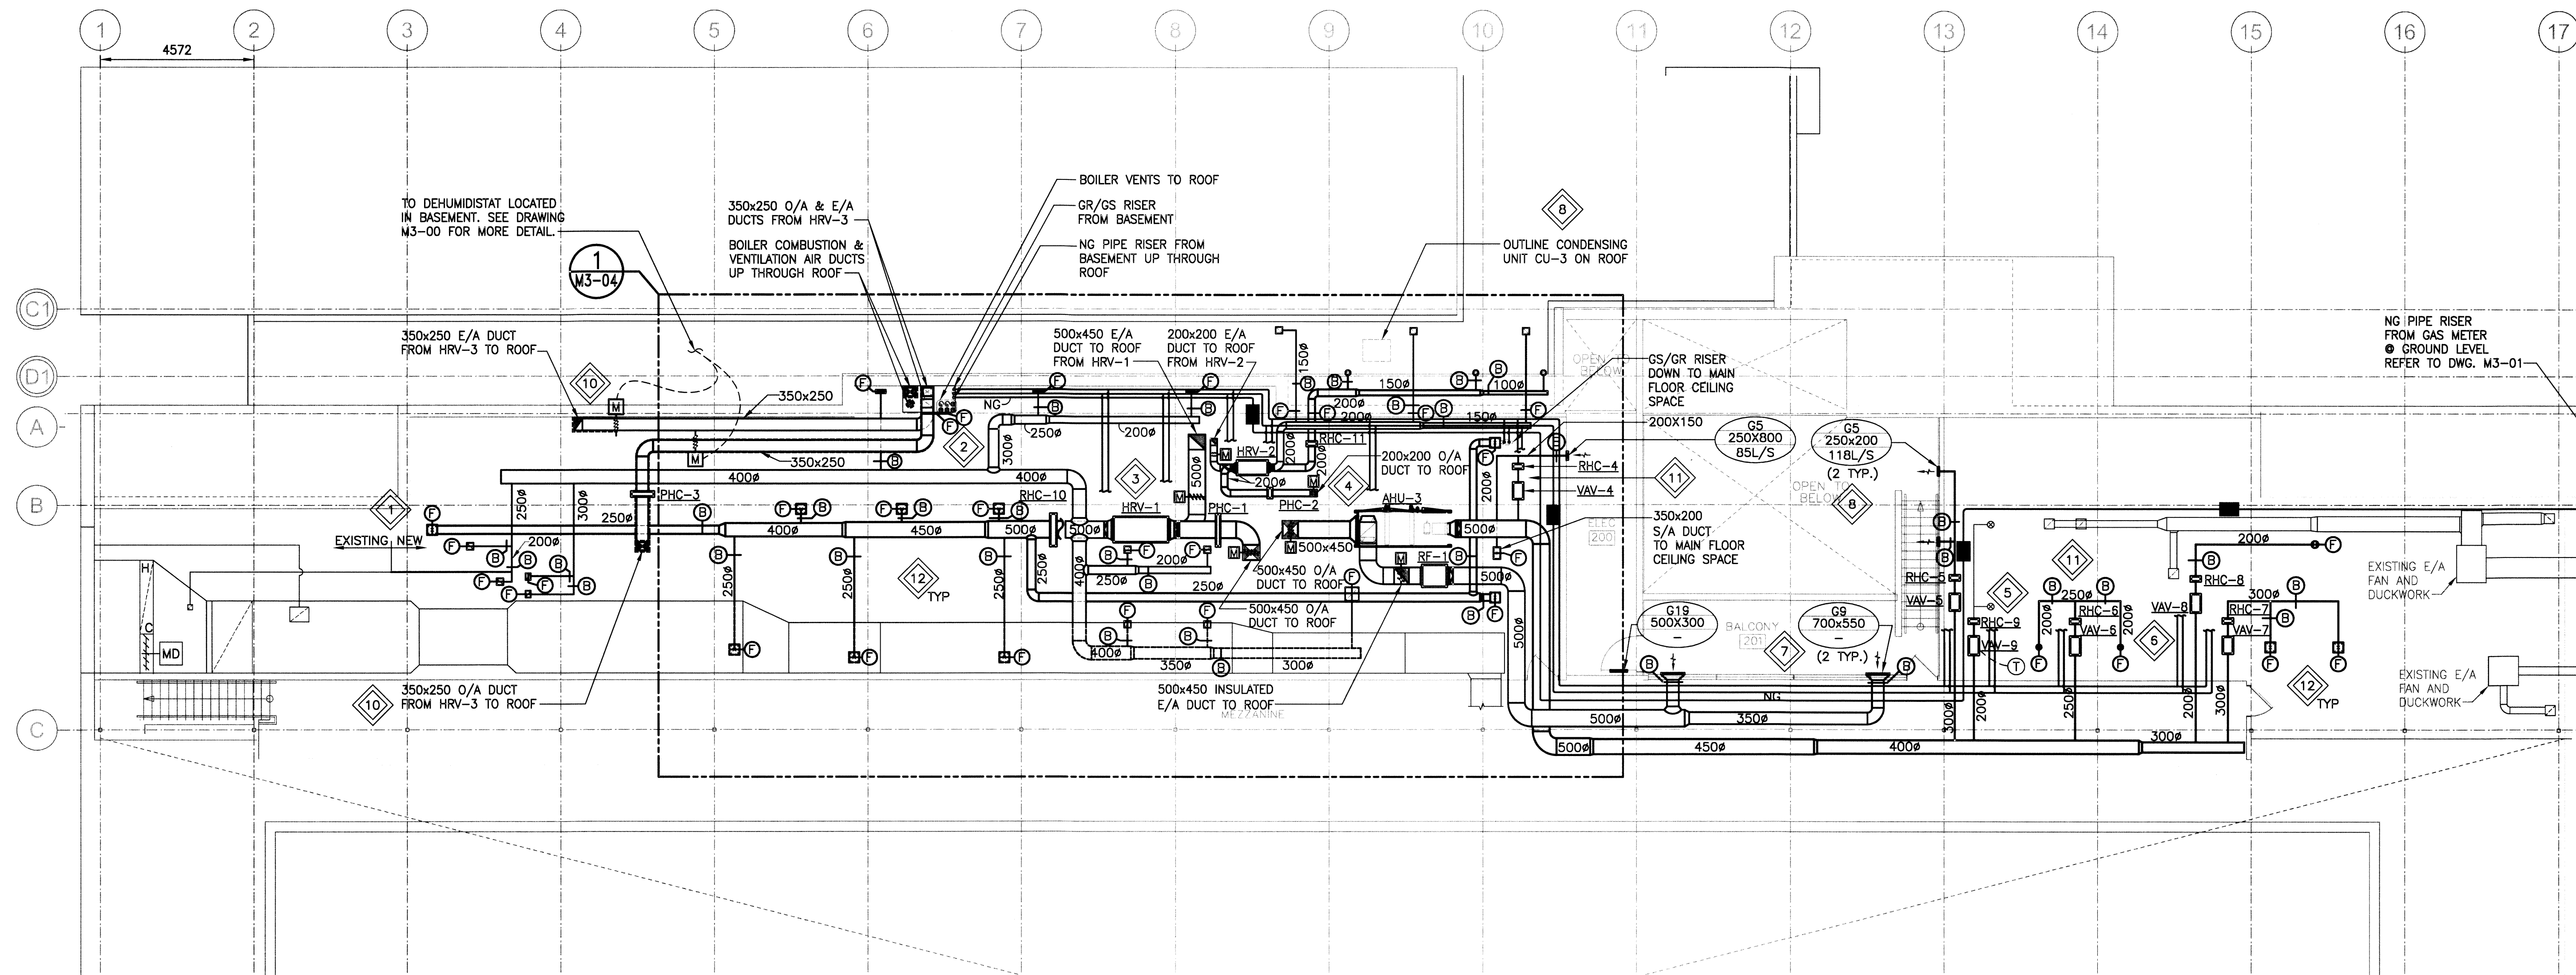

1 MEZZANINE PLAN - NEW HVAC
SCALE: 1:100

SCALE VERIFIED BY: *HC*

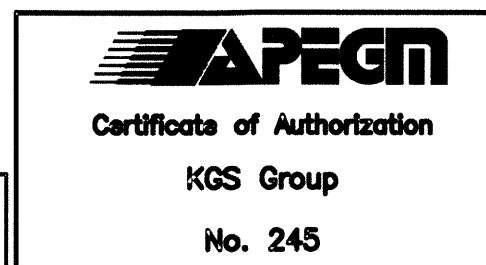

issue / rev.

0	2016/07/15	ISSUED FOR CONSTRUCTION
#	date	issue notes

professional seals



project information

SEVEN OAKS POOL

444 Adsum Drive
Winnipeg, MB
Canada

client

City of Winnipeg
4th Floor - 86 King Street
Winnipeg, MB

drawing information

MECHANICAL
MEZZANINE FLOOR PLAN
NEW HVAC

drawn by: RLR
approved by: *LR*

scale: AS NOTED
date issued: 2016.07.15
proj. #: 14-1736-008
rev. #: R-0

SEVEN OAKS POOL
RENOVATION & ADDITION
BID OPPORTUNITY NO. 646-2016

File Name: P:\Projects\2014\14-1736-008\DWG\Mech\14-1736-008_M3-02.dwg - Tab: M3-02 Plotted By: dderoché 16/07/13 [Wed 4:08pm]

This drawing must not be scaled. The contractor shall verify all dimensions and other data on site prior to commencement of work. All discrepancies, errors, and omissions are to be reported to the architect. Drawing and specifications, as instruments of service, are the property of the architect. No reproduction may be made without the permission of the architect, and when made, must bear his name. All prints to be returned to the architect on request.