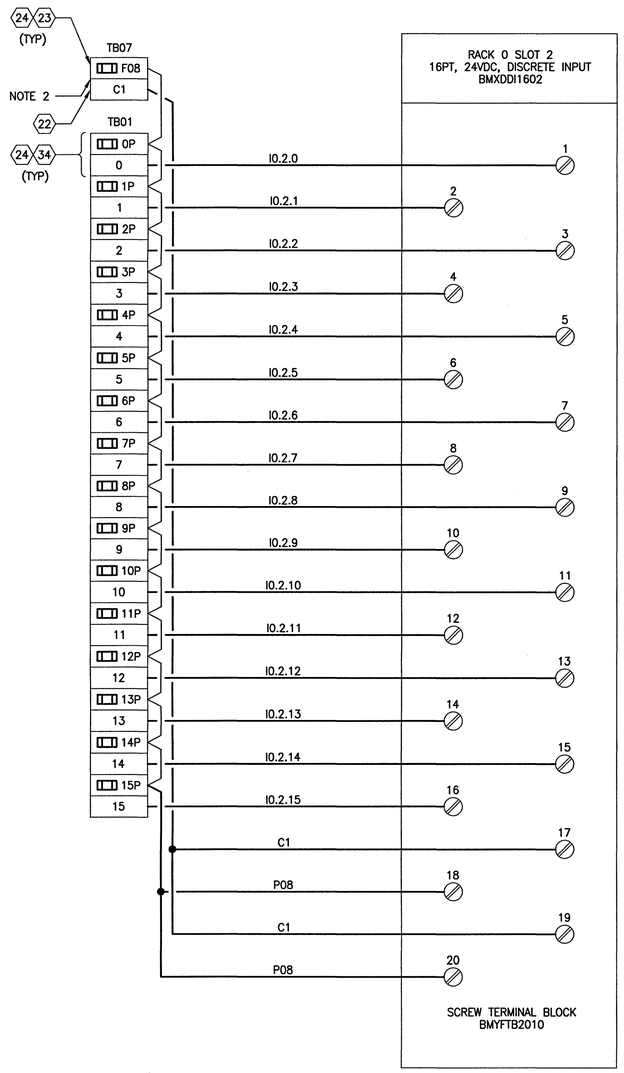


## NOTES:

1. SEE DRAWING 1-0103-ACBD-Z002 FOR BILL OF MATERIALS.
2. REFER TO DRAWING 1-0103-ACBD-Z003 FOR FUSE SCHEDULE.

## LEGEND:

⬡ BILL OF MATERIALS ITEM

| NO. | REVISIONS | DATE | DESIGN | CHECK |
|---|---|---|---|---|
| 00 | ISSUED FOR CONSTRUCTION | 2016/09/02 | DDW | GMS |

B.M. –
ELEV. –

APEGM
Certificate of Authorization
KGS Group
No. 245

KGS GROUP CONSULTING ENGINEERS

DESIGNED BY: C. S. ROBINSON
CHECKED BY: J.A. BOUCHARD
DRAWN BY: J. P. DELEON
APPROVED BY: J.A. BOUCHARD
SCALE: N.T.S.
ISSUED FOR CONSTRUCTION BY:
DATE: 2016/06/27
DATE:
CONSULTANT NO.: 15-0107-019_E33

ENGINEER'S SEAL
PROVINCE OF MANITOBA
BOUCHARD
Member
20560
REGISTERED PROFESSIONAL ENGINEER
16/09/02

Winnipeg
THE CITY OF WINNIPEG
WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT
EFFLUENT MONITORING STATION
MODULE WIRING DIAGRAM
RACK 0 SLOT 2
DISCRETE INPUT

| CITY DRAWING NUMBER | SHEET | REV. | SIZE |
|---|---|---|---|
| 1-0103-ACBD-Z004 | | 00 | A1 |

PLOT DATE: Sep 02, 2016 – 12:22pm
FILE NAME: 15-0107-019_E33.dwg

A1 SIZE – 594mm x 841mm

FileName: P:\Projects\2015\15-0107-019\Dwg\Elec\15-0107-019_E33.dwg – Tab: E33 Plotted By: dderoche 09/02/2016 [Fri 12:22pm]