


B SIZE - 279mm x 432mm

Filename: P:\Projects\2015\15-0107-019\Elec\Elec\15-0107-019\_E21.dwg - Tab: E21 Plotted By: dderoche 09/02/2016 [Fr. 3:29pm]

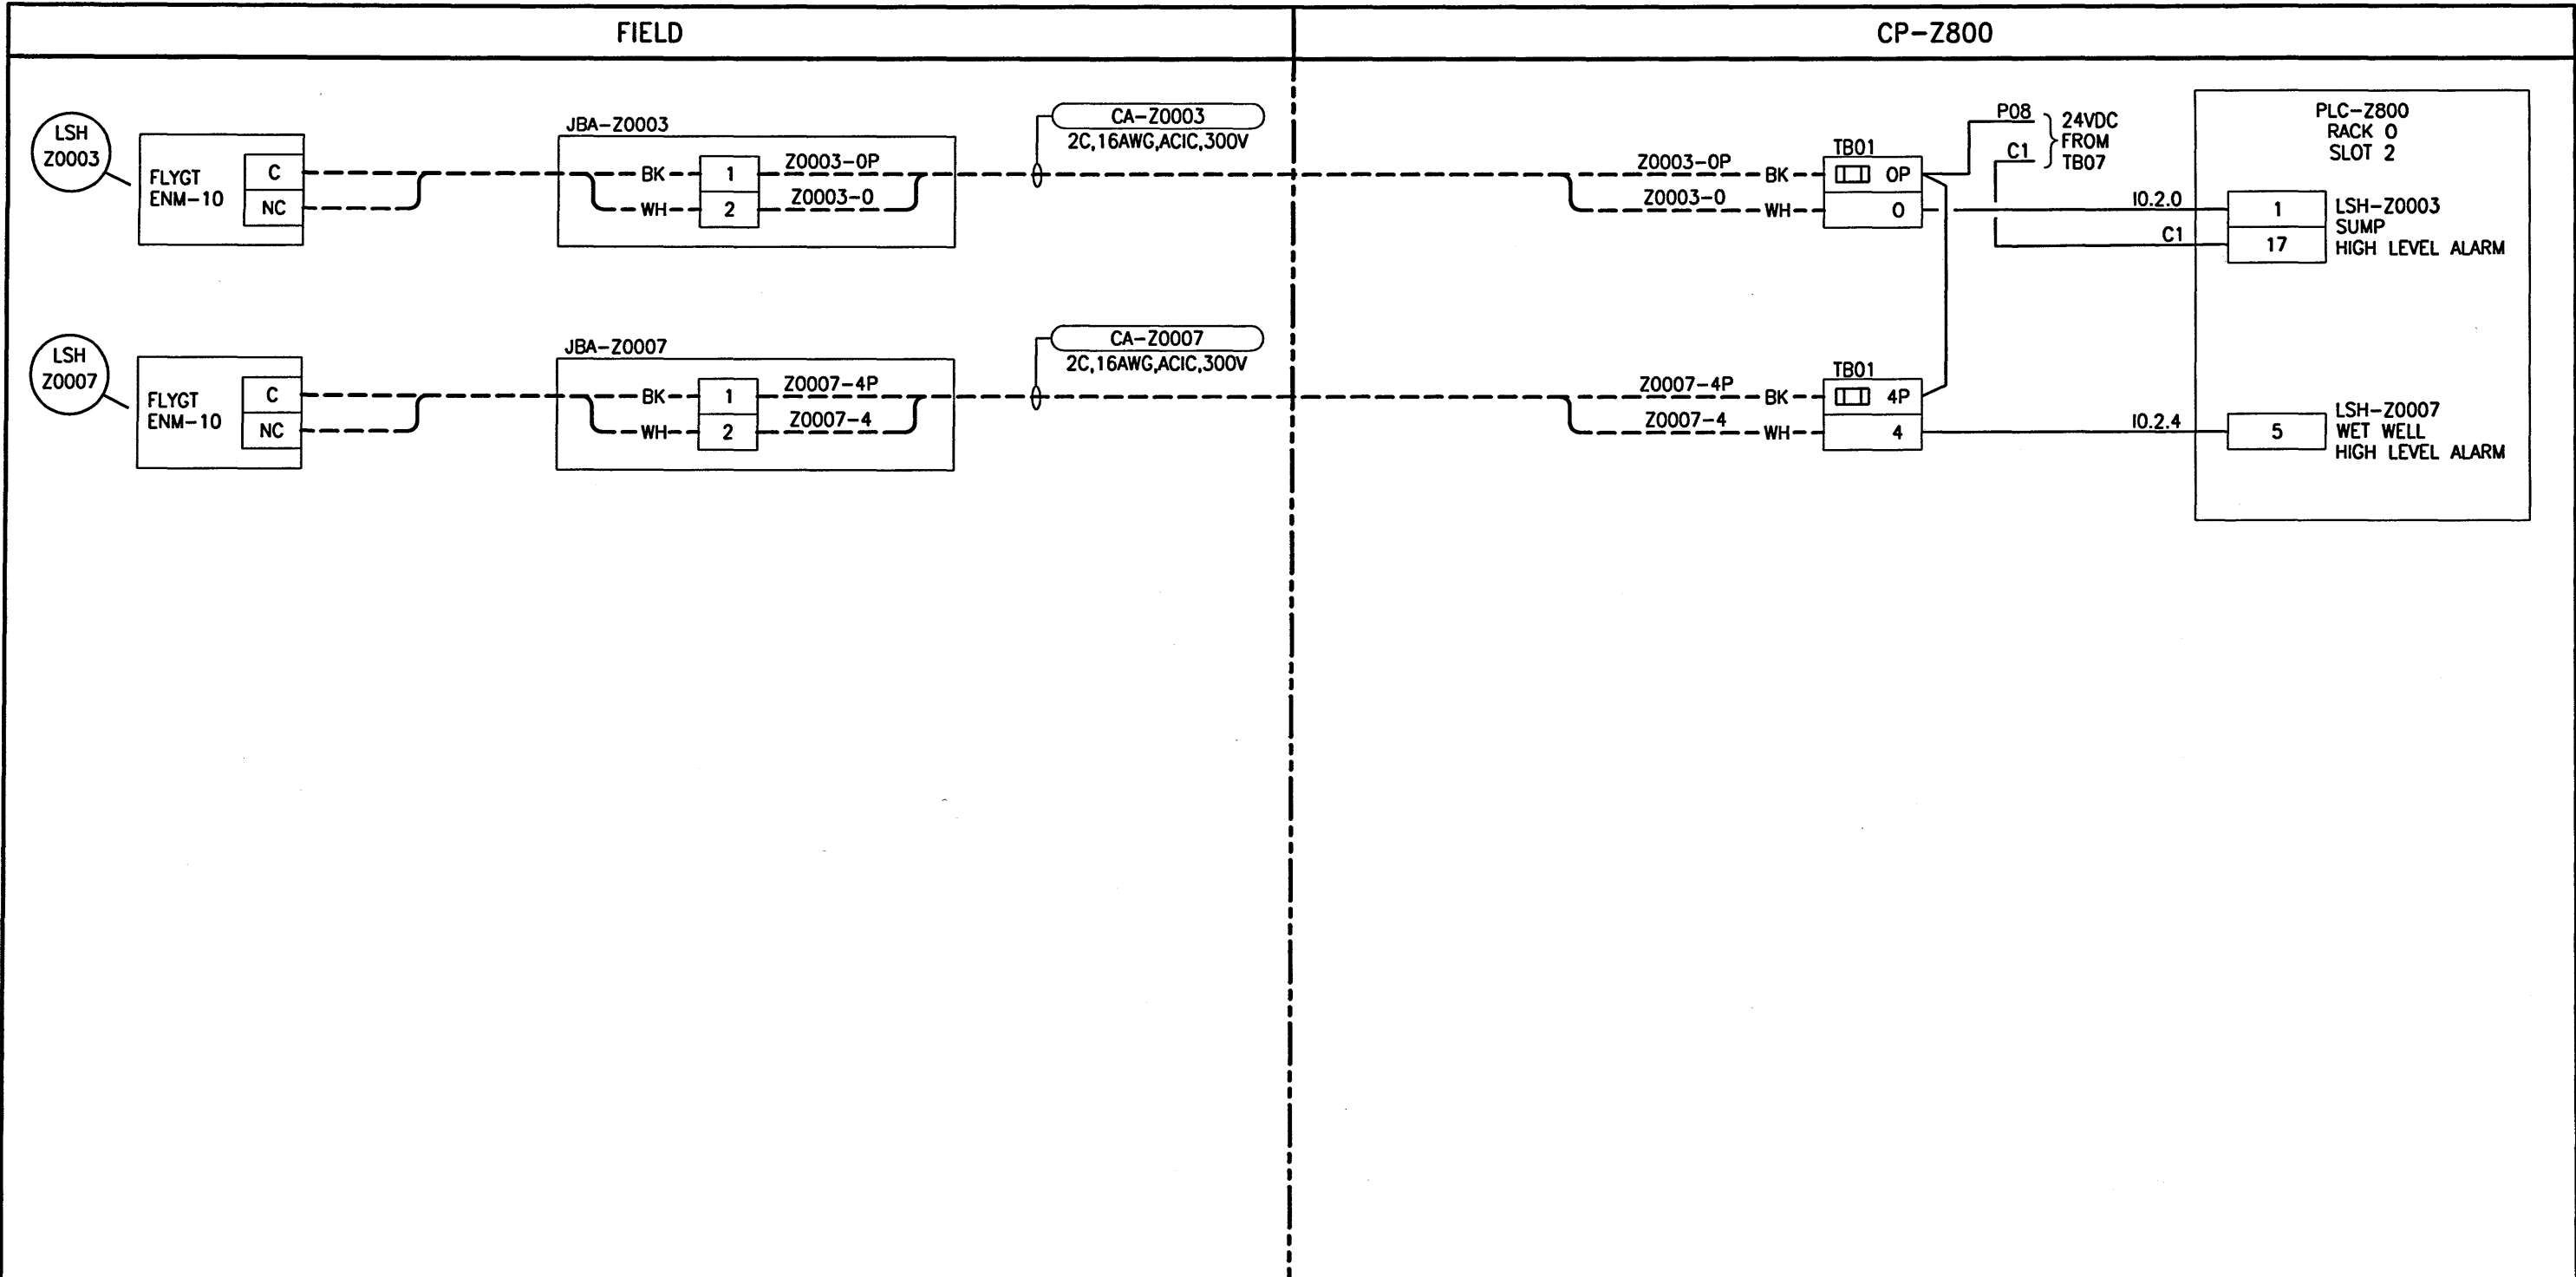

**NOTES:**

1. -

**LEGEND:**

— PANEL WIRING  
 - - - - - FIELD WIRING



<b>KGS GROUP   CONSULTING ENGINEERS</b>				
DESIGNED BY:	C. S. ROBINSON	CHECKED BY:	J.A. BOUCHARD	
DRAWN BY:	D. SHABATAEV	APPROVED BY:	J.A. BOUCHARD	
SCALE:	N.T.S.	DATE:	2016/06/06	
BY:	RELEASED FOR CONSTRUCTION DATE:			
00	ISSUED FOR CONSTRUCTION	2016/09/02	DDW	MS
NO.	REVISIONS	DATE	DESIGN	CHECK

CONSULTANT NO.: 15-0107-019\_E21

ENGINEER'S SEAL

16/09/16

**THE CITY OF WINNIPEG**  
 WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT  
 EFFLUENT MONITORING STATION  
 LOOP DIAGRAM  
 LSH-Z0003, LSH-Z0007

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0103-AILD-Z001	1	00	B