


B SIZE - 279mm x 432mm
 File Name: P:\Projects\2015\15-0107-019\E22.dwg - Tab: E22 Polled By: dderoché 09/02/2016 (Fr. 3:29pm)



NOTES:
 1. CABLE CONTAINS 120VAC CIRCUIT.

LEGEND:
 _____ PANEL WIRING
 - - - - - FIELD WIRING

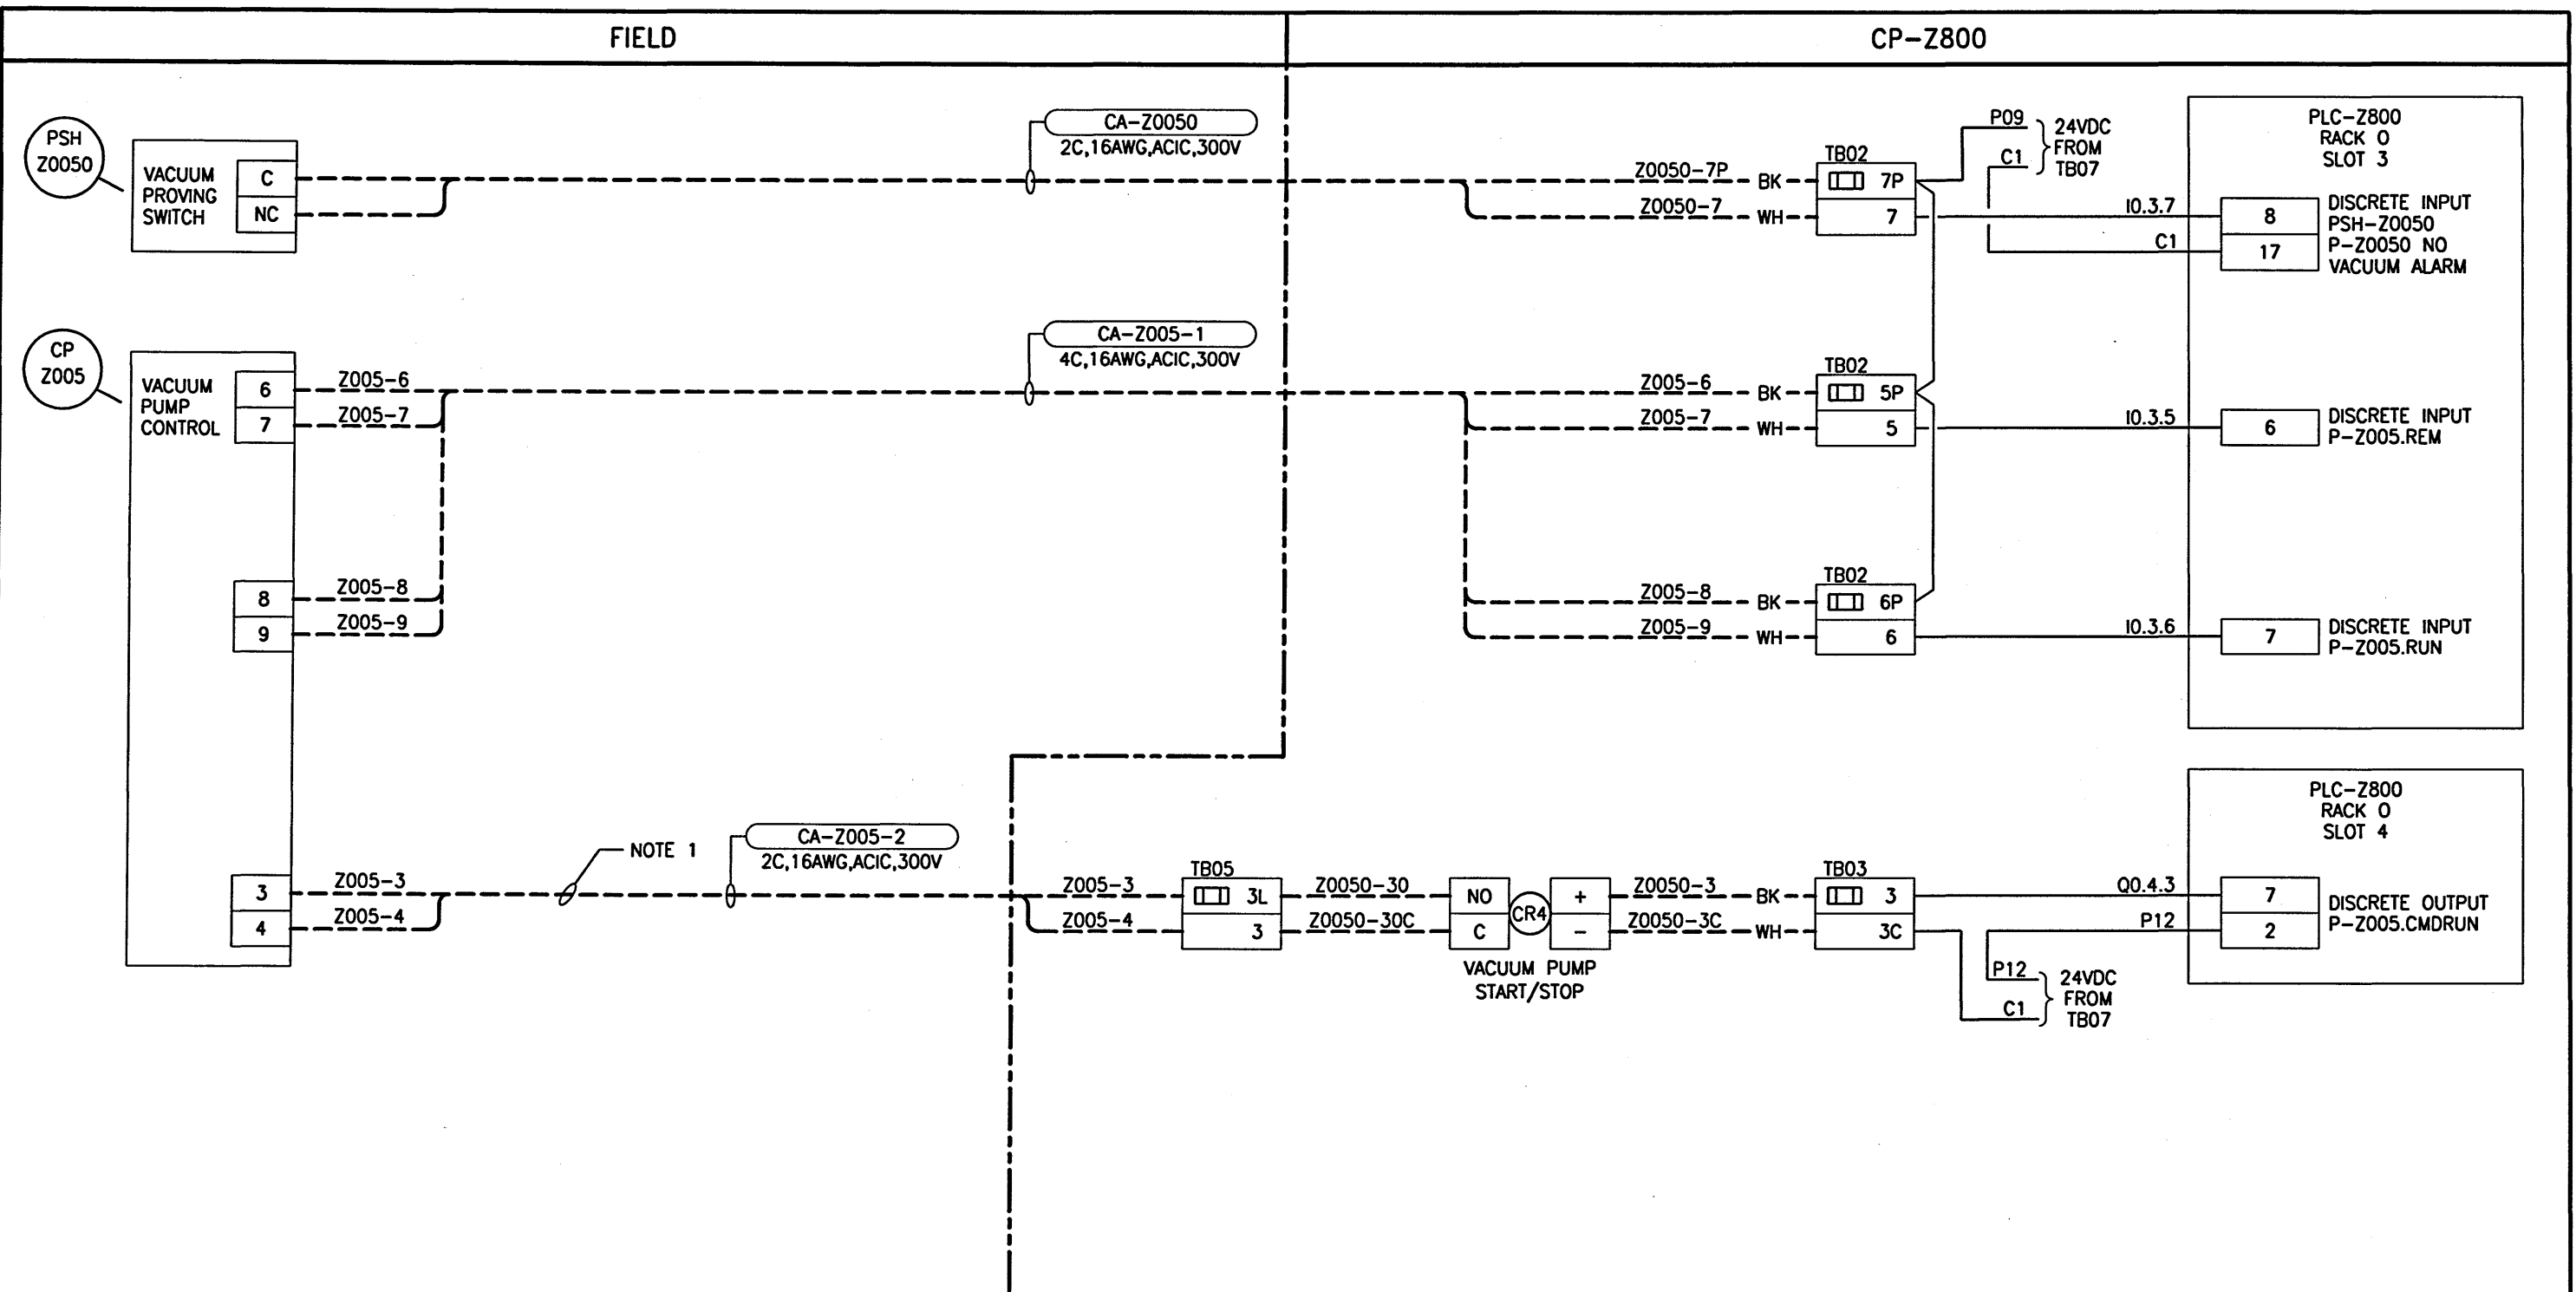

KGS GROUP CONSULTING ENGINEERS			
DESIGNED BY: C. S. ROBINSON	CHECKED BY: <i>J.A. BOUCHARD</i>		
DRAWN BY: D. SHABATAEV	APPROVED BY: <i>J.A. BOUCHARD</i>		
SCALE: N.T.S.	DATE: 2016/06/06		
RELEASED FOR CONSTRUCTION DATE:			
CONSULTANT NO.:		15-0107-019_E22	
NO.	REVISIONS	DATE	DESIGN CHECK
00	ISSUED FOR CONSTRUCTION	2016/09/02	<i>DDW JAS</i>

ENGINEER'S SEAL

16/09/02

THE CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT

WEST END SEWAGE TREATMENT PLANT
 EFFLUENT MONITORING STATION
 LOOP DIAGRAM
 PSH-Z0050, CP-Z005

CITY DRAWING NUMBER	SHEET	REV.	SIZE
1-0103-AILD-Z002	1	00	B